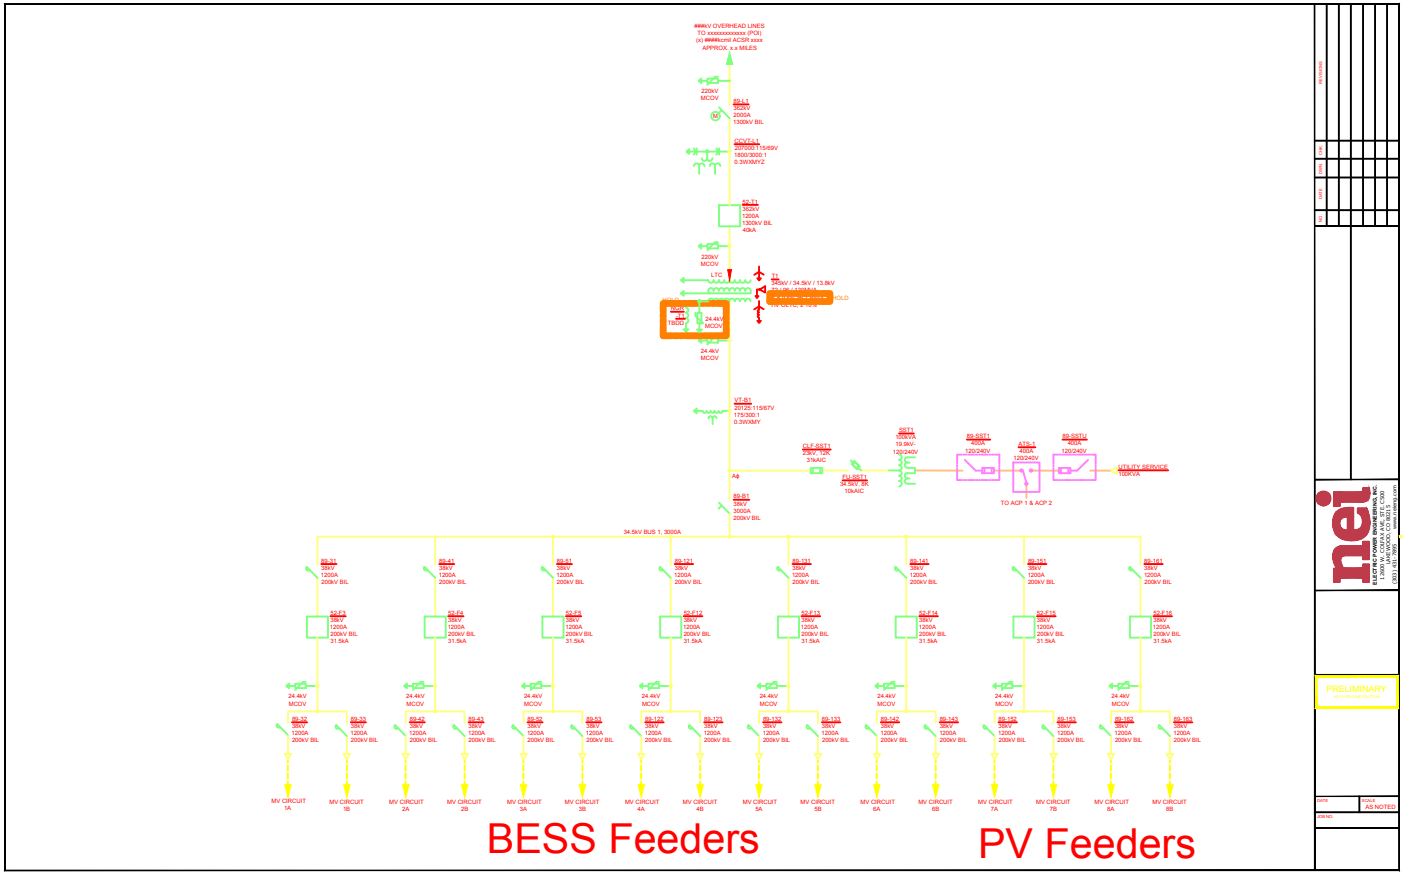
###kV OVERHEAD LINES
TO xxxxxxxxxxxx (POI)
(x) ####cmil ACSR xxxx
APPROX. x.x MILES
220kV MCOV
89-L1 362kV 2000A 1300kV BIL
CCVT-L1 220000/115/69V 1600:300:1 0.3W/0M/Y
89-T1 362kV 1200A 1300kV BIL 40kA
220kV MCOV
LTC
T1 345kV / 34.5kV / 13.8kV
24.4kV MCOV
24.4kV MCOV
VT-B1 20125:115/67V 175/300:1 0.3W/0M/Y
CLF-SST1 23kV, 12K 3YA/AC
SST1 1000VA 19.9kV- 120/240V
89-SST1 400A 120/240V
ATS-1 400A 120/240V
89-SST2 400A 120/240V
UTILITY SERVICE 1000VA
TO ACP 1 & ACP 2
FU-SST1 24.9kV SR 10kAIC
A6
89-B1 38kV 3000A 200kV BIL
34.5kV BUS 1, 3000A
89-31 38kV 1200A 200kV BIL
89-41 38kV 1200A 200kV BIL
89-51 38kV 1200A 200kV BIL
89-121 38kV 1200A 200kV BIL
89-131 38kV 1200A 200kV BIL
89-141 38kV 1200A 200kV BIL
89-151 38kV 1200A 200kV BIL
89-161 38kV 1200A 200kV BIL
52-F3 38kV 1200A 200kV BIL 31.5kA
52-F4 38kV 1200A 200kV BIL 31.5kA
52-F5 38kV 1200A 200kV BIL 31.5kA
52-F12 38kV 1200A 200kV BIL 31.5kA
52-F13 38kV 1200A 200kV BIL 31.5kA
52-F14 38kV 1200A 200kV BIL 31.5kA
52-F15 38kV 1200A 200kV BIL 31.5kA
52-F16 38kV 1200A 200kV BIL 31.5kA
24.4kV MCOV
89-32 38kV 1200A 200kV BIL
89-33 38kV 1200A 200kV BIL
89-42 38kV 1200A 200kV BIL
89-43 38kV 1200A 200kV BIL
89-52 38kV 1200A 200kV BIL
89-53 38kV 1200A 200kV BIL
89-122 38kV 1200A 200kV BIL
89-123 38kV 1200A 200kV BIL
89-132 38kV 1200A 200kV BIL
89-133 38kV 1200A 200kV BIL
89-142 38kV 1200A 200kV BIL
89-143 38kV 1200A 200kV BIL
89-152 38kV 1200A 200kV BIL
89-153 38kV 1200A 200kV BIL
89-162 38kV 1200A 200kV BIL
89-163 38kV 1200A 200kV BIL
MV CIRCUIT 1A
MV CIRCUIT 1B
MV CIRCUIT 2A
MV CIRCUIT 2B
MV CIRCUIT 3A
MV CIRCUIT 3B
MV CIRCUIT 4A
MV CIRCUIT 4B
MV CIRCUIT 5A
MV CIRCUIT 5B
MV CIRCUIT 6A
MV CIRCUIT 6B
MV CIRCUIT 7A
MV CIRCUIT 7B
MV CIRCUIT 8A
MV CIRCUIT 8B
BESS Feeders
PV Feeders
nei
ELECTRICAL POWER ENGINEERING, INC.
1 XXX AV, XXXXX, XXX 00000
(XXX) XXX-XXXX
www.neiengr.com
PRELIMINARY
NOT FOR CONSTRUCTION
SCALE
AS NOTED