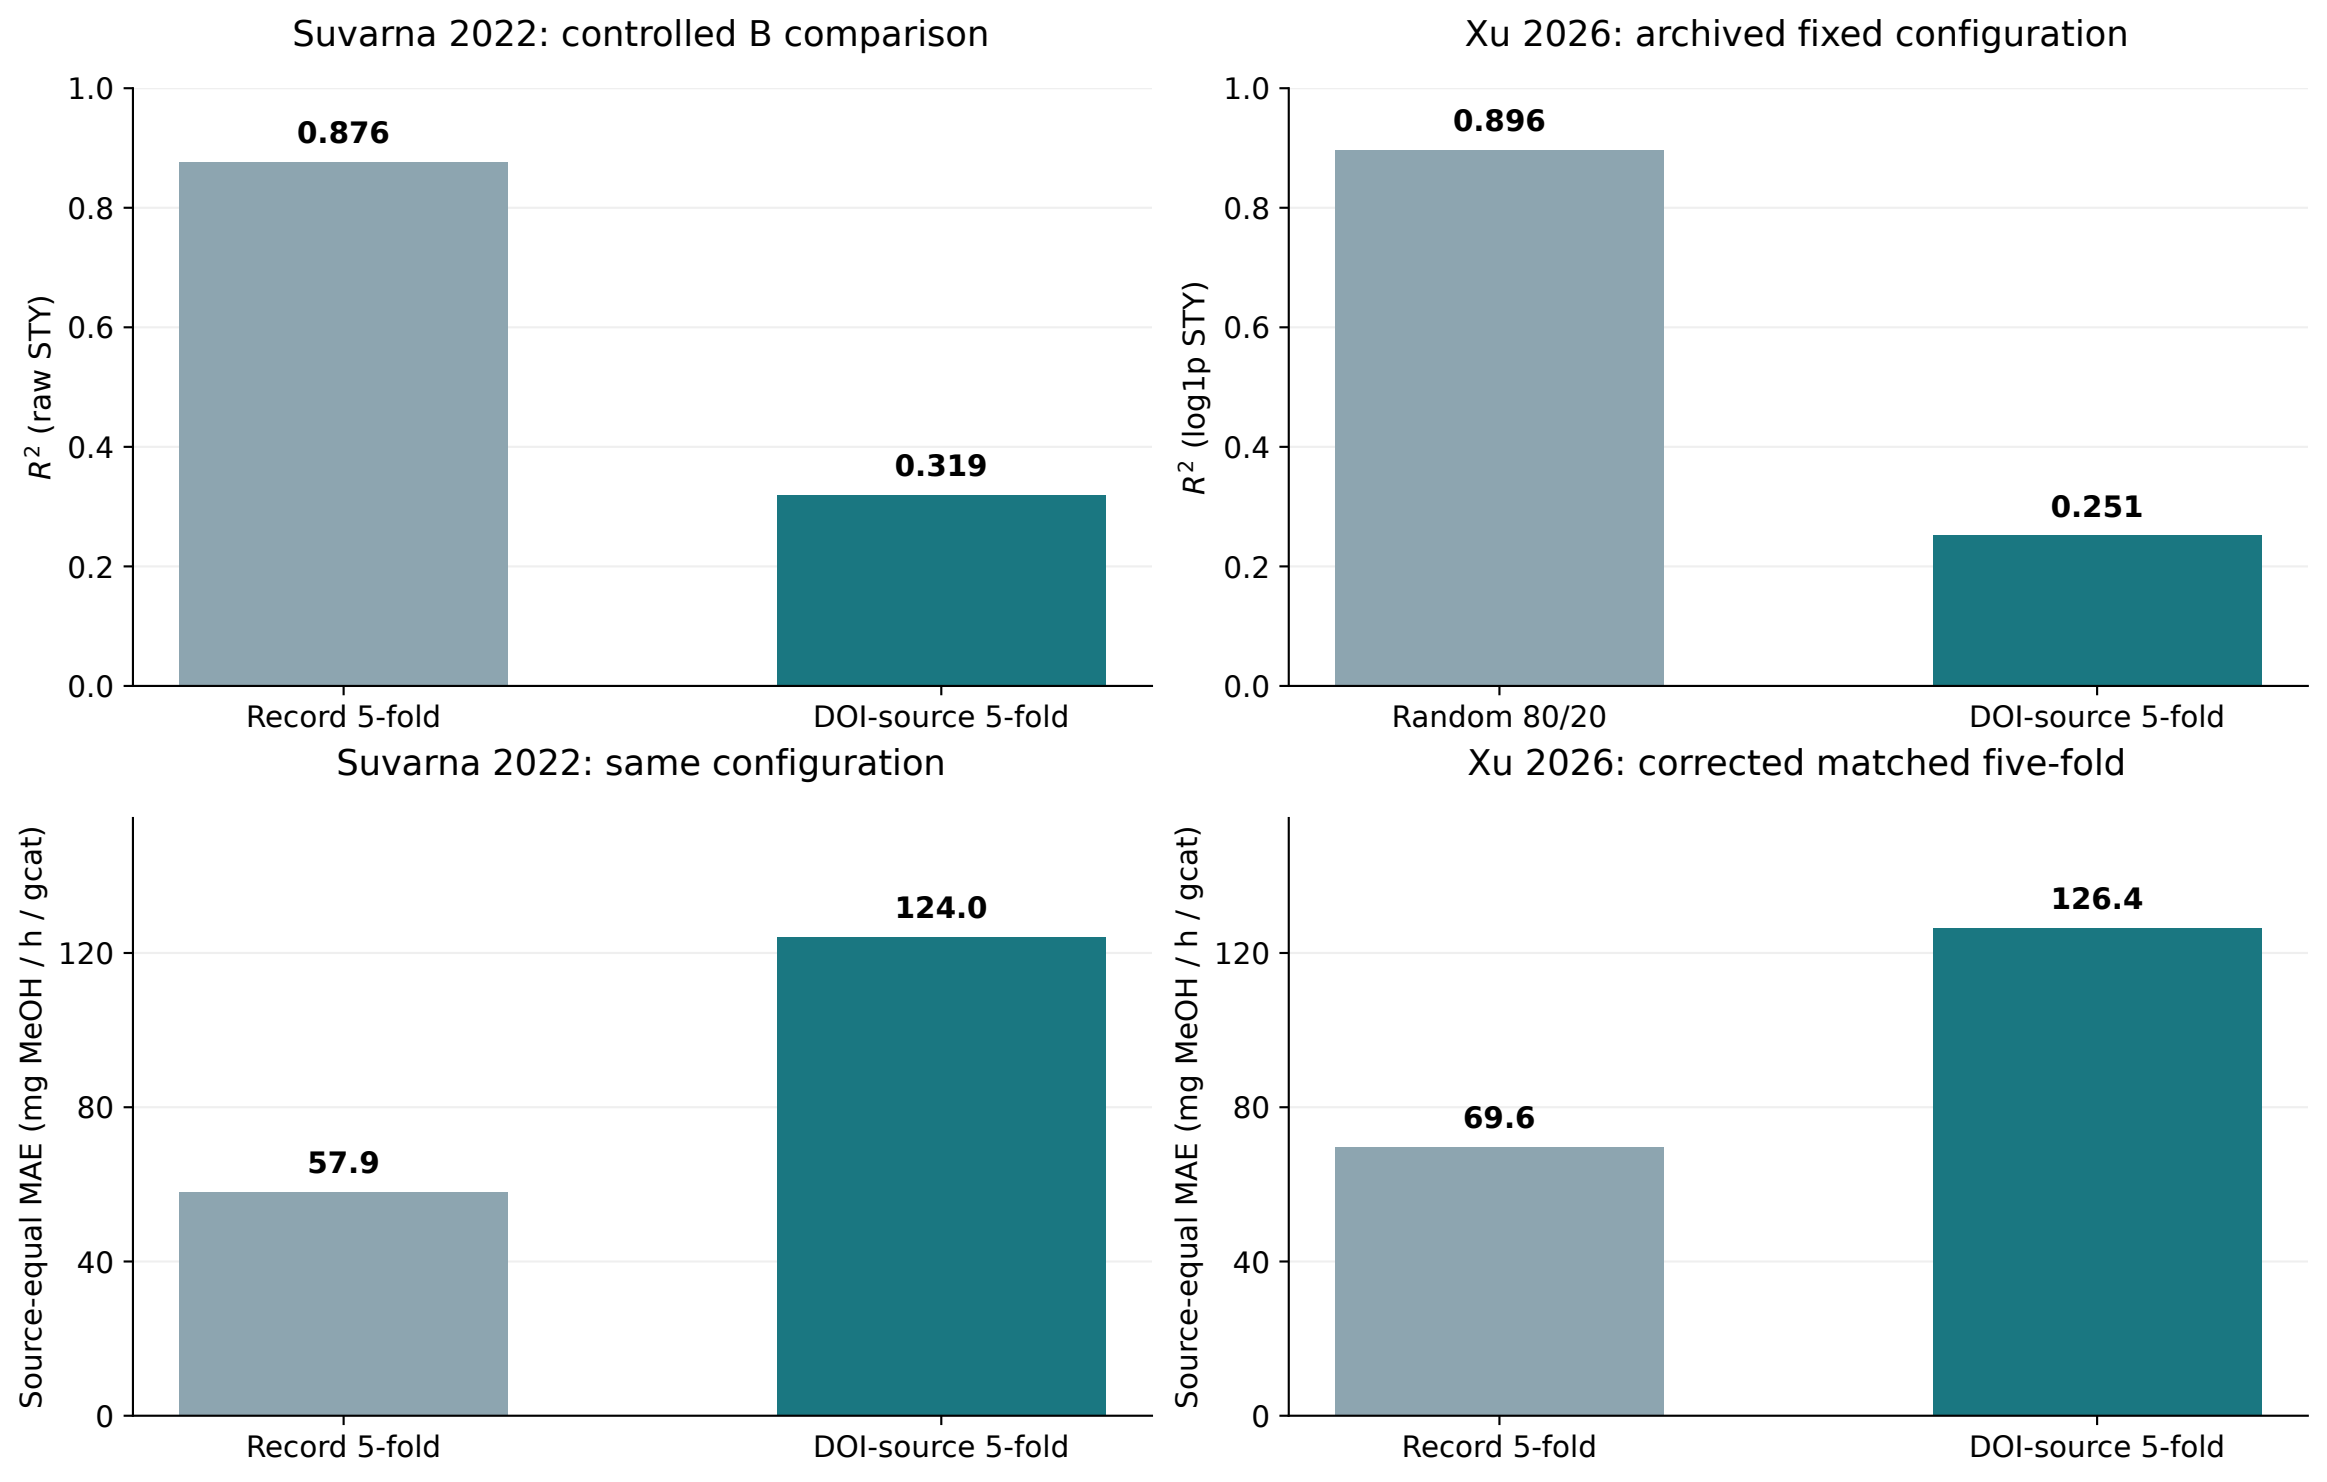
Suvarna 2022: controlled B comparison
R^2 (raw STY)
1.0
0.8
0.6
0.4
0.2
0.0
0.876
0.319
Record 5-fold
DOI-source 5-fold
Xu 2026: archived fixed configuration
R^2 (log1p STY)
0.896
0.251
Random 80/20
DOI-source 5-fold
Suvarna 2022: same configuration
Source-equal MAE (mg MeOH / h / gcat)
120
80
40
0
57.9
124.0
Record 5-fold
DOI-source 5-fold
Xu 2026: corrected matched five-fold
69.6
126.4
Record 5-fold
DOI-source 5-fold