


Predicted PFAS Risk x EJ Communities — Untested MA Public Water Systems

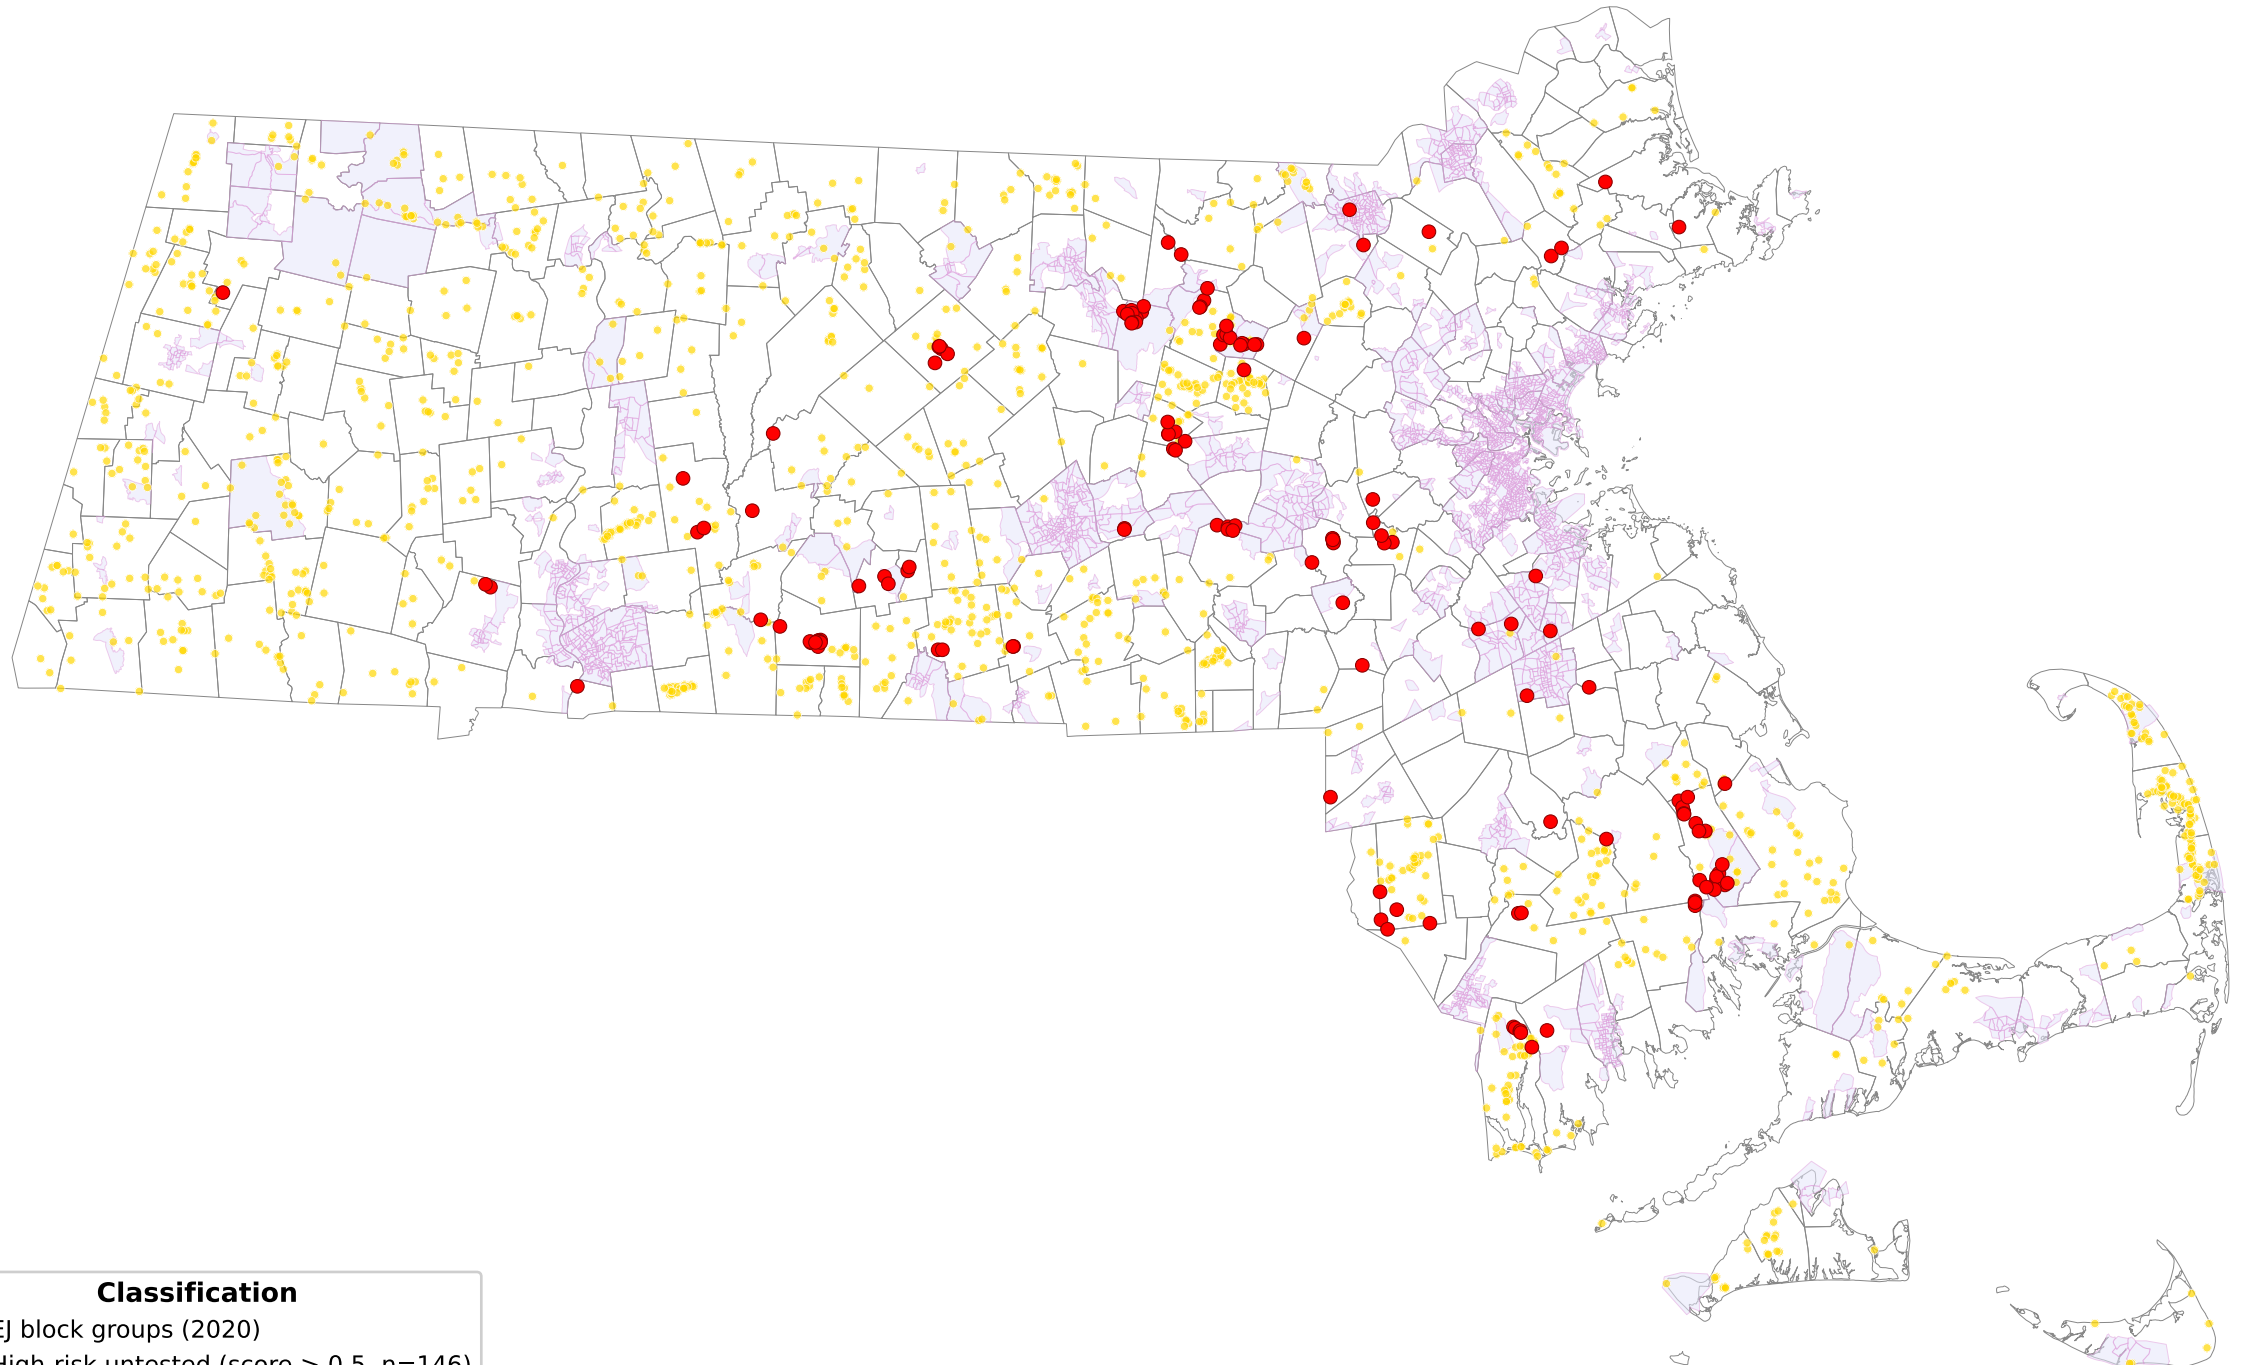

Classification

-  EJ block groups (2020)
-  High-risk untested (score > 0.5, n=146)
-  Lower-risk untested (n=1452)