```
Testing SPIOutCommand: ok, Score =8
Testing SPIOutData: ok, Score =15
Testing OutDec: ok, Score =25
```

Output | GEL Output | Serial Console - COM5 | Debug Output | Debug Console | Memor

```
Test of OutDec
Your: 0 Correct: 0
Your: 7 Correct: 7
Your: 99 Correct: 99
Your: 100 Correct: 100
Your: 654 Correct: 654
Your: 999 Correct: 999
Your: 1000 Correct: 1000
Your: 5089 Correct: 5089
Your: 9999 Correct: 9999
Your: 10000 Correct: 10000
Your: 20806 Correct: 20806
Your: 65535 Correct: 65535
```

```
Testing SPIOutCommand: ok, Score =8
```

```
Testing SPIOutData: ok, Score =7
```

```
Testing OutDec: ok, Score =10
```

Register	Value
Core Registers	
PC	0x00000404
SP	0x20207FEC
LR	0x00000405
xPSR	0x21000000
R0	0x0000000C
R1	0x00000003
R2	0x00000000
R3	0x0000000C
R4	0xFFFFFFFF
R5	0xFFFFFFFF
R6	0xFFFFFFFF
R7	0xFFFFFFFF
R8	0xFFFFFFFF
R9	0xFFFFFFFF
R10	0xFFFFFFFF
R11	0xFFFFFFFF
R12	0xFFFFFFFF
R13	0x20207FEC
R14	0x00000405
MSP	0x20207FEC
PSP	0xFFFFFFFC
CTRL_PRI	0x00000000

Register	Value
Core Registers	
PC	0x0000040A
SP	0x20207FEC
LR	0x0000040B
xPSR	0x21000000
R0	0x000004D2
R1	0x00000005
R2	0x00000000
R3	0x000004D2
R4	0xFFFFFFFF
R5	0xFFFFFFFF
R6	0xFFFFFFFF
R7	0xFFFFFFFF
R8	0xFFFFFFFF
R9	0xFFFFFFFF
R10	0xFFFFFFFF
R11	0xFFFFFFFF
R12	0xFFFFFFFF
R13	0x20207FEC
R14	0x0000040B
MSP	0x20207FEC
PSP	0xFFFFFFFC
CTRL_PRI	0x00000000
adc0	

Register	Value
Core Registers	
PC	0x00000410
SP	0x20207FEC
LR	0x00000411
xPSR	0x61000000
R0	0x00000000
R1	0x00000000
R2	0x00000000
R3	0x00000000
R4	0xFFFFFFFF
R5	0xFFFFFFFF
R6	0xFFFFFFFF
R7	0xFFFFFFFF
R8	0xFFFFFFFF
R9	0xFFFFFFFF
R10	0xFFFFFFFF
R11	0xFFFFFFFF
R12	0xFFFFFFFF
R13	0x20207FEC
R14	0x00000411
MSP	0x20207FEC
PSP	0xFFFFFFFC
CTRL_PRI	0x00000000
adc0	

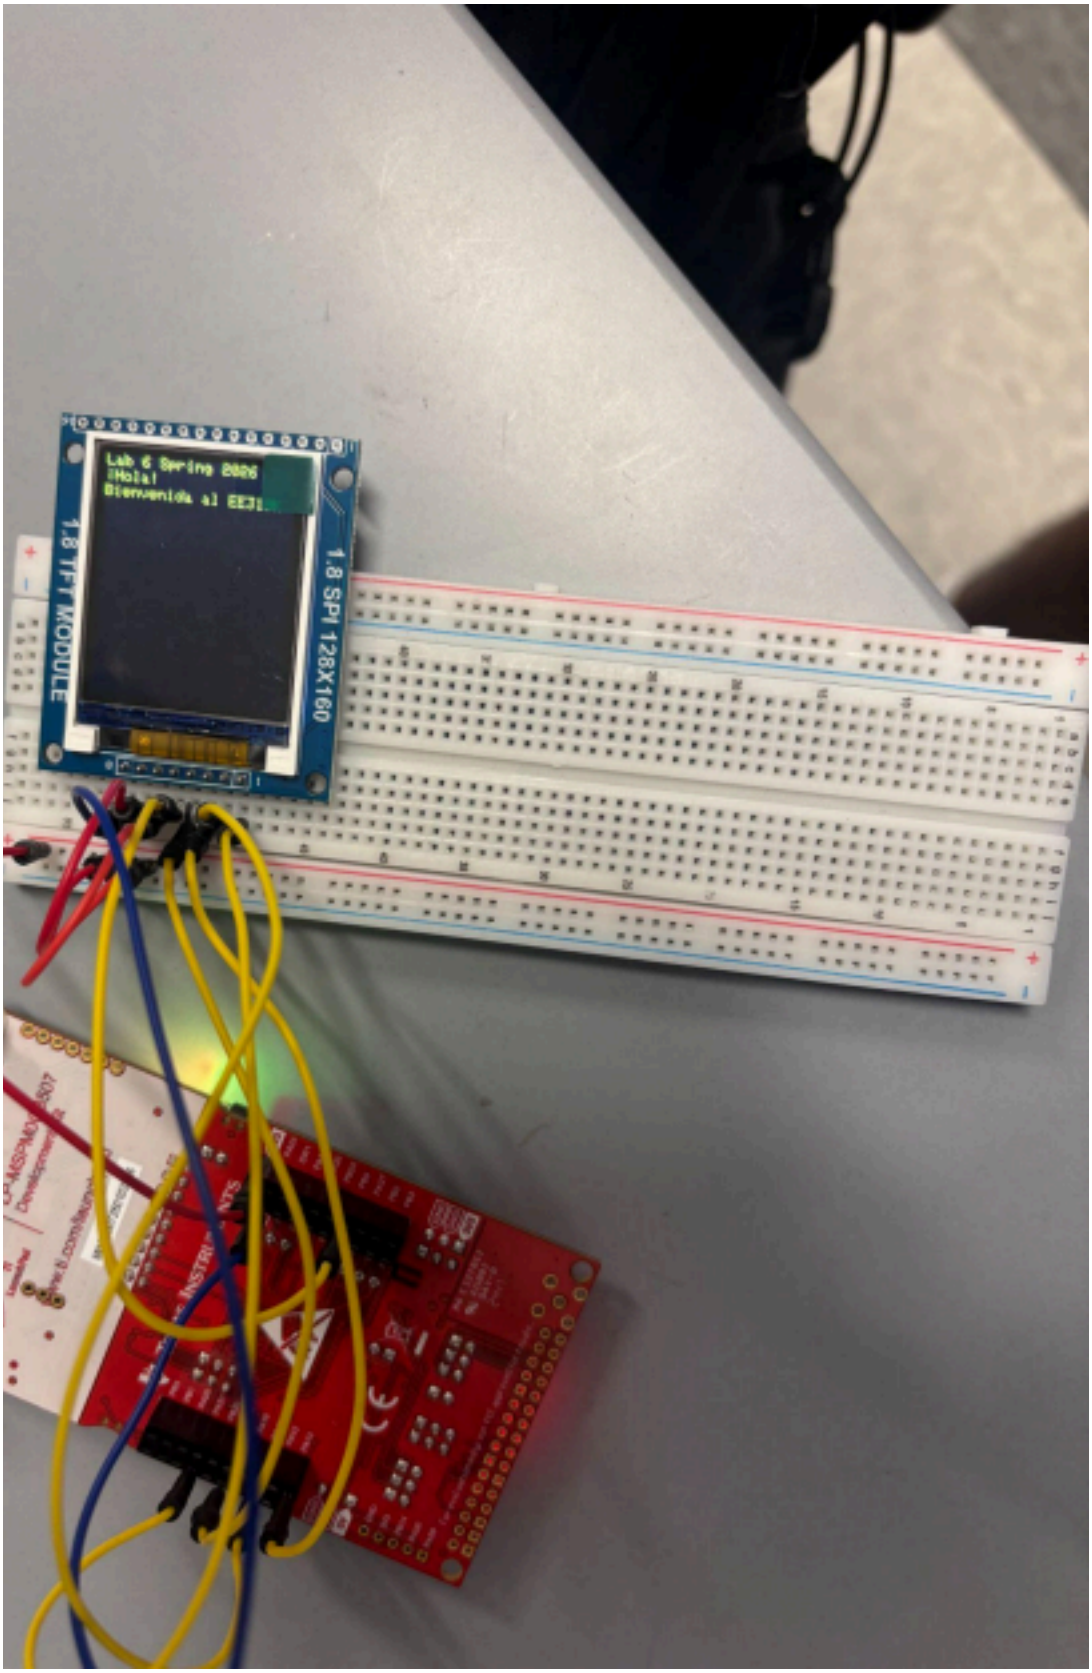
Lab 6 Spring 2026
¡Hola!
Bienvenida al EE3
1.8 TFT MODULE
1.8 SPI 128X160

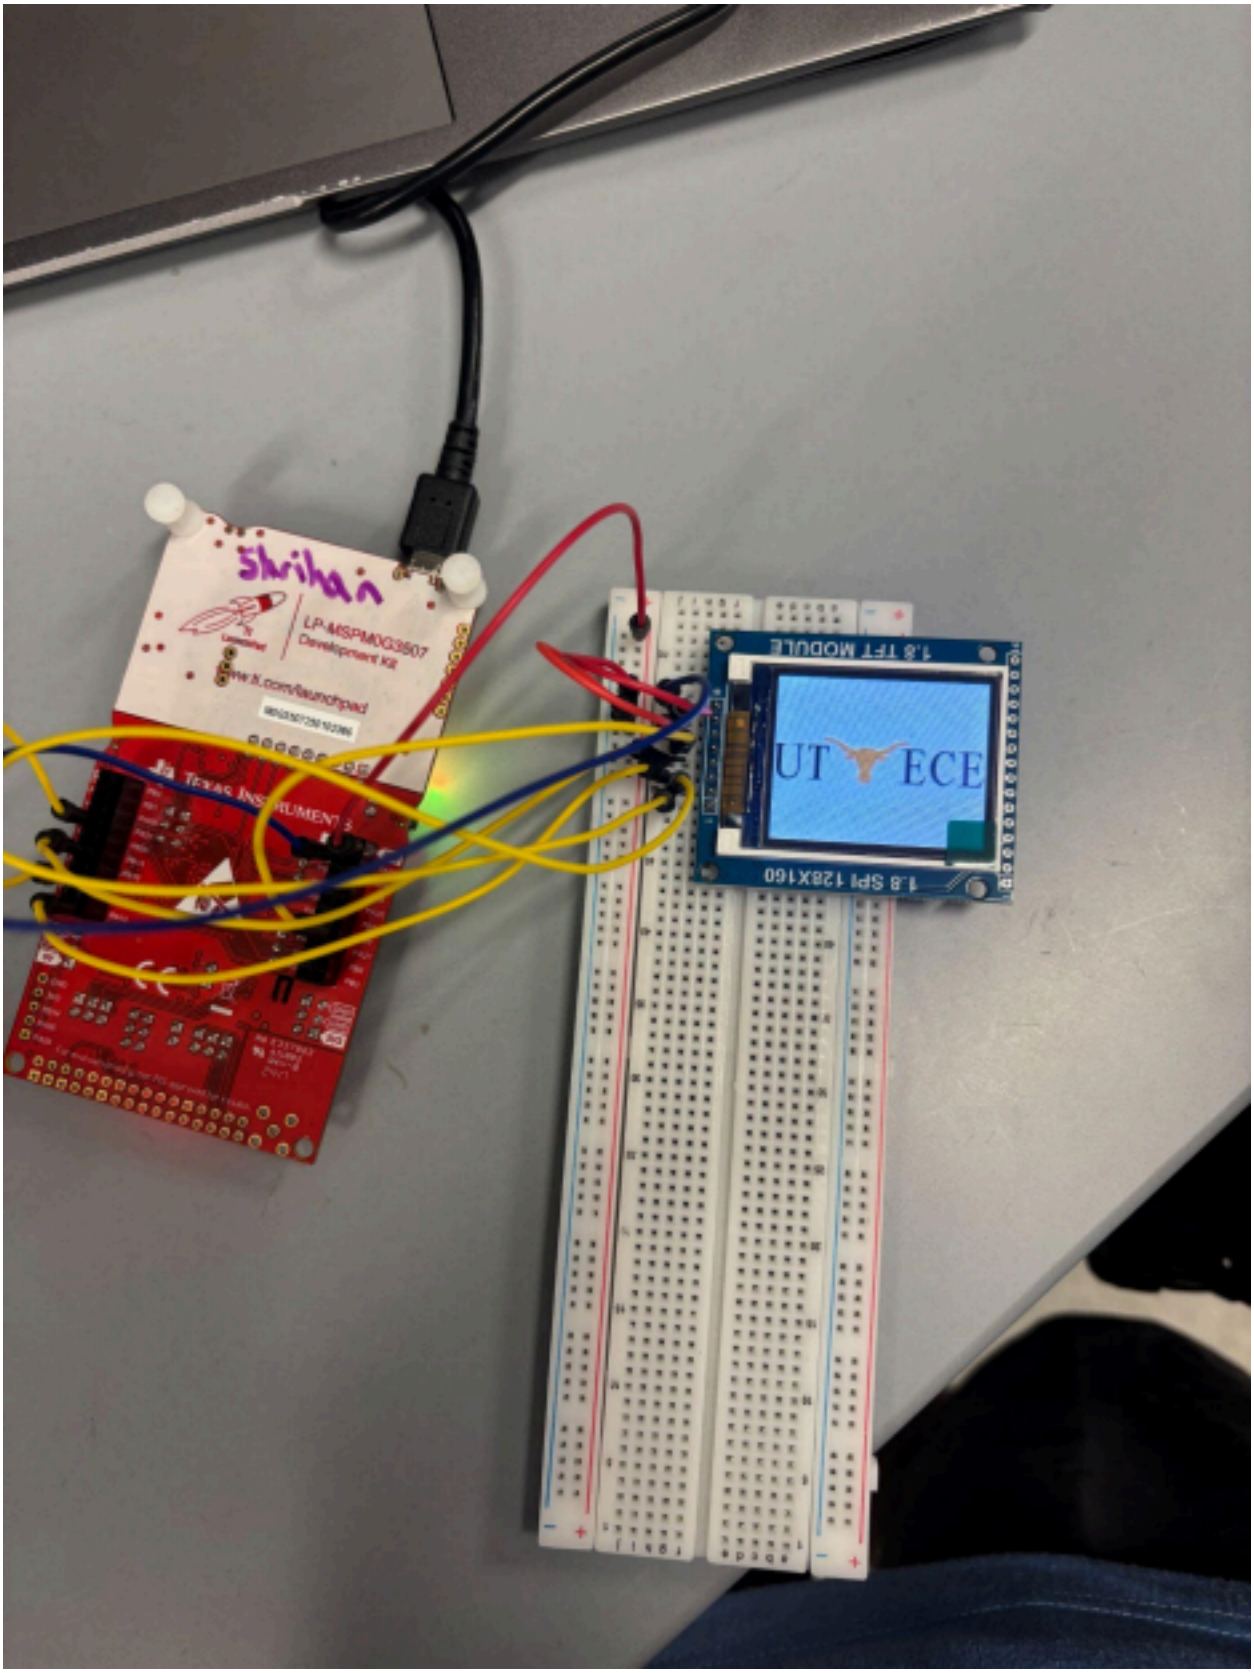
Shrihan
LP-MSPM0G3507
Development Kit
www.ti.com/launchpad
TEXAS INSTRUMENTS
1.8 TFT MODULE
UT ECE
1.8 SPI 128X160

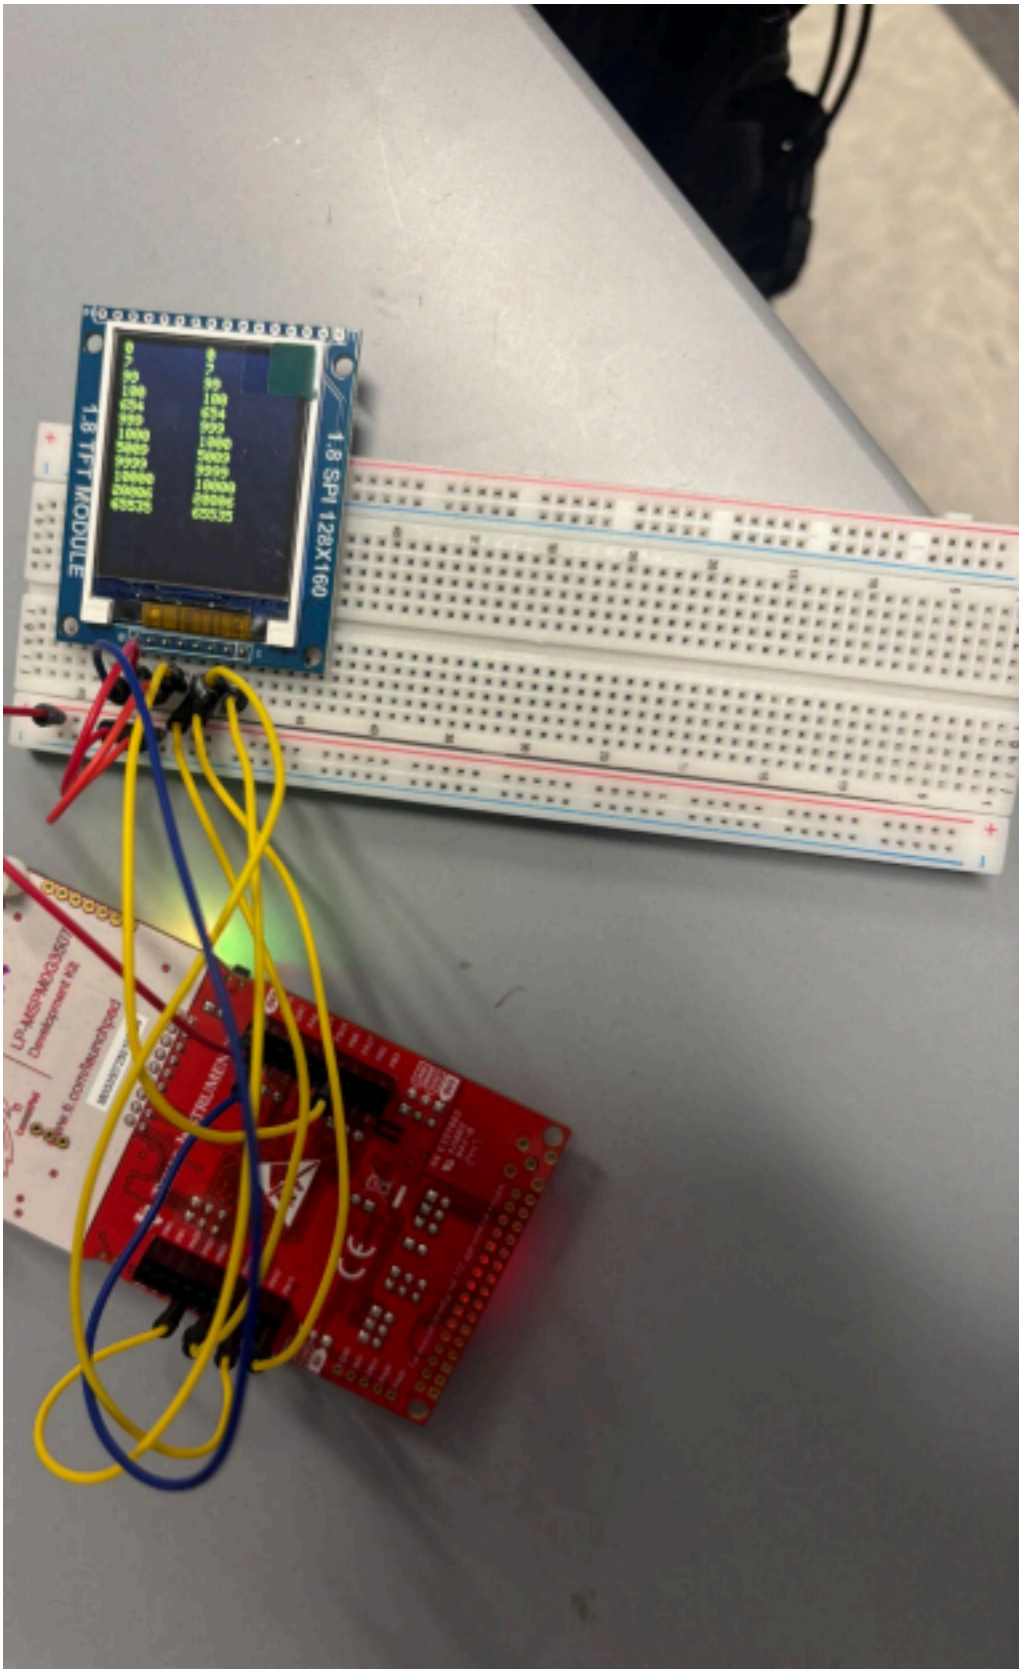
1.8 TFT MODULE
1.8 SPI 128X160

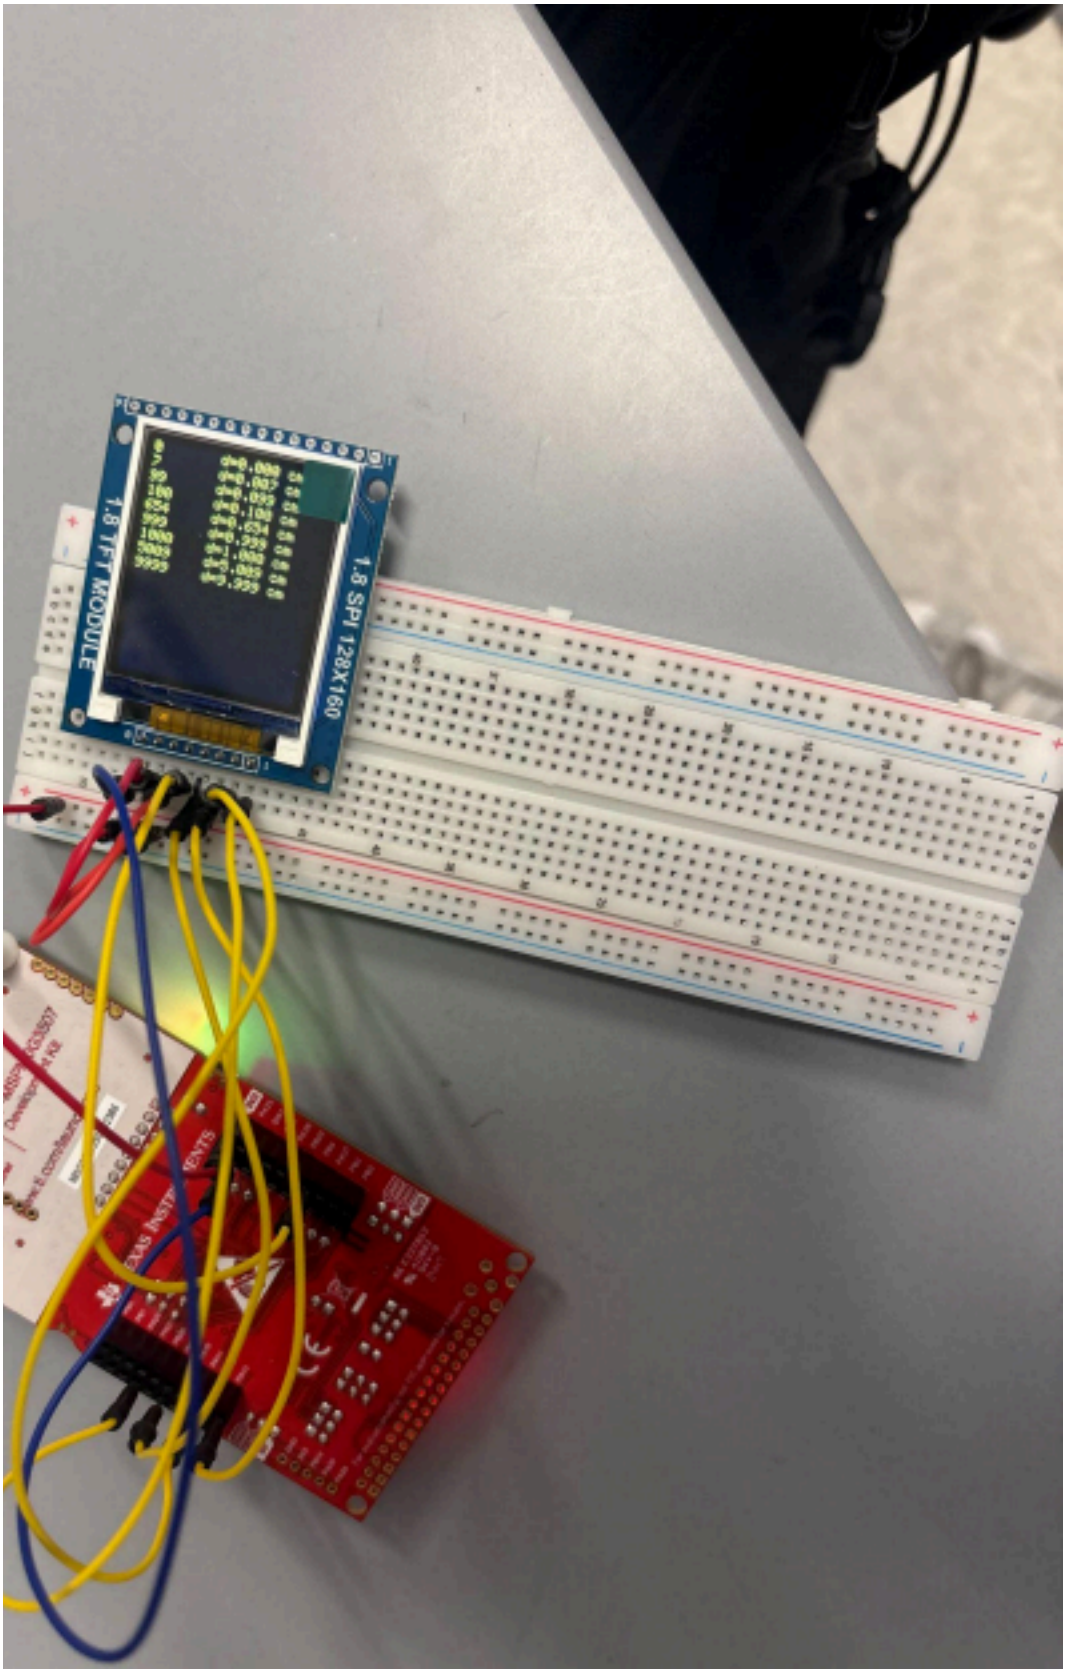
1.8 TFT MODULE
1.8 SPI 128X160

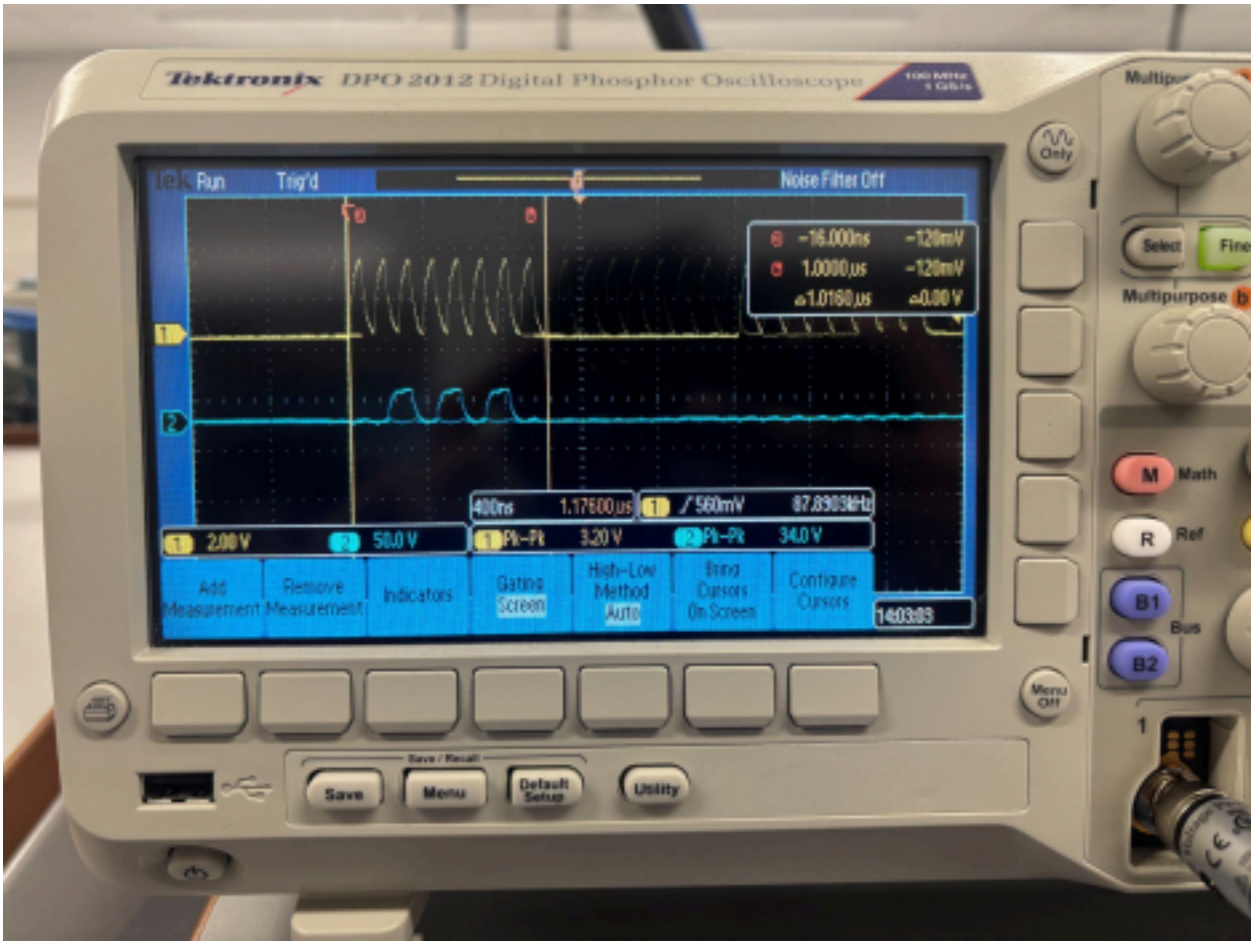
Tektronix DPO 2012 Digital Phosphor Oscilloscope
Tek Run Trig'd
Noise Filter Off
-16.000ns -120mV
1.0000µs -120mV
Δ1.0160µs Δ0.00 V
400ns 1.17600µs
560mV 87.8903MHz
2.00 V 50.0 V
Pk-Pk 3.20 V
Pk-Pk 34.0 V
Add Measurement
Remove Measurement
Indicators
Gating Screen
High-Low Method Auto
Bring Cursors On Screen
Configure Cursors
14:03:03
Save
Menu
Default Setup
Utility
Select
Fine
Multipurpose
M Math
R Ref
B1
B2
Bus

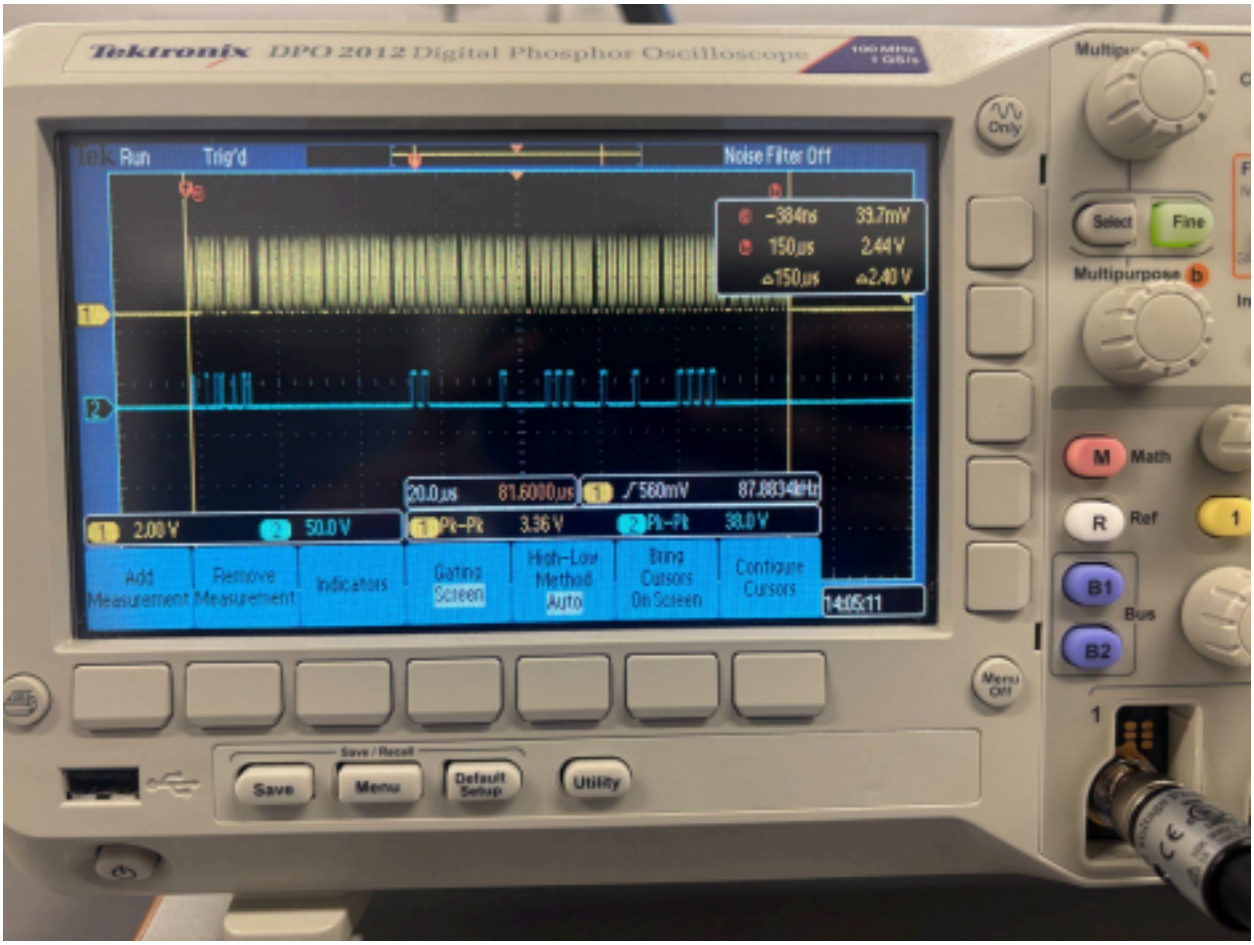
Tektronix DPO 2012 Digital Phosphor Oscilloscope
Run
Trig'd
Noise Filter Off
-384ns 33.7mV
150µs 2.44 V
Δ150µs Δ2.40 V
20.0µs 81.6000µs
560mV 87.8834kHz
2.00 V
50.0 V
Pk-Pk 3.36 V
Pk-Pk 38.0 V
Add Measurement
Remove Measurement
Indicators
Gating Screen
High-Low Method Auto
Bring Cursors On Screen
Configure Cursors
14:05:11
Only
Select
Fine
Multipurpose b
M Math
R Ref
B1
B2
Bus
Menu Off
Save / Recall
Save
Menu
Default Setup
Utility