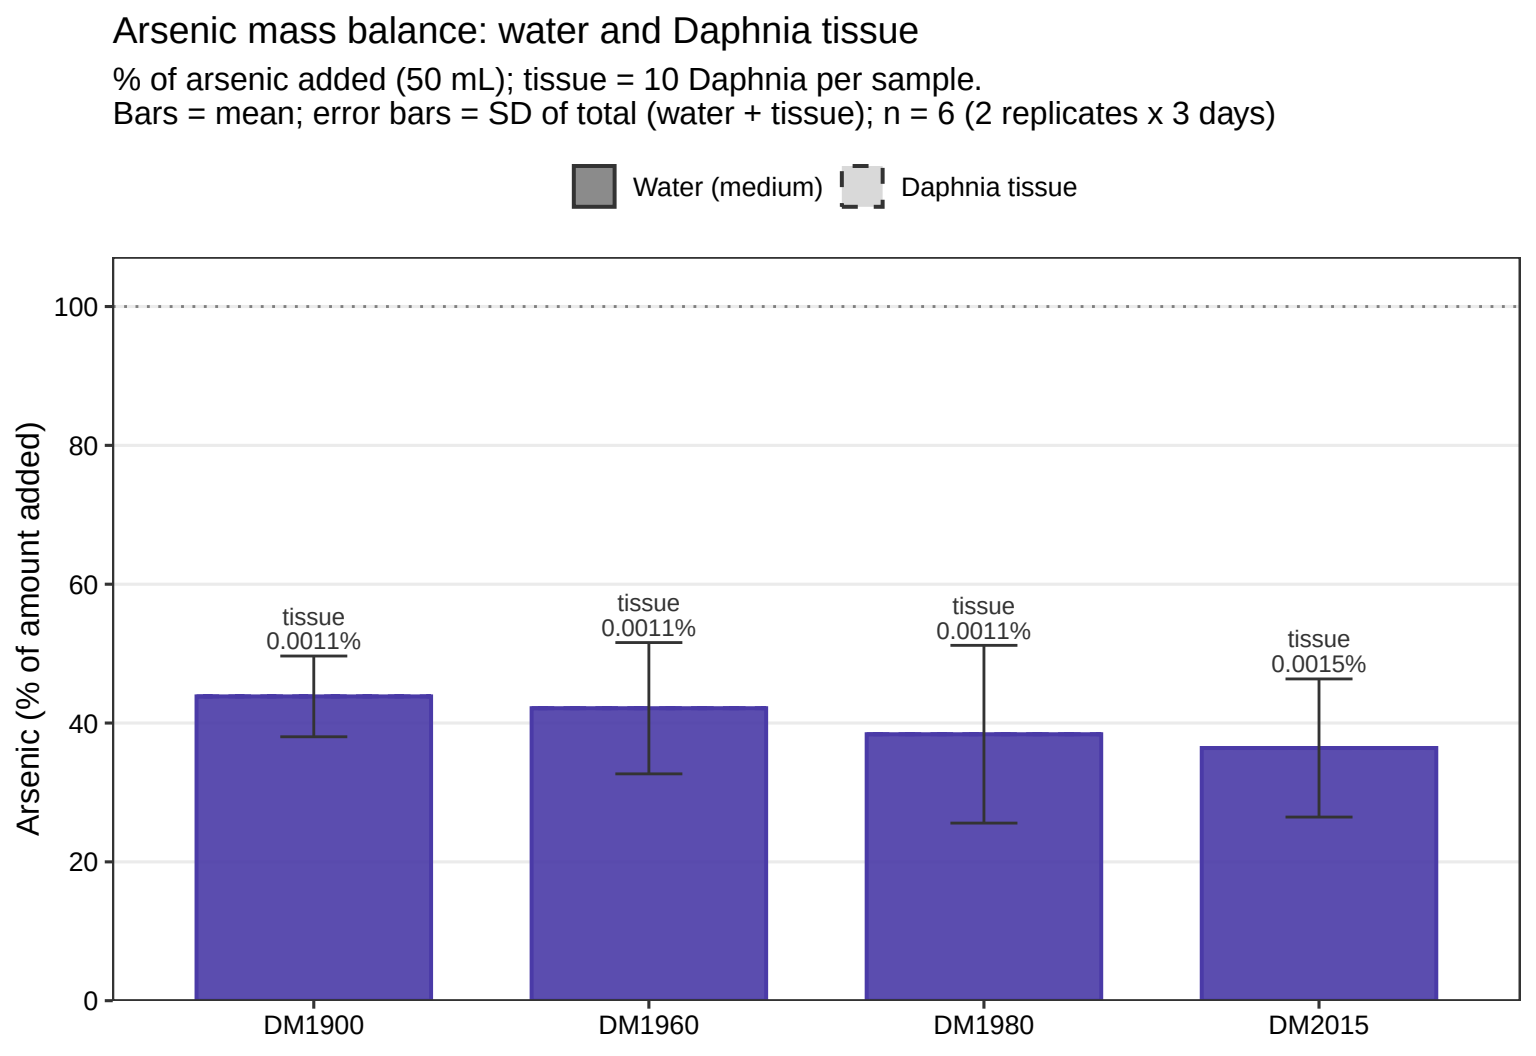
Arsenic mass balance: water and Daphnia tissue
% of arsenic added (50 mL); tissue = 10 Daphnia per sample.
Bars = mean; error bars = SD of total (water + tissue); n = 6 (2 replicates x 3 days)
Water (medium)
Daphnia tissue
Arsenic (% of amount added)
100
80
60
40
20
0
tissue
0.0011%
tissue
0.0011%
tissue
0.0011%
tissue
0.0015%
DM1900
DM1960
DM1980
DM2015