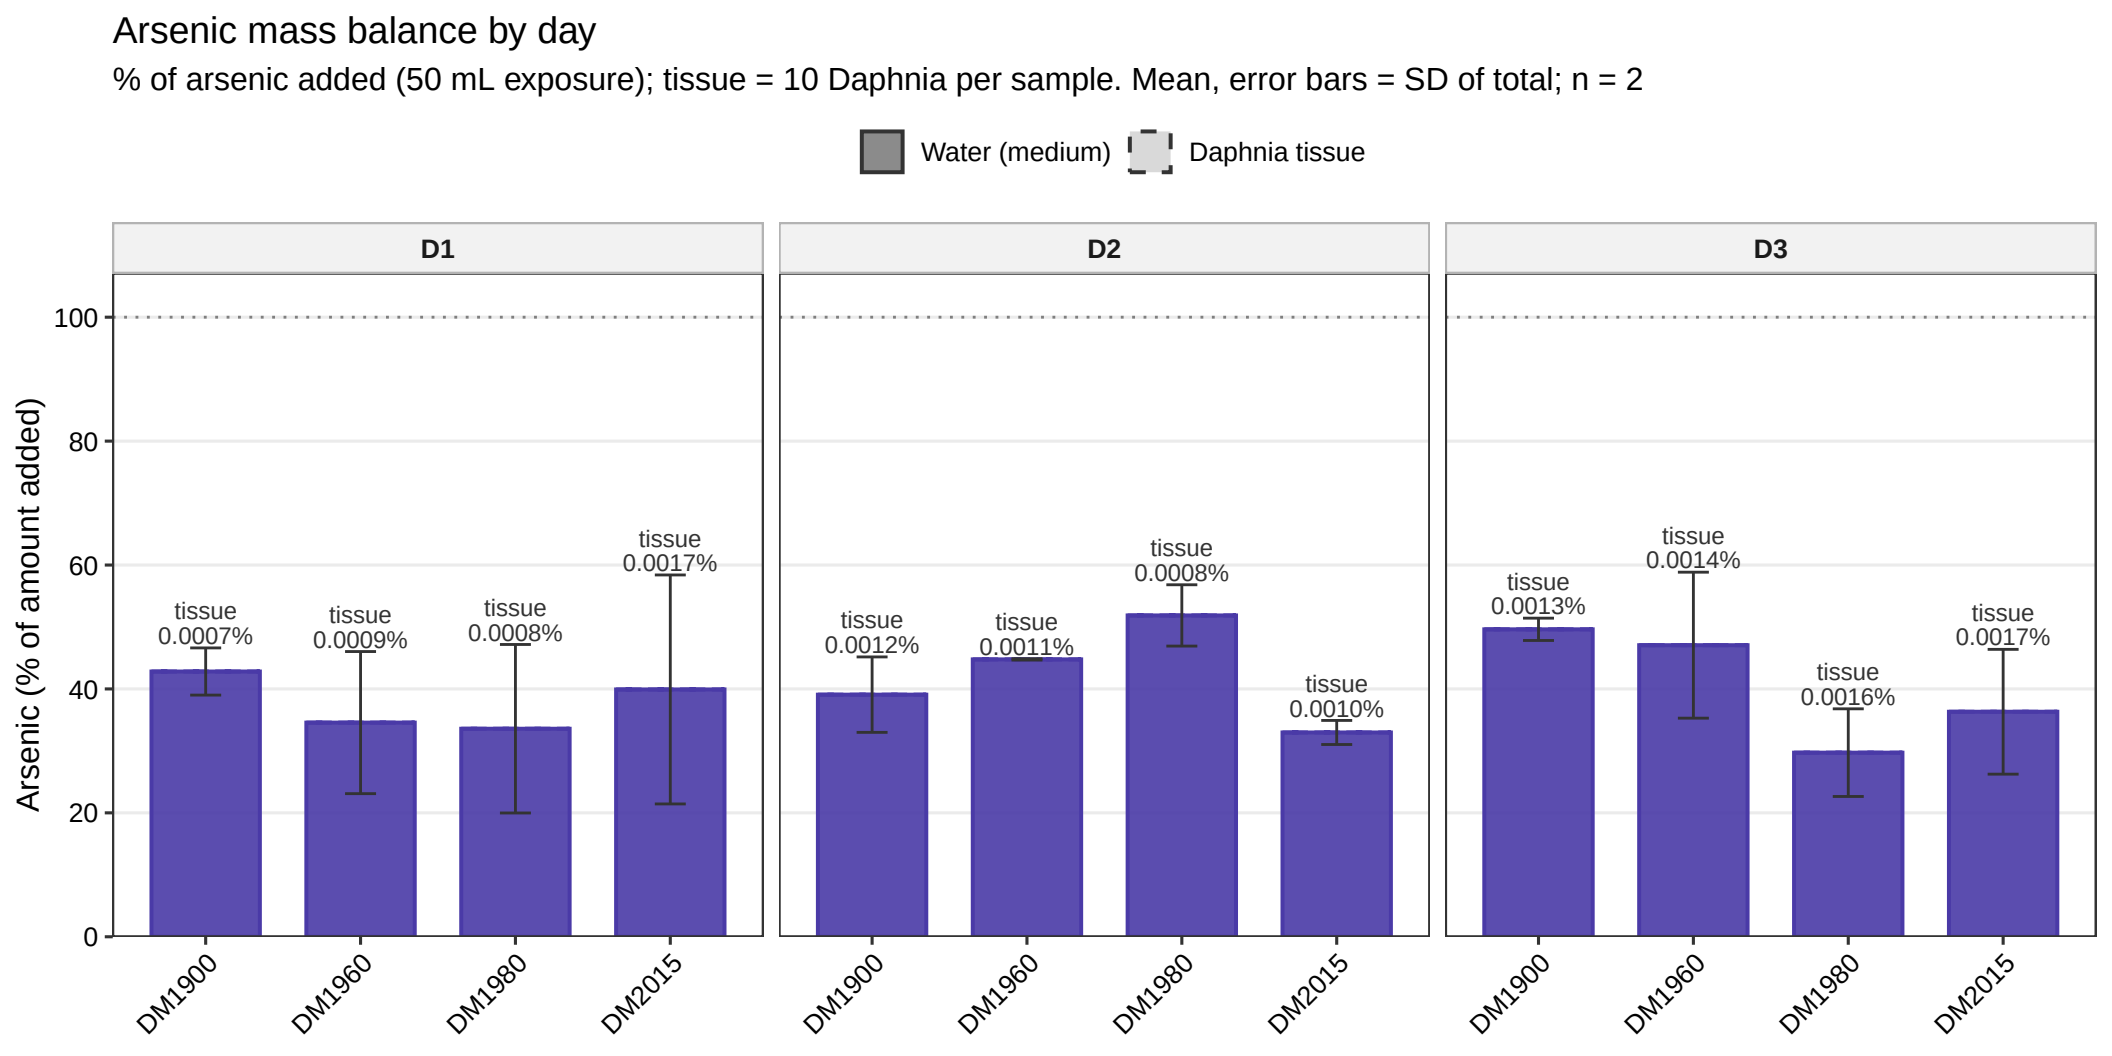
Arsenic mass balance by day
% of arsenic added (50 mL exposure); tissue = 10 Daphnia per sample. Mean, error bars = SD of total; n = 2
Water (medium)
Daphnia tissue
D1
D2
D3
Arsenic (% of amount added)
0
20
40
60
80
100
tissue 0.0007%
tissue 0.0009%
tissue 0.0008%
tissue 0.0017%
tissue 0.0012%
tissue 0.0011%
tissue 0.0008%
tissue 0.0010%
tissue 0.0013%
tissue 0.0014%
tissue 0.0016%
tissue 0.0017%
DM1900
DM1960
DM1980
DM2015