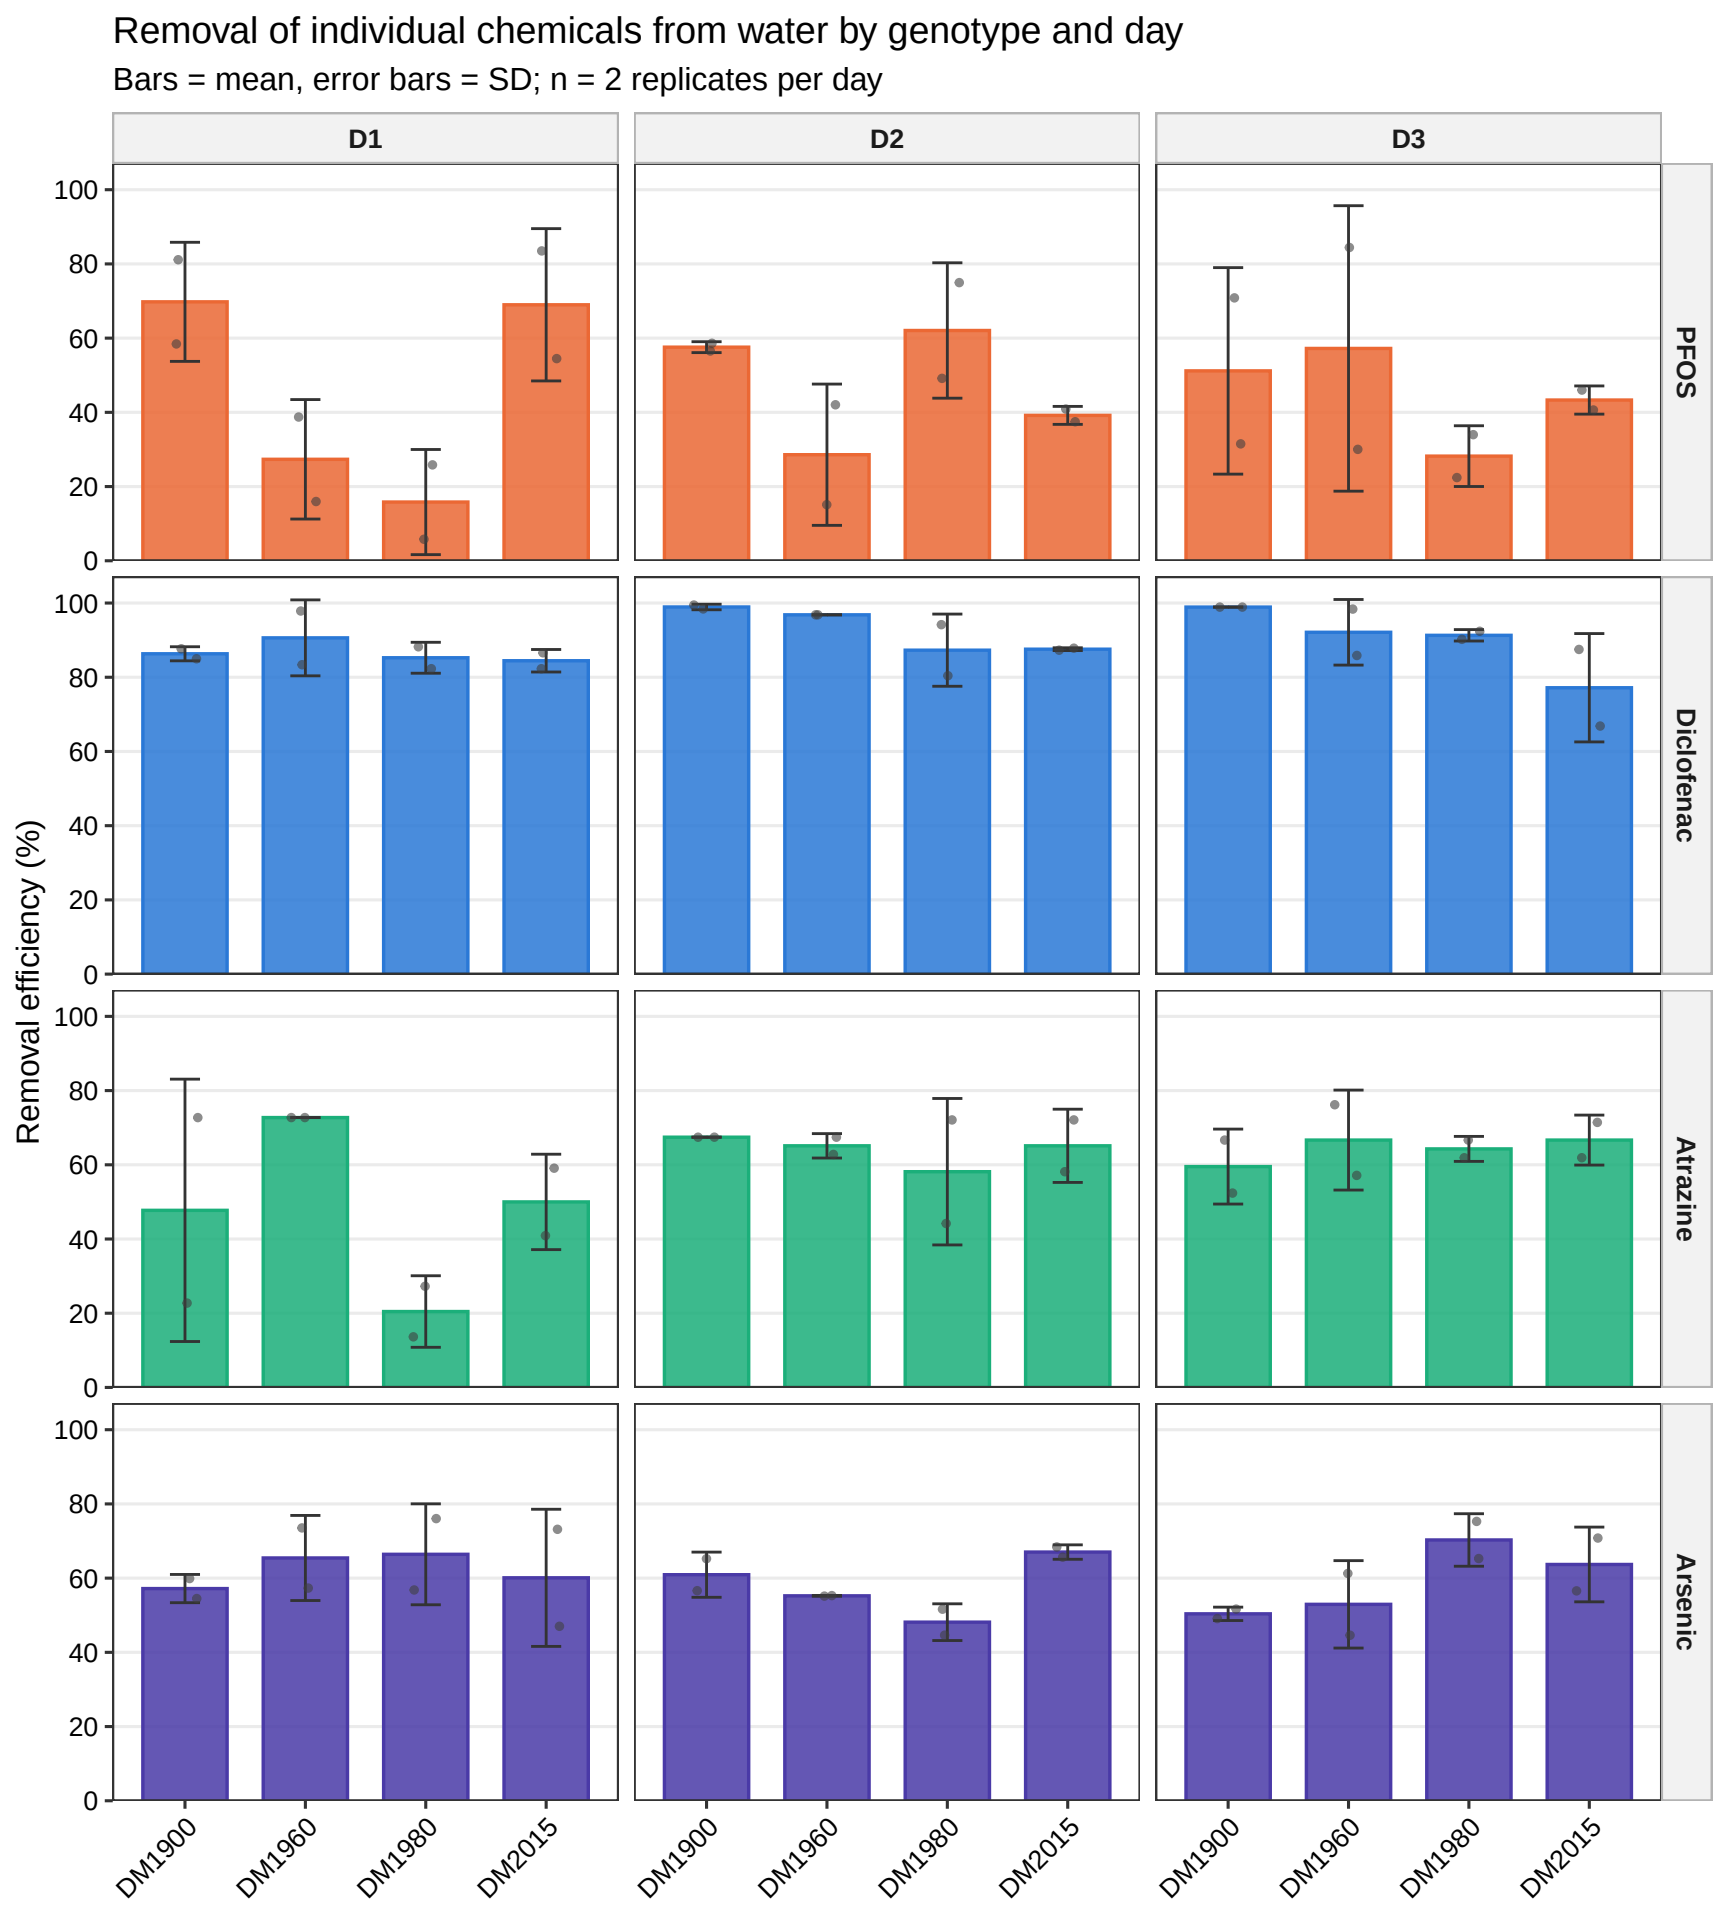
Removal of individual chemicals from water by genotype and day
Bars = mean, error bars = SD; n = 2 replicates per day
D1
D2
D3
PFOS
Diclofenac
Atrazine
Arsenic
Removal efficiency (%)
0
20
40
60
80
100
DM1900
DM1960
DM1980
DM2015