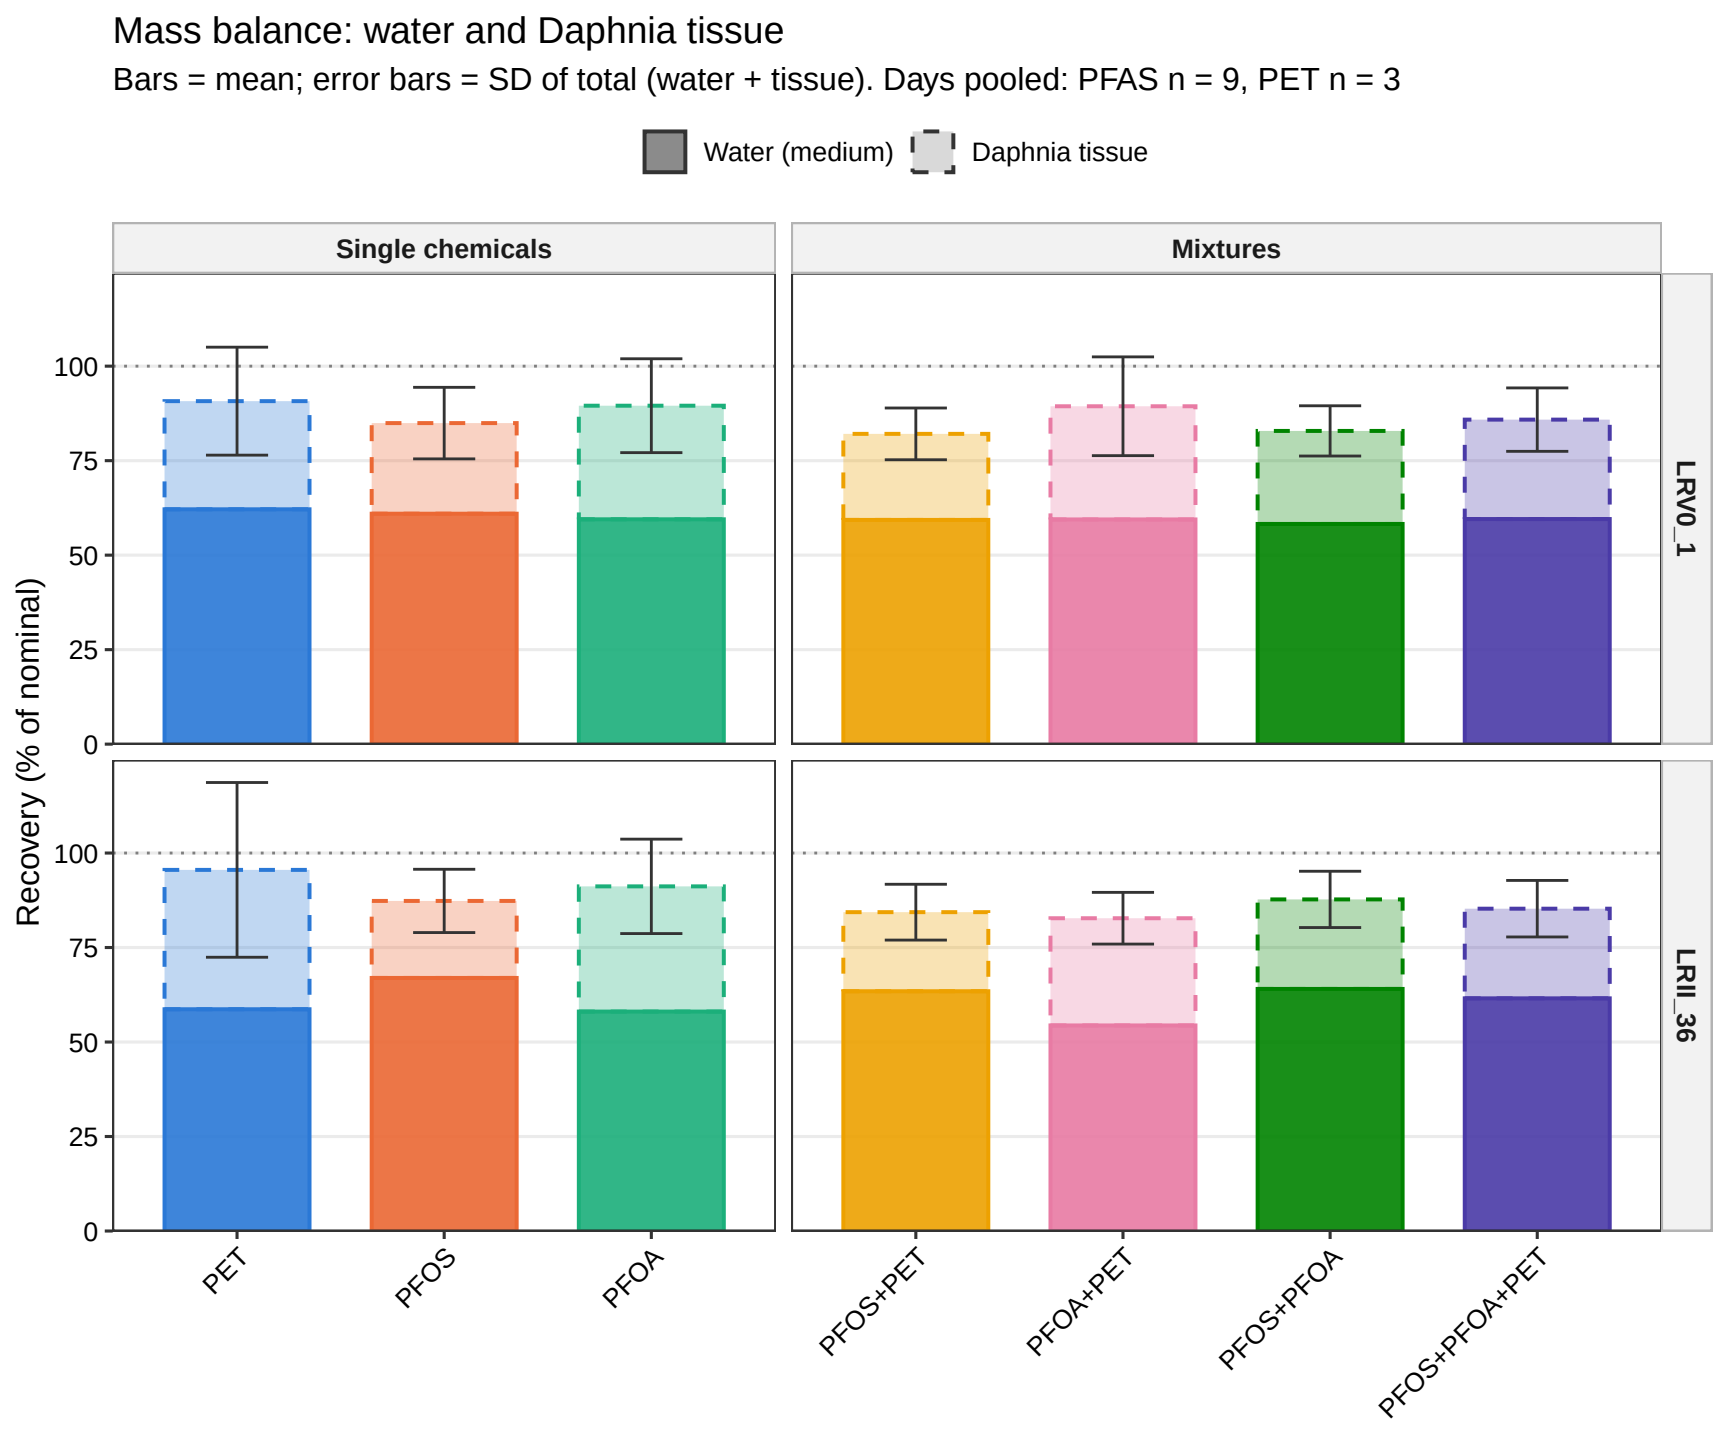
Mass balance: water and Daphnia tissue
Bars = mean; error bars = SD of total (water + tissue). Days pooled: PFAS n = 9, PET n = 3
Water (medium)
Daphnia tissue
Single chemicals
Mixtures
LRV0_1
LRII_36
Recovery (% of nominal)
0
25
50
75
100
PET
PFOS
PFOA
PFOS+PET
PFOA+PET
PFOS+PFOA
PFOS+PFOA+PET