


2015 Standard of Coverage

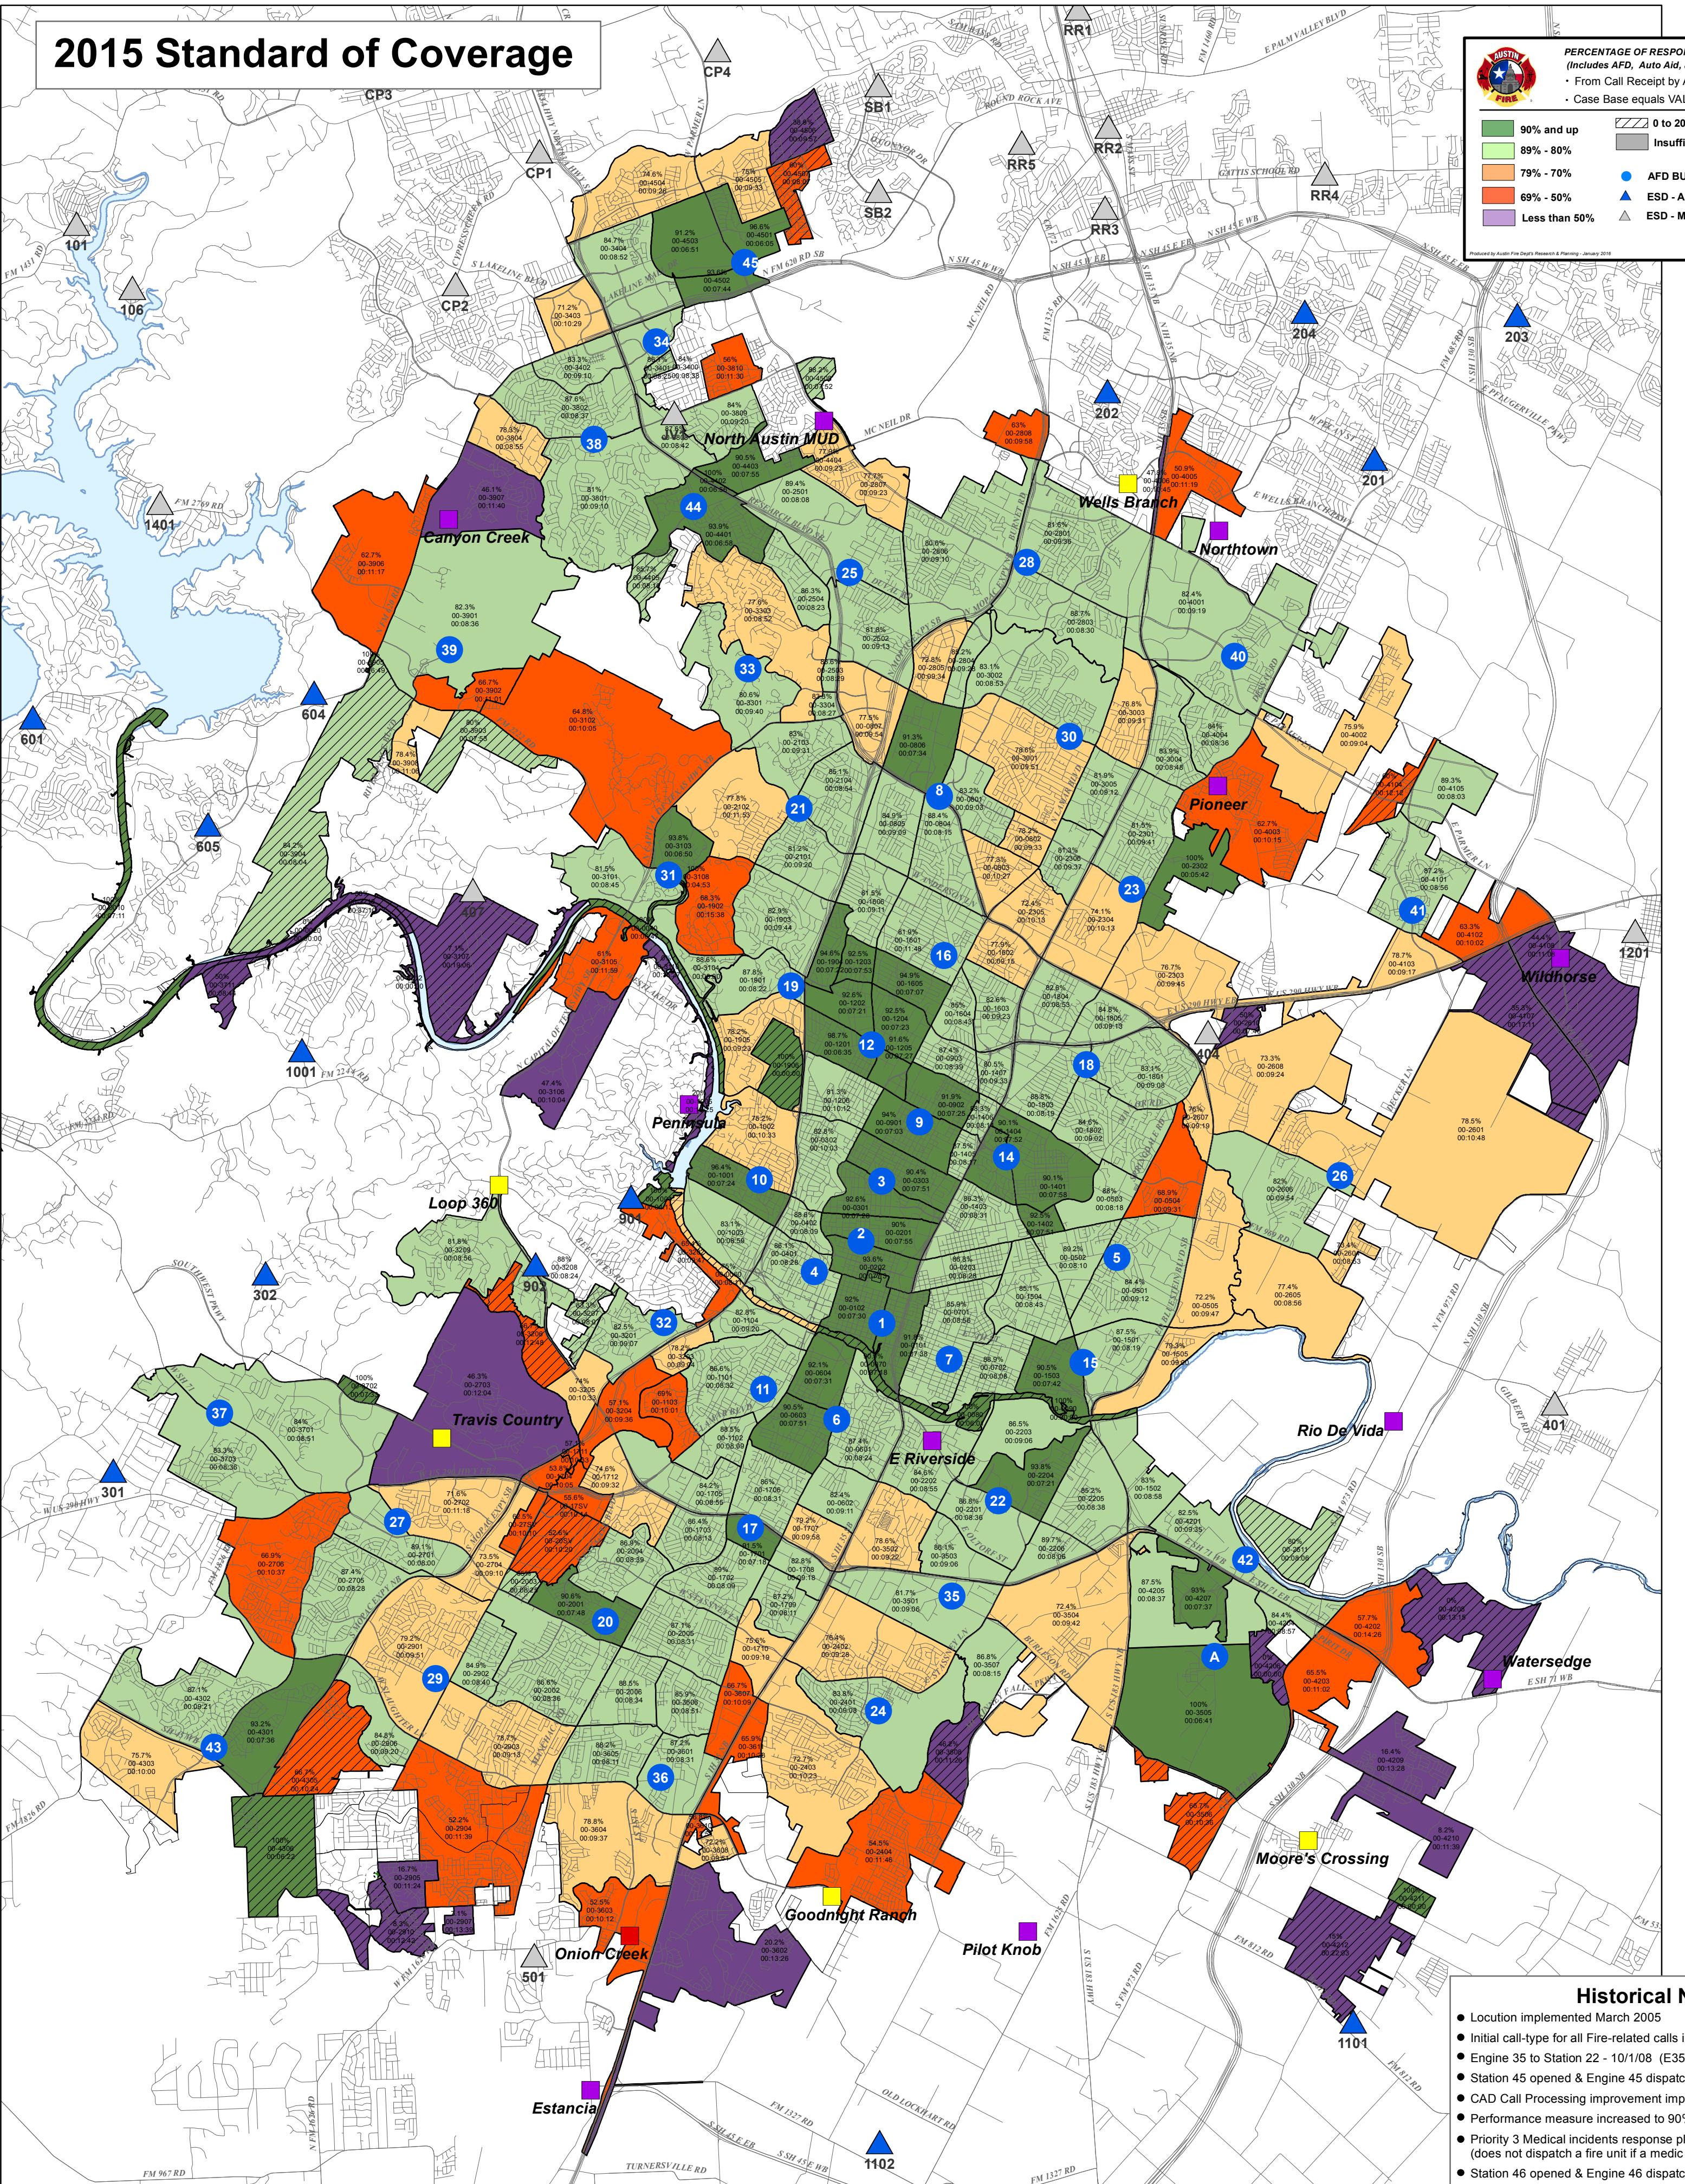

PERCENTAGE OF RESPONSES IN 5 MINUTES OR LESS FOR FIRST-IN UNIT
 * From Call Receipt by AFD/EMS to Arrival OnScene
 • Case Base equals VALID Response Times Only


0 to 20 Calls	Insufficient Data	95% Percentage of responses within 5 mins
---------------	-------------------	---

Proposed Fire Stations

In Progress: 2014-2019
 2020-2029

00-1902 Fire Box number
 00-1918 Response Time at 90%

2016 Standard of Coverage

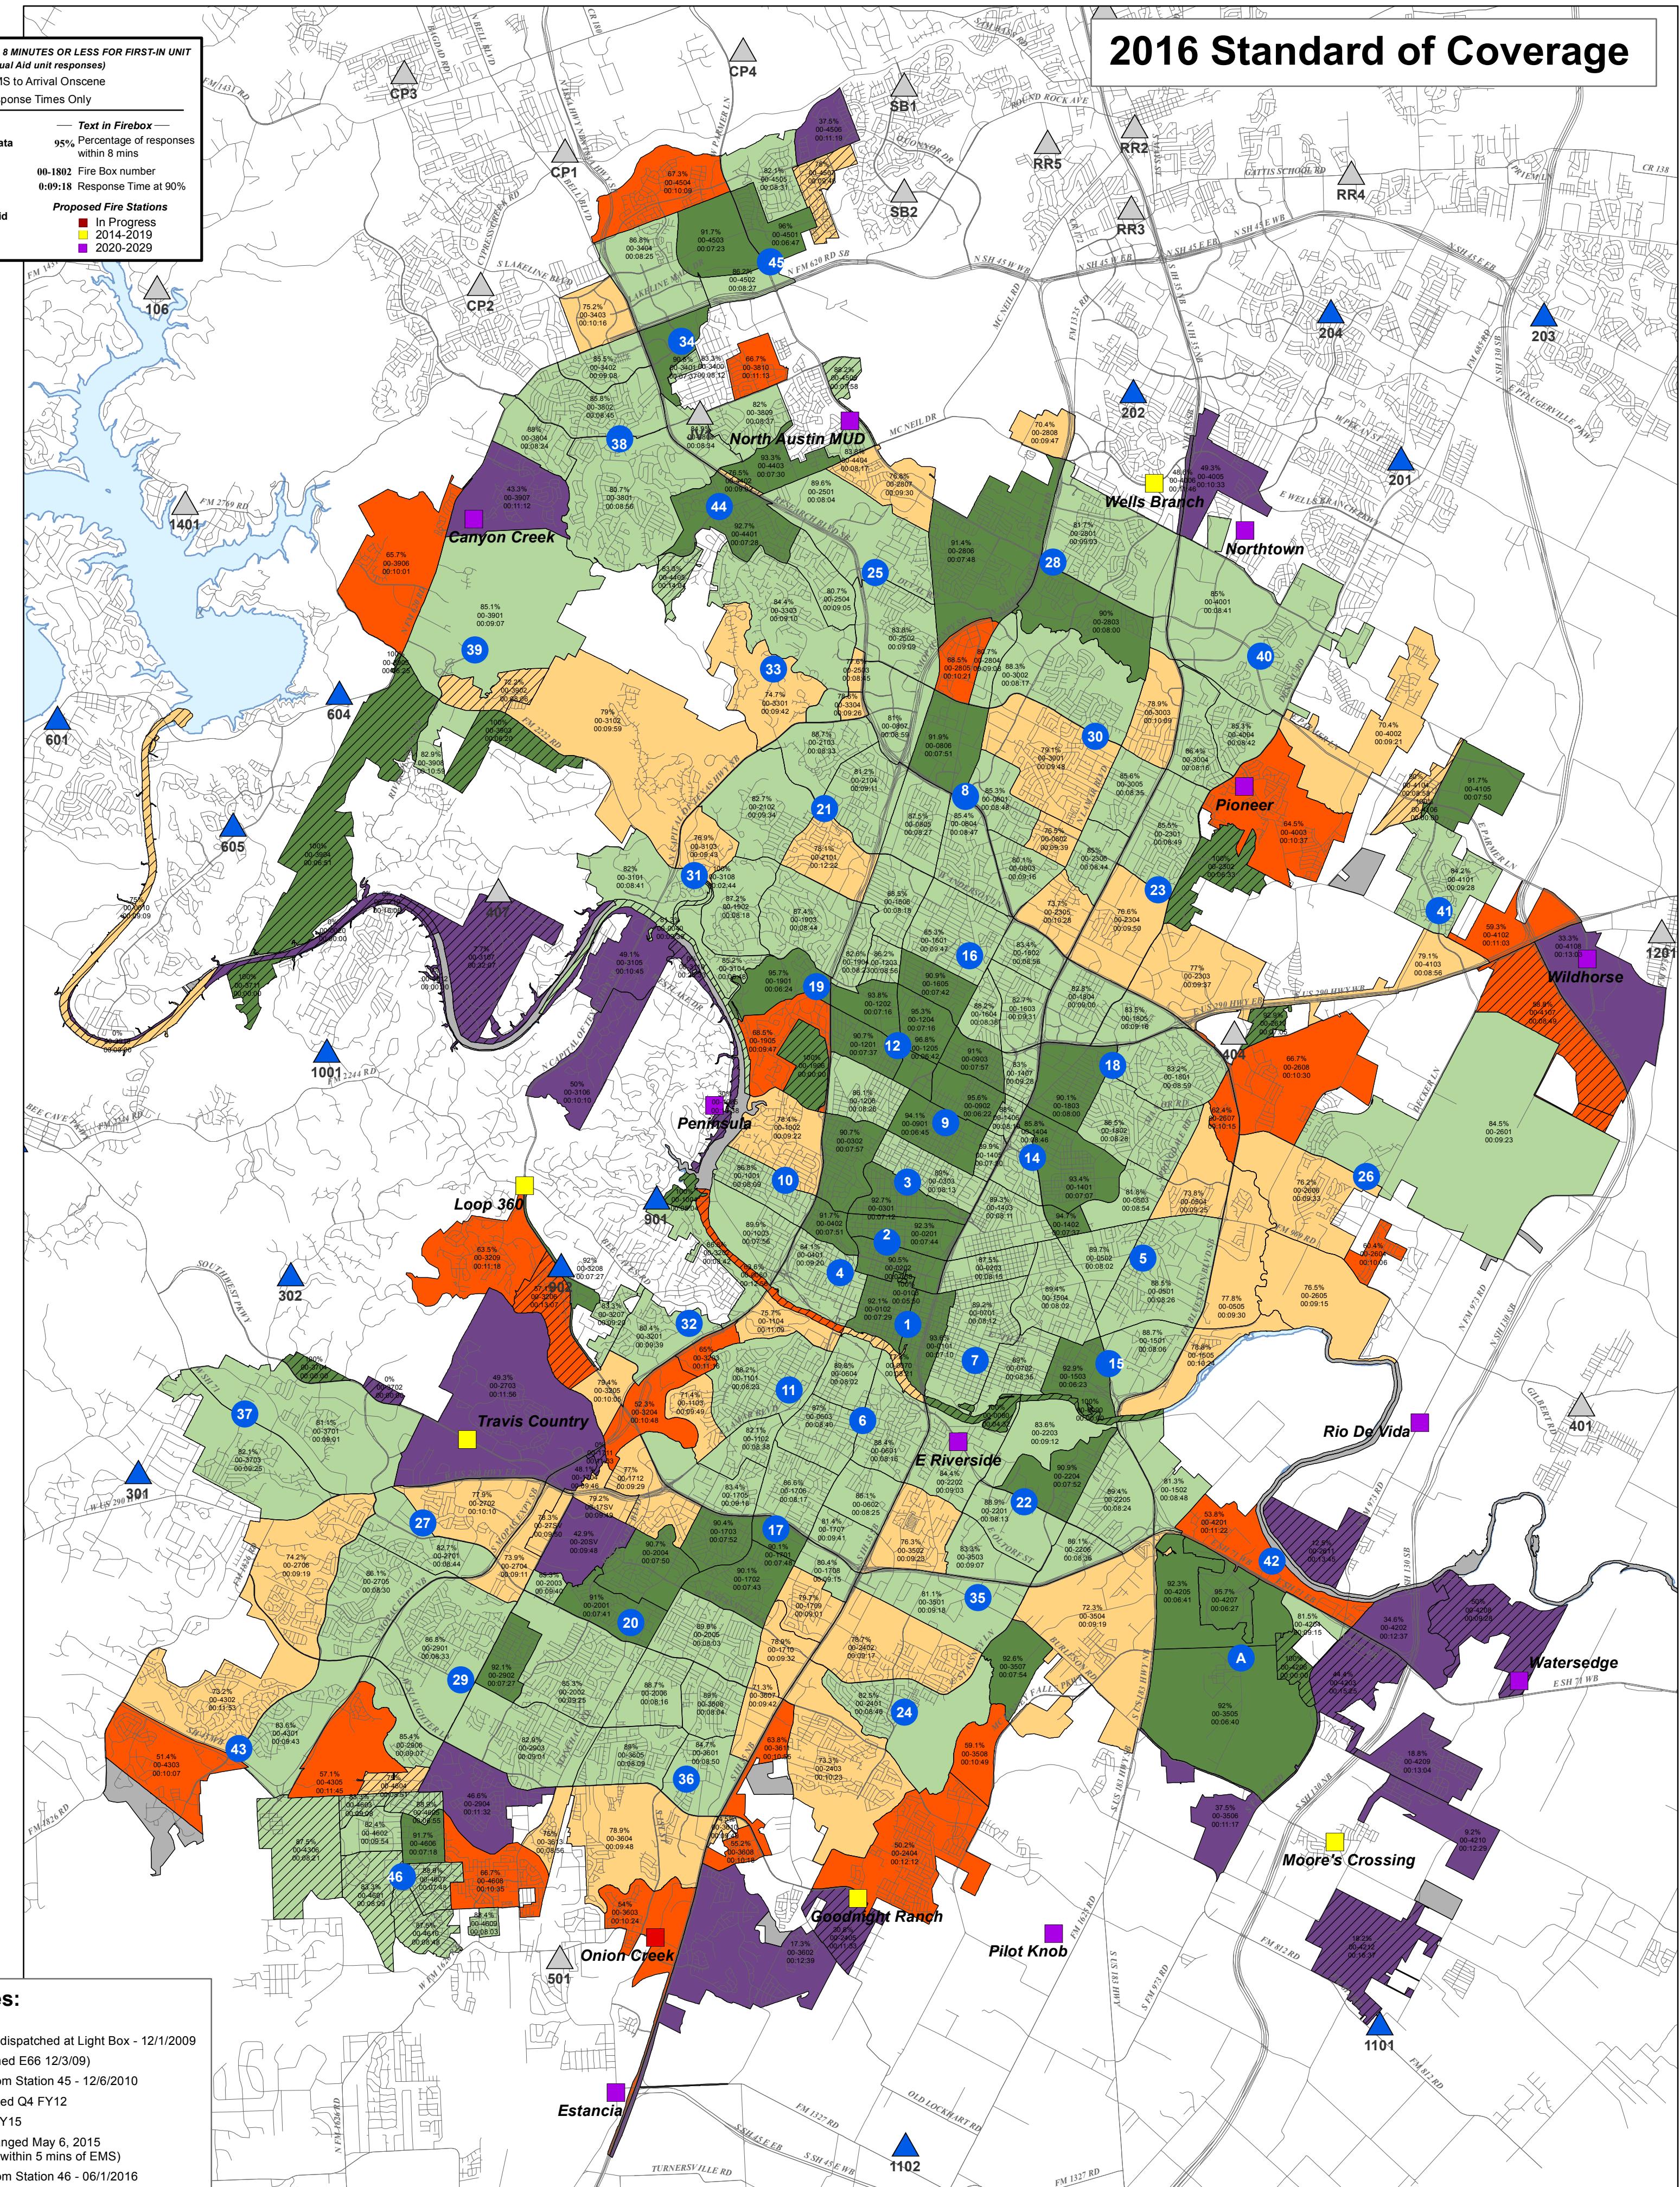

Historical Notes:

- Location implemented March 2005
- Initial call-type for all Fire-related calls initially dispatched at Light Box - 12/1/2009
- Engine 35 to Station 22 - 10/1/04 (E35 renamed E66 12/3/09)
- Station 45 opened & Engine 45 dispatched from Station 45 - 12/6/2010
- CAD Call Processing Improvement implemented Q4 FY12
- Performance measure increased to 90% for FY15
- Priority 3 Medical incidents response plan changed May 6, 2015
 (does not dispatch a fire unit if a medic unit is within 5 mins of EMS)
- Station 46 opened & Engine 46 dispatched from Station 46 - 06/1/2016