


REVISION HISTORY			
REV	DESCRIPTION	DATE	APPROVED

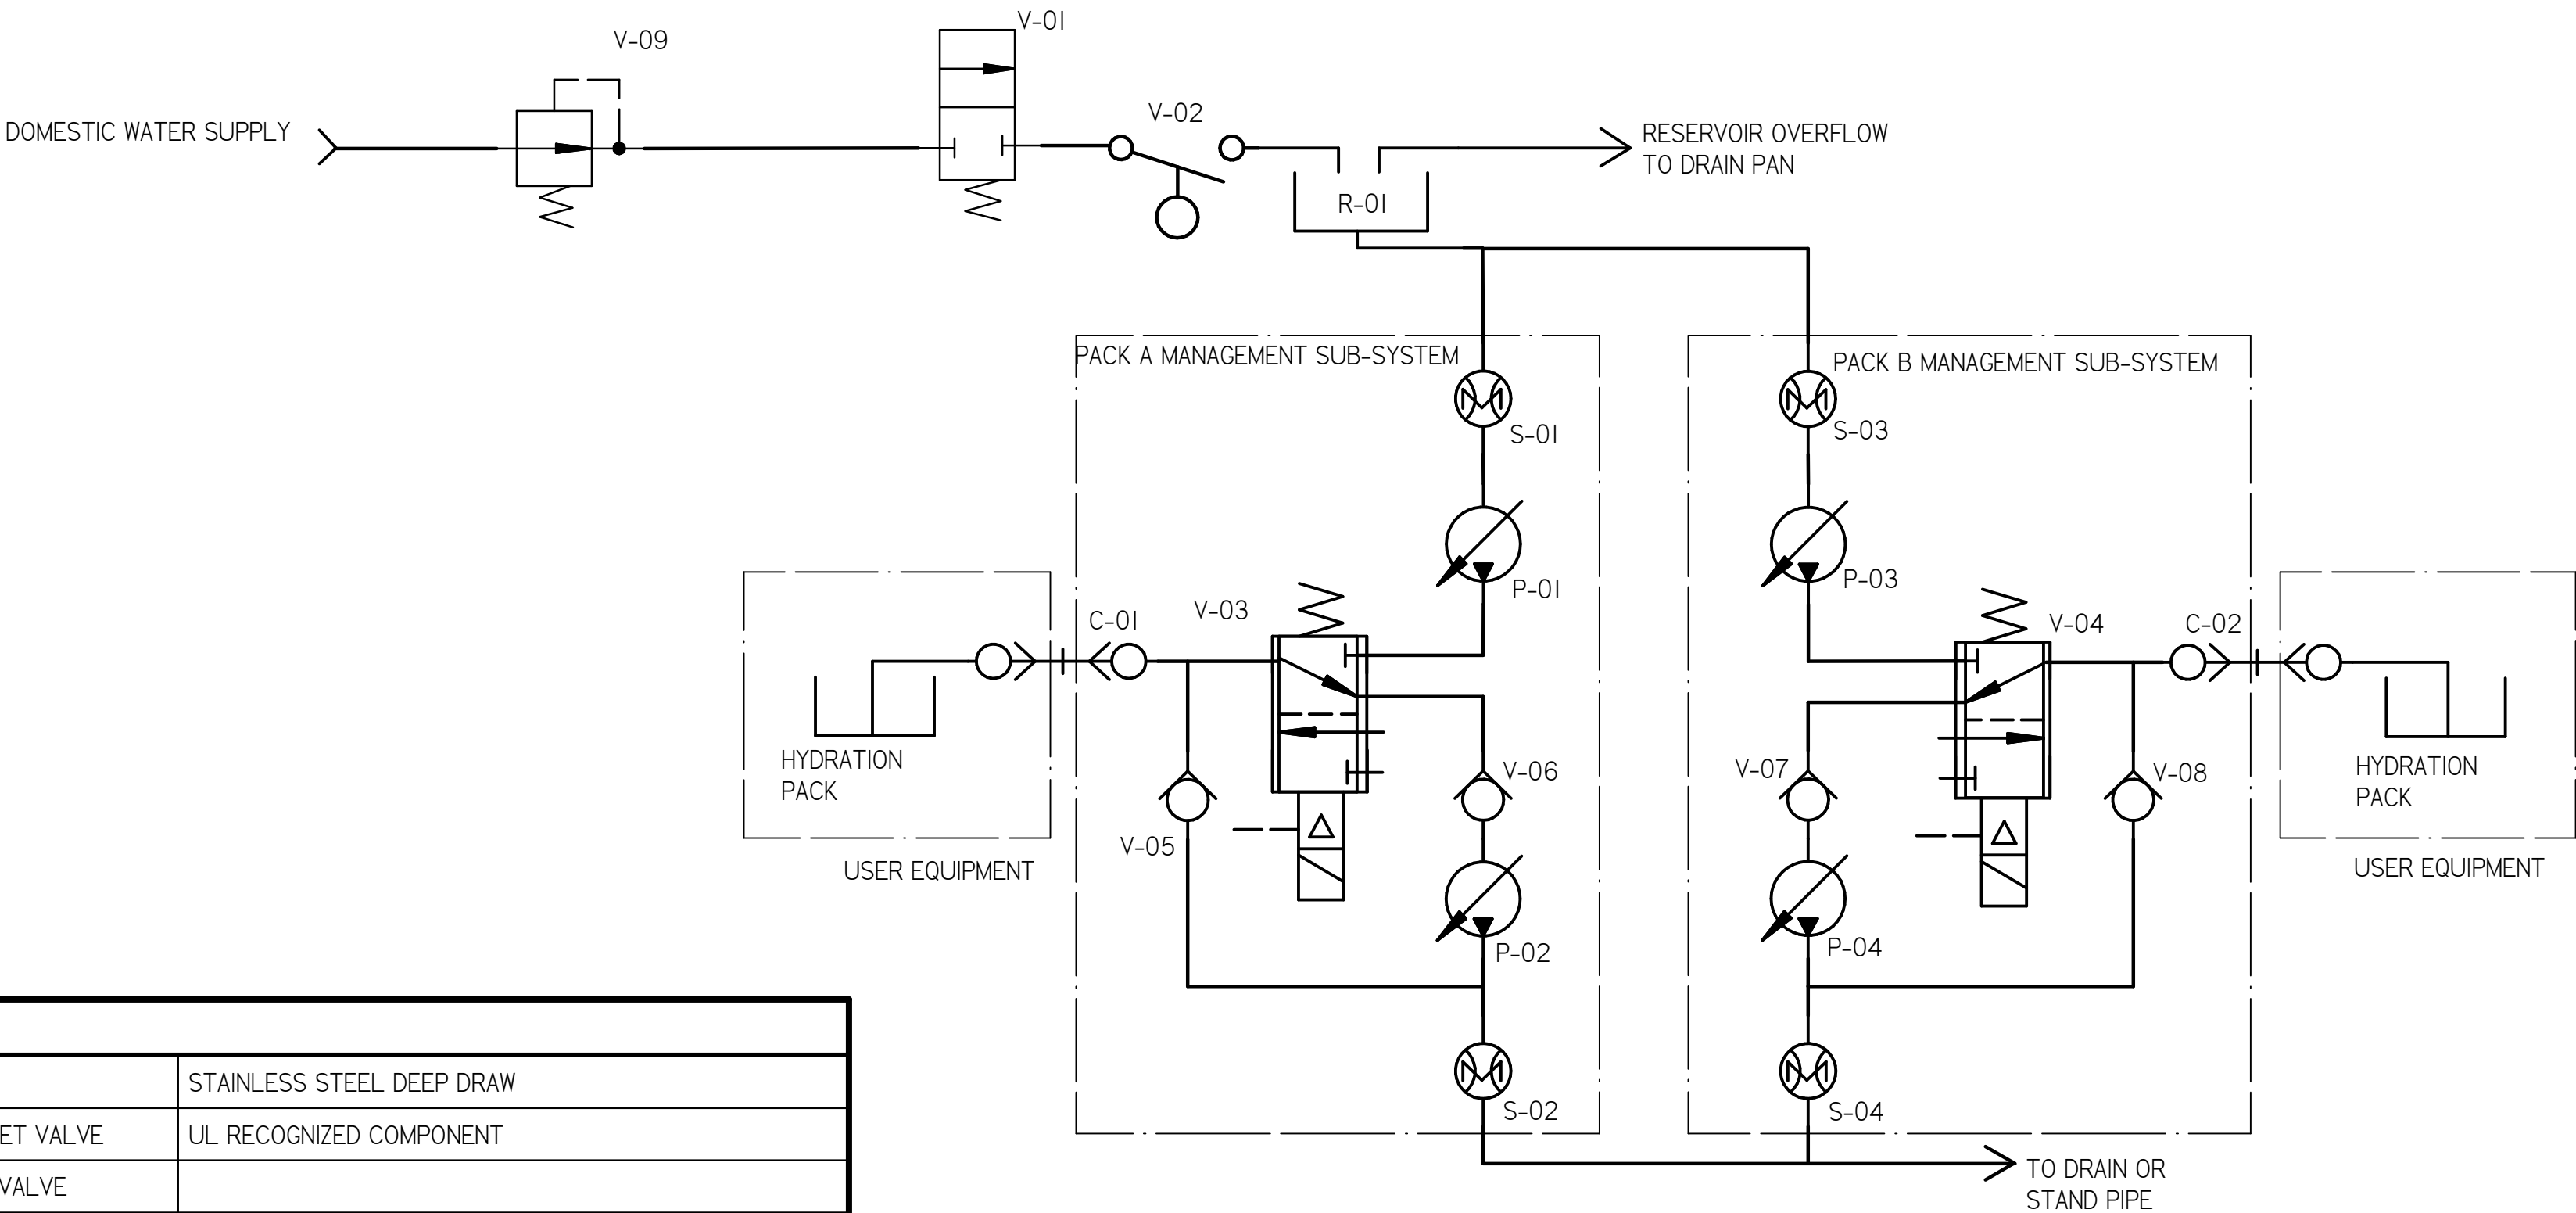

R-01	RESERVOIR	STAINLESS STEEL DEEP DRAW
V-01	WATER SUPPLY INLET VALVE	UL RECOGNIZED COMPONENT
V-02	RESERVOIR FLOAT VALVE	
V-03	3-WAY VALVE	UL RECOGNIZED / NSF COMPLIANT
V-04	3-WAY VALVE	UL RECOGNIZED / NSF COMPLIANT
V-05	BYPASS CHECK VALVE	LOW CRACK PRESSURE NEEDED
V-06	EVACUATION CHECK VALVE	
V-07	EVACUATION CHECK VALVE	
V-08	BYPASS CHECK VALVE	LOW CRACK PRESSURE NEEDED
V-09	EXTERNAL PRESSURE REGULATOR	20 PSI OUTLET PRESSURE
P-01	FILL PUMP	DIAPHRAGM - 1.5L/MIN - UL/NSF COMPLIANT
P-02	EVACUATION PUMP	DIAPHRAGM - 1.5L/MIN - UL/NSF COMPLIANT
P-03	FILL PUMP	DIAPHRAGM - 1.5L/MIN - UL/NSF COMPLIANT
P-04	EVACUATION PUMP	DIAPHRAGM - 1.5L/MIN - UL/NSF COMPLIANT
S-01	FILL FLOW METER	LOW-COST HALL EFFECT TURBINE STYLE SUFFICIENT
S-02	EVACUATION FLOW METER	LOW-COST HALL EFFECT TURBINE STYLE SUFFICIENT
S-03	FILL FLOW METER	LOW-COST HALL EFFECT TURBINE STYLE SUFFICIENT
S-04	EVACUATION FLOW METER	LOW-COST HALL EFFECT TURBINE STYLE SUFFICIENT
C-01	VALVED M/F COUPLING	
C-02	VALVED M/F COUPLING	

	NAME	DATE	Solid Edge	
DRAWN	WTM	04/23/26		
CHECKED			TITLE	
ENG APPR			Glacier Dock Fluid Schematic	
MGR APPR			SIZE	DWG NO
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN MILLIMETERS ANGLES ±XX° 2 PL ±XXX 3 PL ±X.XXX			C	GD-
			FILE NAME:	GD - Fluid_Schematic_v1.dft
			SCALE:	WEIGHT:
				SHEET 1 OF 2