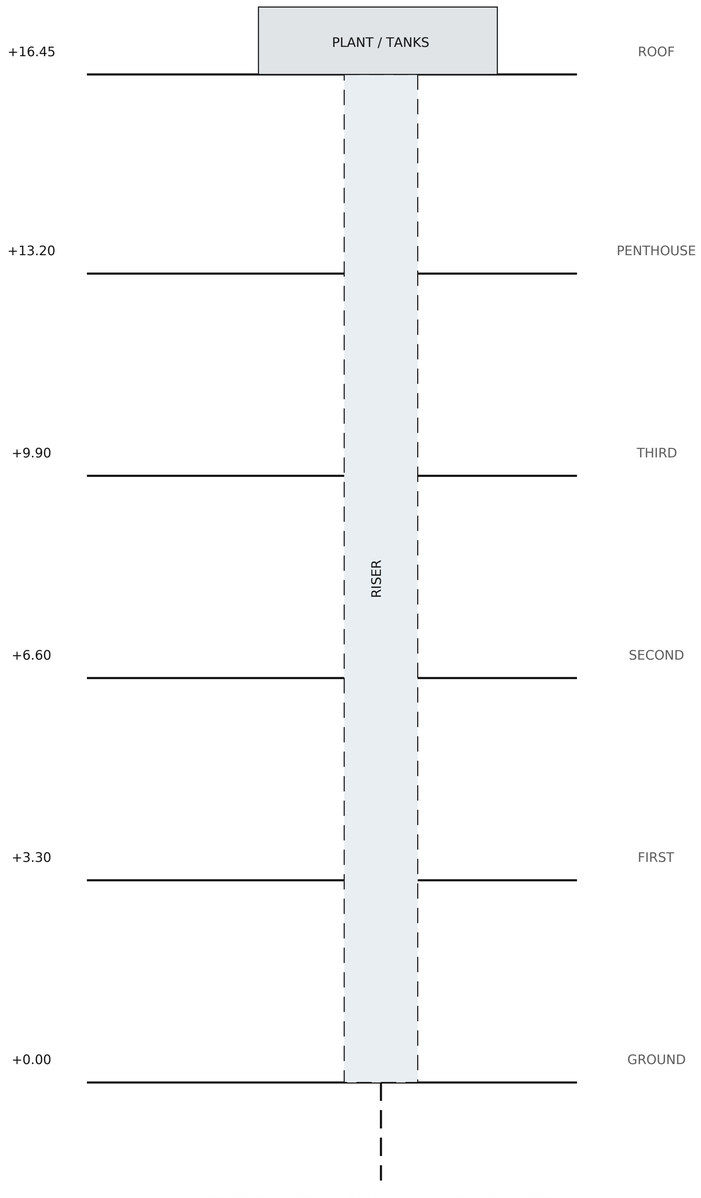


# HVAC SCHEMATIC & PLANT ARRANGEMENT

LEVEL the whole building · schematic · METRES

## THE RISER

| | |
|---|---|
| LEVELS SERVED | 5 |
| RISER RESERVED | 2.50 × 3.50 m |
| WET ON | 5 levels |
| PLANT | roof, north-west |
| HEIGHT SERVED | 16.45 m |
| SIZES | by the engineer |
| CAPACITIES | by the engineer |
| BELOW GROUND | by the engineer |

## GENERAL NOTES

1. Plant on the roof, risers down, which is all the architecture fixes.

2. A diagram, not a drawing to scale, and it fixes one thing: the riser runs the full height of the building in the east strip, where the wet rooms were measured to stack on every level.

3. No size, capacity, rating or load appears. The engineer's design fills them in; this reserves the space it has to fit through.

4. The connection below ground waits on GEO-001 and the drainage design, and on whatever the authority requires at the boundary.

**FIVE-STOREY VACATION VILLA** — SHAMANDEEL, QUESNA, MENOUFIA, EGYPT

DRAWING

**HVAC SCHEMATIC & PLANT ARRANGEMENT**

| DRAWING No | REVISION | SCALE | DATE |
|---|---|---|---|
| **ME-200** | **P24** | **schematic** | **2026-10-12** |

Coordination layout for the services engineer's design — no fitting, no size, no load. Not for construction. Do not scale; work to figured dimensions only.

REVISIONS

P21 2026-10-07 300 mm external and party walls: brick, colour unrestricted
P22 2026-10-08 A-300 to A-302 withdrawn: enlargements of a building not being built
P23 2026-10-10 services layouts: overlapping labels; ground floor re-centred
P24 2026-10-10 EL-400, ME-200 and PL-300 drawn back onto the sheet