## **TOSHIBA**

# **Industrial Inverter**

(For three-phase inductive motors)

## Instruction Manual

Ultra-Compact,
Easy-To-Use Inverter
TOSVERT™ *VF-nC1* 

Single-phase 100V class 0.1 to 0.75kW Single-phase 200V class 0.2 to 2.2kW Three-phase 200V class 0.1 to 2.2kW

#### NOTICE

- Make sure that this instruction manual is delivered to the end user of the inverter unit.
- Read this manual before installing or operating the inverter unit, and store it in a safe place for reference.

© Toshiba Schneider Inverter Corporation 2002 All Rights Reserved.

TOSVERT is a trademark of Toshiba Corporation.

## F6581090(3)

Safety precautions Contents Read first Connection Simple operation Basic VF-nC1 operations parameters Extended parameters Variety of operation Monitoring the operation status Taking measure to satisfy the CE / UL / CSA Peripheral devices Table of parameters and data Specifications Before making a service call - Trip information and Inspection and maintenance Warranty

Disposal of the inverter

# Safety precautions

The items described in these instructions and on the inverter itself are very important so that you can use the inverter safely prevent injury to yourself and other people around you as well as prevent damage to property in the area. Thoroughly familiarize yourself with the symbols and indications shown below and then continue to read the manual. Make sure that you observe all warnings given.

#### Evolunation of markings

Marking	Meaning of marking
Danger	Indicates that errors in operation may lead to death or serious injury.
Warning	Indicates that errors in operation may lead to injury (*1) to people or that these errors may cause damage to physical property. (*2)

- (\*1) Such things as injury, burns or shock that will not require hospitalization or long periods of outpatient treatment.
- (\*2) Physical property damage refers to wide-ranging damage to assets and materials.

Meanings of	Meanings of symbols		
Symbol	Meaning of Symbol		
$\Diamond$	Indicates prohibition (Don't do it). What is prohibited will be described in or near the symbol in either text or picture form.		
0	Indicates something mandatory (must be done). What is mandatory will be described in or near the symbol in either text or picture form.		
$\Diamond$	Indicates danger. What is dangerous will be described in or near the symbol in either text or picture form.		
Δ	Indicates warning.  What the warning should be applied to will be described in or near the symbol in either text or picture form.		

#### ■Limits in purpose

This inverter is used for controlling speeds of three-phase induction motors in general industrial

## Safety precautions

- ▼The inverter cannot be used in any device that would present danger to the human body or from which malfunction or error in operation would present a direct threat to human life (nuclear power control device, aviation and space flight control device, traffic device, life support or operation system, safety device, etc.). If the inverter is to be used for any special purpose, first get in touch with the people in charge of sales.
- ▼This product was manufactured under the strictest quality controls but if it is to be used in critical equipment, for example, equipment in which errors in malfunctioning signal output system would cause a major accident, safety devices must be installed on the equipment.
- ▼Do not use the inverter for loads other than those of properly applied threephase induction motors in general industrial use. (Use in other than properly applied three-phase induction motors may cause an accident.)

## ■General operation

Danger		See item
Disassembly	Never disassemble, modify or repair. This can result in electric shock, fire and injury. For repairs, call your sales agency.	2.
prohibited '		
9	<ul> <li>Never remove the front cover when power is on or open door if enclosed in a cabinet. The unit contains many high voltage parts and contact with them will result in electric shock.</li> </ul>	2.1
Prohibited	<ul> <li>Don't stick your fingers into openings such as cable wiring hole and cooling fan covers. This can result in electric shock or other injury.</li> </ul>	2.
1 TOTIIDREG	Don't place or insert any kind of object into the inverter (electrical wire cuttings, rods, wires). This can result in electric shock or fire.	2.
	Do not allow water or any other fluid to come in contact with the inverter. This can result in electric shock or fire.	2.
0	Turn power on only after attaching the front cover or closing door if enclosed in a cabinet. If power is turned on without the front cover attached or closing door if enclosed in a cabinet. This can result in electric shock or other injury.	2.1
Mandatory	<ul> <li>If the inverter begins to emit smoke or an unusual odor, or unusual sounds, immediately turn power off.</li> </ul>	3.
	If the equipment is continued in operation in such a state, the result may be fire. Call your local sales agency for repairs.	
	<ul> <li>Always turn power off if the inverter is not used for long periods of time since there is a possibility of malfunction caused by leaks, dust and other material.</li> <li>If power is left on with the inverter in that state, it may result in fire.</li> </ul>	3.

	🕂 Warnir	ng	See item
Prohibited contact	Do not touch heat radiating fins. These devices them.	are hot, and you'll get burned if you touch	3.
Prohibited	Avoid operation in any location where there is di other chemicals. The plastic parts may be dama shape, and there is a possibility of the plastic co dropped.  If the chemical or solvent is anything other than advance.  (Table 1) Examples of applicable	ged to a certain degree depending on their vers coming off and the plastic units being those shown below, please contact us in	1.4.4
	Chemical	Solvent	
	Hydrochloric acid (density of 10% or less)	Methanol	
	Sulfuric acid (density of 10% or less)	Ethanol	
	Nitric acid (density of 10% or less)	Triol	
	Caustic soda	Mesopropanol	
	Ammonia	Glycerin	
	Sodium chloride (salt)		
	(Table 2) Examples of unapplicab	le chemicals and solvents	
	Chemical	Solvent	
	Phenol	Gasoline, kerosene, light oil	
	Benzenesulfonic acid	Turpentine oil	
		Benzol	
		Thinner	

## ■Transportation • Installation

Danger		See item
Prohibited	D on to install or operate the inverter if it is damaged or any component is missing. This can result in electric shock of fire. Please consult your local sales agency for repairs.     D on to place any inflammable objects nearby. If a flame is emitted due to malfunction, it may result in a fire.     D on of install in any location where the inverter could come into contact with water or other fluids. This can result in electric shock or fire.	1.4.4
Mandatory	Must be used in the environmental conditions prescribed in the instruction manual. Use under any other conditions may result in malfunction.     Must be installed in non-inflammables such as metals. The rear panel gets very hot. If installation is in an inflammable object, this can result in fire.     Do not operate with the front panel cover removed. This can result in electric shock.     An emergency stop device must be installed that fits with system specifications (e.g. shut off input power then engage mechanical brake). Operation cannot be stopped immediately by the inverter alone, thus risking an accident or injury.     All options used must be those specified by Toshiba. The use of any other option may result in an accident.	1.4.4 1.4.4 1.4.4 1.4.4

	<u> </u>	See item
Prohibited	When transporting or carrying, do not hold by the front panel covers. The covers may come off and the unit will drop out resulting in injury. Do not install in any area where the unit would be subject to large amounts of vibration. That could result in the unit falling, resulting in injury.	1.4.4
Mandatory	<ul> <li>The main unit must be installed on a base that can bear the unit's weight. If the unit is installed on a base that cannot withstand that weight, the unit may fall resulting in injury.</li> <li>If braking is necessary (to hold motor shaft), install a mechanical brake. The brake on the inverter will not function as a mechanical hold, and if used for that purpose, injury may result.</li> </ul>	1.4.4

## ■Wiring

	Danger	See item
0	Do not connect input power to the output (motor side) terminals (U/T1,V/T2,W/T3). That will destroy the inverter and may result in fire.     Do not connect resistors to the DC terminals (across PA/+-PC/- or PO-PC/-). That may	22
Prohibited	<ul> <li>Bornot comment resistors as directed by the instructions for "Installing separate braking resistors."</li> <li>Within 15 minutes after turning off input power, do not touch wires of devices (MCCB) connected to the input side of the inverted.</li> <li>That could result in electric shock.</li> </ul>	22

	Danger	See item
0	Electrical construction work must be done by a qualified expert. Connection of input power by someone who does not have that expert knowledge may result in fire or electric shock.	2.1
Mandatory	Connect output terminals (motor side) correctly.  If the phase sequence is incorrect, the motor will operate in reverse and that may result in injury.	2.1
	Wiring must be done after installation. If wiring is done prior to installation that may result in injury or electric shock.	2.1
	The following steps must be performed before wiring. Thur did ill input power.  Wall at least 15 minutes and check to make sure that the charge lamp is no longer lit. Suse a tester that can measure DC voltage (400VDC or more), and check to make sure that the voltage to the DC main circuits (across PAI+PCI-) is 45V or less. If these steps are not properly performed, the wiring will cause electric shock.	2.1
	Tighten the screws on the terminal board to specified torque.  If the screws are not tightened to the specified torque, it may lead to fire.	2.1
	<ul> <li>Check to make sure that the input power voltage is +10%, -15% of the rated power voltage written on the rating label (±10% when the load is 100% in continuous operation) if the input power voltage is not +10%, -15% of the rated power voltage (±10% when the load is 100% in continuous operation) this may result in fire.</li> </ul>	1.4.4
•	Ground must be connected securely.  If the ground is not securely connected, it could lead to electric shock or fire when a malfunction or current leak occurs.	2.1
Be Grounded		

		See item
$\Diamond$	<ul> <li>Do not attach equipment (such as noise filters or surge absorbers) that has built-in capacitors to the output (motor side) terminals.</li> <li>That could result in a fire.</li> </ul>	2.1
Prohibited		

## ■Operations

	Danger	See item
Prohibited	Do not touch inverter terminals when electrical power is going to the inverter even if the motor is stopped. Touching the inverter terminals while power is connected to it may result in electric shock. Do not touch switches when the hands are wet and do not try to clean the inverter with a damp cloth. Such practices may result in electric shock. Do not go near the motor in alarm-stop status when the retry function is selected. The motor may suddenly restart and that could result in injury. Take measures for safety, e.g. attaching a cover to the motor, against accidents when the motor unexpectedly restarts.	3. 3. 3.
Mandatory	• Turn input power on after attaching the front cover. When storing inside the cabinet and using with the front cover removed, always close the cabinet doors first and then turn power on. If the power is turned on with the front cover or the cabinet doors open, it may result in electric shock. • Make sure that operation signals are off before resetting the inverter after malfunction. If the inverter is reset before turning off the operating signal, the motor may restart suddenly causing injury.	3.

Prohibited

	<u> </u>	See item
)	Observe all permissible operating ranges of motors and mechanical equipment. (Refer to the motor's instruction manual.) Not observing these ranges may result in injury.	3.

When sequence for restart after a momentary power failure is selected (inverter)

		See item
0	<ul> <li>Stand clear of motors and mechanical equipment if the motor stops due to a momentary power failure, the equipment will start suddenly after power recovers. This could result in unexpected injury.</li> </ul>	
Mandatory	Attach warnings about sudden restart after a momentary power failure on inverters, motors and equipment for projection of accidents in advance.	6.11.1

When retry function is selected (inverter)

•	<ul> <li>Stand clear of motors and equipment.</li> <li>If the motor and equipment stop when the alarm is given, selection of the retry function will restart them suddenly after the specified time has elapsed. This could result in unexpected injury.</li> </ul>	6.11.3		
Mandatory	Attach warnings about sudden restart in retry function on inverters, motors and equipment for prevention of accidents in advance.	6.11.3		

Maintenance and inspection

Danger						
$\Diamond$	<ul> <li>Do not replace parts.</li> <li>This could be a cause of electric shock, fire and bodily injury. To replace parts, call the local sales agency.</li> </ul>	14.2				
Prohibited						
0	The equipment must be inspected every day.     If the equipment is not inspected and maintained, errors and malfunctions may not be discovered and that could result in accidents.					
Mandatory	Before inspection, perform the following steps.     Turn off all input power to the inverter.	14.				
@Wait for at least 15 minutes and check to make sure that the charge lamp is no longer lit.						
	③Use a tester that can measure DC voltages (400VDC or more), and check to make sure that the voltage to the DC main circuits (across PA/+PC/-) is 45V or less. If inspection is performed without performing these steps first, it could lead to electric					
	ahaak					

Disposal

DISPUSA	I e e e e e e e e e e e e e e e e e e e	
		See item
Mandatory	• If you throw away the inverter, have it done by a specialist in industry waste disposal*. If you throw away the inverter by yourself, this can result in explosion of capacitor or produce noxious gases, resulting in injury. (?) Persons who specialize in the processing of waste and known as "industrial waste product collectors and transporters" or "industrial waste disposal persons." If the collection, transport and disposal of industrial waste is done by someone who is not licensed for that job, it is a punishable violation of the law. (Law on Waste Disposal and Cleaning)	16.

## Attach warning labels

Shown here are examples of warning labels to prevent, in advance, accidents in relation to inverters, motors and other equipment.

If the inverter has been programmed for auto-restart function after momentary power failure or retry function, place warning labels in a place where they can be easily seen and read.

If the inverter has been programmed for restart sequence of momentary power failure, place warning labels in a place where they can be easily seen and read.

(Example of warning label)

⚠

Warning (Functions programmed for restart)

Do not go near motors and equipment. Motors and equipment that have stopped temporarily after momentary power failure will restart suddenly after recovery. If the retry function has been selected, place warning labels in a location where they can be easily seen and read.

(Example of warning label)

Warning (Functions programmed for retry)

Do not go near motors and equipment.

Motors and equipment that have stopped temporarily after an alarm will restart suddenly after the specified time has elapsed.

## - Contents -

i. 5a	rety precautions	1
1. Re	ad first····	A-1
1.1	Check purchased product · · · · · · · · · · · · · · · · · · ·	A-1
1.2	Contents of the product code · · · · · · · · · · · · · · · · · · ·	A-1
1.3	Name and function of each part · · · · · · · · · · · · · · · · · · ·	A-2
1.4	Notes on the application · · · · · · · · · · · · · · · · · · ·	A-9
	Total of the approach	,,,
2. Co	nnection · · · · · · · · · · · · · · · · · · ·	B-1
2.1	Cautions on wiring · · · · · · · · · · · · · · · · · · ·	B-1
2.2	Standard connections · · · · · · · · · · · · · · · · · · ·	B-2
2.3	Description of terminals · · · · · · · · · · · · · · · · · · ·	B-7
	mple operation · · · · · · · · · · · · · · · · · · ·	C-1
3.1	Simple operation of the VF-nC1	C-2
4. Ba	sic VF-nC1 operations · · · · · · · · · · · · · · · · · · ·	D-1
4.1	How to set parameters · · · · · · · · · · · · · · · · · · ·	D-2
	The to set parameters	-
5. Ba	sic parameters · · · · · · · · · · · · · · · · · · ·	E-1
5.1	Selecting an operation mode · · · · · · · · · · · · · · · · · · ·	E-1
5.2	Meter setting and adjustment · · · · · · · · · · · · · · · · · · ·	E-2
5.3	Standard default setting · · · · · · · · · · · · · · · · · · ·	E-4
5.4	Selecting forward and reverse runs (operation panel only) · · · · · · · · · · · · · · · · · · ·	E-5
5.5	Setting acceleration/deceleration time	E-5
5.6	Maximum frequency · · · · · · · · · · · · · · · · · · ·	E-6
5.7	Upper limit and lower limit frequencies · · · · · · · · · · · · · · · · · · ·	E-6
5.8	Base frequency · · · · · · · · · · · · · · · · · · ·	E-7
5.9	Selecting control mode · · · · · · · · · · · · · · · · · · ·	E-7
5.10	Setting the electronic thermal · · · · · · · · · · · · · · · · · · ·	E-9
5.11	Preset speed operation (speeds in 15 steps) · · · · · · · · · · · · · · · · · · ·	E-11
6. Ex	tended parameters · · · · · · · · · · · · · · · · · · ·	F-1
6.1	Output signal-related parameters·····	F-1
6.2	Parameters related to terminal function selection · · · · · · · · · · · · · · · · · · ·	F-3
6.3	Basic parameters 2·····	F-7
6.4	Analog signals for frequency setting · · · · · · · · · · · · · · · · · · ·	F-8
6.5	Operation frequency	F-10
6.6	DC braking · · · · · · · · · · · · · · · · · · ·	F-11
6.7	Jump frequency – Jumping resonant frequencies · · · · · · · · · · · · · · · · · · ·	F-12
6.8	Preset speed operation frequencies 8 to 15 · · · · · · · · · · · · · · · · · ·	F-12
6.9	PWM carrier frequency · · · · · · · · · · · · · · · · · · ·	F-12
6.10	Trip-less intensification · · · · · · · · · · · · · · · · · · ·	F-13
6.11	Performing PI control · · · · · · · · · · · · · · · · · · ·	F-17
6.12	Improving torque and speed characteristics · · · · · · · · · · · · · · · · · · ·	F-19
6.13	Acceleration/deceleration patterns and acceleration/deceleration 2 · · · · · · · · · · · · · · · · · ·	F-20
6.14	Protection functions · · · · · · · · · · · · · · · · · · ·	F-21
6.15	Operation panel parameters · · · · · · · · · · · · · · · · · · ·	F-26
6.16	Communication function (common serial) · · · · · · · · · · · · · · · · · · ·	F-28
7 1/0	riety of operation · · · · · · · · · · · · · · · · · · ·	G-1
7. Va 7.1	Setting the operation frequency · · · · · · · · · · · · · · · · · · ·	G-1
7.1	Setting the operation mode · · · · · · · · · · · · · · · · · · ·	G-3
		J-3
8. Mc	onitoring the operation status·····	H-1
8.1	Status monitor mode · · · · · · · · · · · · · · · · · · ·	H-1

i

8.2 Display of trip information · · · · · · · · · · · · · · · · · · ·	H-3
9. Taking measures to satisfy the CE / UL / CSA · · · · · · · · · · · · · · · · · · ·	I-1
9.1 Compliance with the CE Marking · · · · · · · · · · · · · · · · · · ·	I-1
9.2 Compliance with UL Standard and CSA Standard · · · · · · · · · · · · · · · · · · ·	I-6
10. Peripheral devices · · · · · · · · · · · · · · · · · · ·	J-1
10.1 Selection of wiring materials and devices·····	J-1
10.2 Installation of a magnetic contactor · · · · · · · · · · · · · · · · · · ·	J-3
10.3 Installation of an overload relay · · · · · · · · · · · · · · · · · · ·	J-3
11. Table of parameters and data · · · · · · · · · · · · · · · · · ·	K-1
11.1 User parameters · · · · · · · · · · · · · · · · · · ·	K-1
11.2 Basic parameters · · · · · · · · · · · · · · · · · · ·	K-1
11.3 Extended parameters · · · · · · · · · · · · · · · · · · ·	K-3
The Existing parameters	
12. Specifications · · · · · · · · · · · · · · · · · · ·	L-1
12.1 Models and their standard specifications · · · · · · · · · · · · · · · · · · ·	L-1
12.2 External dimensions/weights · · · · · · · · · · · · · · · · · · ·	L-4
13. Before making a service call – Trip information and remedies · · · · · · · · · · · · · · · · · · ·	M-1
13.1 Trip causes/warnings and remedies · · · · · · · · · · · · · · · · · · ·	M-1
13.2 Restoring the inverter from a trip · · · · · · · · · · · · · · · · · · ·	M-6
13.3 If the motor does not run while no trip message is displayed · · · · · · · · · · · · · · · · ·	M-7
13.4 How to determine the causes of other problems · · · · · · · · · · · · · · · · · · ·	M-8
14. Inspection and maintenance · · · · · · · · · · · · · · · · · · ·	N-1
14.1 Regular inspection · · · · · · · · · · · · · · · · · · ·	N-1
14.2 Periodical inspection · · · · · · · · · · · · · · · · · · ·	N-2
14.3 Making a call for servicing · · · · · · · · · · · · · · · · · · ·	N-4
14.4 Keeping the inverter in storage · · · · · · · · · · · · · · · · · · ·	N-4
14.4 Reeping the inverter in storage	14-4
15. Warranty ·····	O-1
16. Disposal of the inverter · · · · · · · · · · · · · · · · · · ·	P-1

# 1. Read first


## 1.1 Check purchased product

Before using the product you have purchased, check to make sure that it is exactly what you ordered.

# / Warning




Use an inverter that conforms to the specifications of power supply and threephase induction motor being used. If the inverter being used does not conform to those specifications, not only will the three-phase induction motor not rotate correctly, but it may cause serious accidents through overheating and fire.

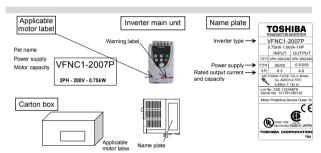

## 1.2 Contents of the product code


Here is explained the type and form written on the label

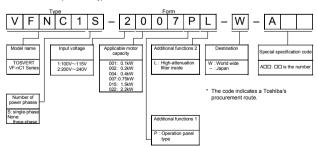

Warning: Always shut power off first then check the ratings label of inverter held in a cabinet.

## 1.3 Name and function of each part

## 1.3.1 Operation keypad panel

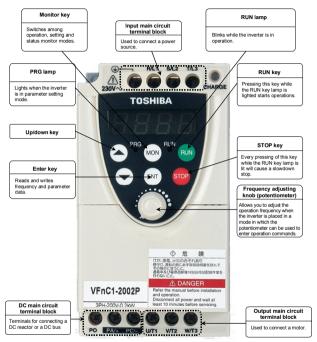

#### [Front panel]

#### Charge lamp

Indicates that high voltage is still present within the inverter. Do not open the terminal board cover while this is lit. This lamp is not provided for single-phase 200V European models.




#### Connector for optional devices

- Used to connect an optional device.
- Parameter writer
- · Extension panel
- RS485/RS232C

#### Control terminal block

Used to control the inverter by inputting signals from an external control device and to output signals to the external device.




Note 1: When installing the inverter where the ambient temperature will rise above 40°C, detach this caution label.

An example of a caution label on the top surface translation



## ■Self-up terminal block

The self-up terminals ①, R/LI, S/L2, (T/L3), U/T1, V/T2 and W/T3 on the main circuit board were factory-set to the UP position to allow you to connect cables smoothly. After you have connected cables to these terminals, tighten them securely.



Note: The self-up (self-lifting) terminals of VFNC1 are constructed with plastic body and screws, therefore please take following precautions.

- Do not unscrew the power terminals to UP position frequently. (Less than 5 times is recommended)
- . Do not press the screw when unscrew the main terminals.
- . Do not unscrew quickly like using an Electric screw driver.
- Do not pull the power wire during unscrewing the power terminals to UP position.
- Do not unscrew the power terminal to UP position with over torque.
- . Do not make any deformation of the cover when unscrewing the power terminals.

#### 1.3.2 Main circuit and control circuit terminal blocks


#### 1) Main circuit terminal block

When using a crimp terminal, cover its caulked part with a tube or use an insulated terminal.


Screw size	tightening torque
M3 screw	0.8N · m
M3.5 screw	1.0N · m


VFNC1-2001P~2007P

[Main circuit input terminals]



[Main circuit output terminals]




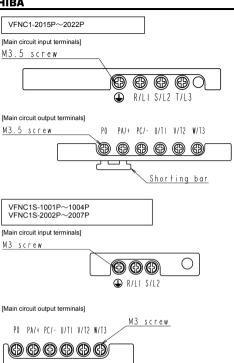


Shorting bar

VFNC1S-1007P VFNC1S-2015P~2022P

[Main circuit input terminals]



[Main circuit output terminals]



VFNC1S-2002PL~2007PL

[Main circuit input terminals]




[Main circuit output terminals]



VFNC1S-2015PL~2022PL

[Main circuit input terminals]




[Main circuit output terminals]



### 2) Control circuit terminal block

The same type of terminal board is provided for all models.



For details of each terminal, see 2.3.2.

## 1.4 Notes on the application

#### 1.4.1 Motors

When the VF-nC1 and the motor are used in conjunction, pay attention to the following items.

## **↑** Warning



Use an inverter that conforms to the specifications of the three-phase induction motor and power supply being used. If the inverter being used does not conform to those y specifications, not only will the three-phase induction motor not rotate correctly, but it may causes serious accidents through overheating and fire.

#### Comparisons with commercial power operation.

The VF-nC1 Inverter employs the sinusoidal PWM system. However, the output voltage and output current do not assume a precise sine wave, they have a distorted wave that is close to sinusoidal waveform. This is why compared to operation with a commercial power there will be a slight increase in motor temperature, noise and vibration.

#### Operation in the low-speed area

When running continuously at low speed in conjunction with a general purpose motor, there may be a decline in that motor's cooling effect. If this happens, operate with the output decreased from rated load.

If you want to run continuously low speed operations at rated torque, please use the VF motor made especially for Toshiba inverter. When operating in conjunction with a VF motor, you must chance the inverter's motor overload protection level to "VF motor use (BI,B)":

#### Adjusting the overload protection level

The VF-nC1 Inverter protects against overloads with its overload detection circuits (electronic thermal). The electronic thermal's reference current is set to the inverter's rated current, so that it must be adjusted in line with the rated current of the general purpose motor being used in combination.

#### High speed operation at and above 60Hz

Operating at frequencies greater than 60Hz will increase noise and vibration. There is also a possibility that such operation will exceed the motor's mechanical strength limits and the bearing limits so that you should inquire to the motor's manufacturer about such operation.

#### Method of lubricating load mechanisms.

Operating an oil-lubricated reduction gear and gear motor in the low-speed areas will worsen the lubricating effect. Check with the manufacturer of the reduction gear to find out about operable gearing area.

#### Extremely low loads and low inertia loads

The motor may demonstrate instability such as abnormal vibrations or overcurrent trips at light loads of 50 percent or under of the load percentage, or when the load's inertia moment is extremely small. If that happens reduce the carrier frequency.

#### Occurrence of instability

Unstable phenomena may occur under the load and motor combinations shown below.

- · Combined with a motor that exceeds applicable motor ratings recommended for the inverter
- Combined with special motors such as explosion-proof motors
- To deal with the above lower the settings of inverter carrier frequency.
- Combined with couplings between load devices and motors with high backlash
   Combined with loads that have sharp fluctuations in rotation such as piston movements

#### Braking a motor when cutting off power supply


A motor with its power cut off goes into free-run, and does not stop immediately. To stop the motor quickly as soon as the power is cut off install an auxiliary brake. There are different kind of brake devices, both electrical and mechanical. Select the brake that is best for the system.

#### Loads that generate negative torque

When combined with loads that generate negative torque the protection for overvoltage and overcurrent on the inverter will go into operation and may cause a trip. For this kind of situation, you must install a dynamic braking resistor, etc. that compiles with the load conditions.

#### Motor with brake

If a motor with brake is connected directly to the output side of the inverter, the brake will not release because voltage at startup is low. Wire the brake circuit separately from the motor's main circuit.



In circuit configuration 1, the brake is turned on and off through MC2 and MC3. If the circuit is configured in some other way, the overcurrent trip may be activated because of the locked rotor current when the brake goes into operation. Circuit configuration 2 uses low-speed signal FM/OUT to turn on and off the brake. Turning the brake on and off with a low-speed signal may be better in such applications as elevators. Please confer with us before designing the system.

#### 1.4.2 Inverters

#### Protecting inverters from overcurrent


The inverter has an overcurrent protection function. However because the programmed current level is set to the inverter's maximum applicable motor, if the motor is one of small capacity and it is in operation, the overcurrent level and the electronic thermal protection must be readjusted. If adjustment is necessary, see 5-10 in Chapter 5, and make adjustments as directed.

#### Inverter capacity

Do not operate a large capacity motor with a small capacity (kVA) inverter even with light loads. Current ripple will raise the output peak current making it easier to set off the overcurrent trip.

#### Power factor improving capacitors


Power factor improving capacitors cannot be installed on the output side of the inverter. When a motor is run that has a power factor improving capacitor attached to it, remove the capacitors. This can cause inverter malfunction trips and capacitor destruction.



Power factor improving capacitor

#### Operating at other than rated voltage

Connections to voltages other than the rated voltage described in the rating label cannot be made. If a connection must be made to a power supply other than one with rated voltage, use a transformer to raise or lower the voltage to the rated voltage. Circuit interrupting when two or more inverters are used on the same power line.



Breaking of selected inverter

There is no fuse in the inverter's main circuit. Thus, as the diagram above shows, when more than one inverter is used on the same power line, you must select interupting characteristics so that only the MCCB2 will trip and the MCCB1 will not trip when a short occurs in the inverter (INV1). When you cannot select the proper characteristics install a circuit interrupting fuse between the MCCB2 and the INV1.

#### ■ Disposal

If an inverter is no longer usable, dispose of it as industrial waste.

#### 1.4.3 What to do about leak current

## Narning 🏗

Current may leak through the inverter's input/output wires because of insufficient electrostatic capacity on the motor with bad effects on peripheral equipment. The leak current's value is affected by the carrier frequency and the length of the input/output wires. Test and adopt the following remedies against leak current.


#### (1) Leakage current from the inverter main unit

As compared with other types of inverters, a large amount of current leaks from your inverter when it is used in delta connection (with one phase grounded). Take this into consideration when selecting an earth leakage breaker.

#### <Leakage current in delta connection (one phase grounded)> (For reference only)

#### (2) Effects of leakage current across ground


Leakage current may flow not just through the inverter system but also through ground wires to other systems. Leakage current will cause earth leakage breakers, leak current relays, ground relays, fire alarms and sensors to operate improperly, and it will cause superimposed noise on the CRT screen or display of incorrect current amounts during current detection with the CT.



#### Remedies:

- Reduce PWM carrier frequency.
  - The setting of PWM carrier frequency is done with the parameter F 300.
- Use high frequency remedial products for earth leakage breakers. If you use equipment like this, there is no need to reduce the PWM carrier frequency.
- If the sensors and CRT are affected, it can be remedied using the reduction of PWM carrier frequency described in 1 above, but if this cannot be remedied since there is an increase in the motor's magnetic noise, please consult with Toshiba.

#### (3) Affects of leakage current across lines




#### 1)Thermal relays

The high frequency component of current leaking into electrostatic capacity between inverter output wires will increase the effective current values and make externally connected thermal relays operate improperly. If the wires are more than 50 meters long, it will be easy for the external thermal relay to operate improperly with models having motors of low rated current (several A(ampere) or less), because the leak current will increase in proportion to the motor ratino.

#### Remedies:

- 1. Use the electronic thermal built into the inverter.
- The setting of the electronic thermal is done using parameter ### & E H r .
- Reduce the inverter's PWM carrier frequency. However, that will increase the motor's magnetic noise. Use parameter F 3 0 0 for setting the PWM carrier frequency.
- This can be improved by installing 0.1μ~0.5μF-1000V film capacitor to the input/output terminals of each phase in the thermal relay.



#### 2CT and ammeter

If a CT and ammeter are connected externally to detect inverter output current, the leak current's high frequency component may destroy the ammeter. If the wires are more than 50 meters long, it will be easy for the high frequency component to pass through the externally connected CT and be superimposed on and burn the ammeter with models having motors of low rated current (several A(ampere) or less) because the leak current will increase in proportion to the motor's rated current.

#### Remedies:

- Use a multi-function programmable output terminal for the inverter's control circuit.
   A current can be put out via the FM/OUT terminal.
  - If the meter is connected, use an ammeter of 1mAdc full scale or a voltmeter of 7.5V-1mA full scale
- 2. Use the monitor functions built into the inverter.
  - Use the monitor functions on the panel built into the inverter to check current values.

#### 1.4.4 Installation

#### ■Installation environment

The VF-nC1 Inverter is an electronic control instrument. Take full consideration to installing it in the proper operating environment.

Danger				
0	<ul> <li>Do not place any inflammable substances near the VF-nC1 Inverter. If an accider occurs in which flame is emitted, this could lead to fire.</li> </ul>			
Prohibited				
0	<ul> <li>Operate under the environmental conditions prescribed in the instruction manual.</li> <li>Operations under any other conditions may result in malfunction.</li> </ul>			

## 



Mandatory

Do not install the VF-nC1 Inverter in any location subject to large amounts of vibration.

This could cause the unit to fall, resulting in bodily injury.



 Check to make sure that the input power voltage is +10%, -15% of the rated power voltage written on the rating label (±10% when the load is 100% in continuous operation)

If the input power voltage is not  $\pm 10\%$ , -15% of the rated power voltage ( $\pm 10\%$  when the load is 100% in continuous operation) this may result in fire.



- Avoid operation in any location where there is direct spraying of the following solvents or other chemicals. The plastic parts may be damaged to a certain degree depending on their shape, and there is a possibility of the plastic covers coming off and the plastic units being dropped.
- If the chemical or solvent is anything other than those shown below, please contact us in advance

(Table 1) Examples of applicable chemicals and solvents

Chemical	Solvent
Hydrochloric acid (density of 10% or less)	Methanol
Sulfuric acid (density of 10% or less)	Ethanol
Nitric acid (density of 10% or less)	Triol
Caustic soda	Mesopropanol
Ammonia	Glycerin
Sodium chloride (salt)	

#### (Table 2) Examples of unapplicable chemicals and solvents

Chemical	Solvent
Phenol	Gasoline,
	kerosene, light oil
Benzenesulfonic acid	Turpentine oil
	Benzol
	Thinner

Note: The plastic cover has resistance to deformation by the above applicable solvents. They are not examples for resistance to fire or explosion.



- Do not install in any location of high temperature, high humidity, moisture condensation and freezing and avoid locations where there is exposure to water and/or where there may be large amounts of dust. metallic fraoments and olimist.
- Do not install in any location where corrosive gases or grinding fluids are present.

. Operate in areas where ambient temperature ranges from -10°C to 50°C. However, when installing the inverter where the ambient temperature will rise above 40°C, detach the caution label on the top surface.






Note: The inverter is a heat-emitting body. Make sure to provide proper space and ventilation when installing in the cabinet. When installing the inverter in a cabinet, you are recommended to detach the caution label even if the temperature in the cabinet is below 40°C

. Do not install in any location that is subject to large amounts of vibration.



. If the VF-nC1 Inverter is installed near any of the equipment listed below, provide measures to insure against errors in operation.



Solenoids: Brakes: Fluorescent lights: Resistors:

Attach surge suppressor on coil. Attach surge suppressor on coil. Magnetic contactors: Attach surge suppressor on coil. Attach surge suppressor on coil. Place far away from VF-nC1 Inverter.

#### ■ How to install





## ■Installation location

Select a location with good indoor ventilation, place lengthwise in the vertical direction and attach to a metal wall surface.

If you are installing more than one inverter, the separation between inverters should be at least 5 centimeters, and they should be arranged in horizontal rows.


If the inverters are horizontally arranged with no space between them (side-by-side installation), peel of the ventilation seals on top of the inverters and operate at 40°C or less.

#### Standard installation

injury may result.

#### · Horizontal installation (side-by-side installation)

on the inverter will not function as a mechanical hold, and if used for that purpose,



The space shown in the diagram is the minimum allowable space. Because air cooled equipment has cooling fans built in on the top or bottom surfaces, make the space on top and bottom as large as possible to allow for air passage.

Note: Do not install in any location where there is high humidity or high temperatures and where there are large amounts of dust, metallic fragments and oilmist. If you are going to install the equipment in any area that presents a potential problem, please consult with Toshiba before doing so.

#### ■ Calorific values of the inverter and the required ventilation

The energy loss when the inverter converts power from AC to DC and then back to AC is about 5-10 percent. In order to suppress the rise in itemperature inside the cabinet when this loss becomes heat loss, the interior of the cabinet must be ventilated and cooled.

				Calorific	Amount of	Heat
	Operating	Inverter Type		Values (W)	forcible air	discharge
Voltage Class	motor capacity (kW)			Carrier frequency 12kHz	cooling ventilation required (m³/min)	surface area required for sealed storage cabinet (m²)
	0.1		1001P	12	0.07	0.24
Single-Phase	0.2	VFNC1S-	1002P	21	0.12	0.42
100V Class	0.4		1004P	30	0.17	0.6
	0.75		1007P	55	0.31	1.1
	0.2		2002P(L)	21	0.12	0.42
Single-Phase	0.4		2004P(L)	30	0.17	0.6
200V Class	0.75	VFNC1S-	2007P(L)	55	0.31	1.1
200 V Class	1.5		2015P(L)	96	0.55	1.9
	2.2		2022P(L)	126	0.72	2.5
	0.1		2001P	12	0.07	0.24
	0.2		2002P	21	0.12	0.42
Three-Phase	0.4	VFNC1-	2004P	30	0.17	0.6
200V Class	0.75	VFINC I-	2007P	55	0.31	1.1
	1.5		2015P	96	0.55	1.9
	2.2		2022P	126	0.72	2.5

#### Notes

- The heat loss for the optional external devices (input reactor, DC reactor, radio noise reduction filters, etc.) is not included in the calorific values in the table.
- Case of 100% Load Continuation operation.

#### ■ Panel designing taking into consideration the effects of noise.


The inverter generates high frequency noise. When designing the control panel setup, consideration must be given to that noise. Examples of measures are given below.

- Wire so that the main circuit wires and the control circuit wires are separated. Do not place them in the same conduit, do not run them parallel, and do not bundle them.
- · Provide shielding and twisted wire for control circuit wiring.
- Separate the input (power) and output (motor) wires of the main circuit. Do not place them in the same conduit, do not run them parallel, and do not bundle them.
- Ground the inverter ground terminals (♣).
- . Install surge suppressor on any magnetic contactor and relay coils used around the inverter.
- . Install noise filters if necessary.

#### ■Installing more than one unit in a cabinet

If you are installing two or more inverters in one cabinet, pay attention to the following.

- Inverters may be installed side by side with each other with no space left between them.
   When installing inverters side by side, detach the caution label on the top surface of each inverter and use them where the ambient temperature will not rise above 40°C.
- When using inverters where the ambient temperature will exceed 40°C, allow a space of 5 cm or more between inverters and detach the caution label on the top surface of each inverter.
- . Ensure a space of at least 20 cm on the top and bottom of the inverters.
- Install an air deflecting plate so that the heat rising up from the inverter on the bottom does not
  affect the inverter on the top.



## Connection

# Danger

Never disassemble, modify or repair. This can result in electric shock, fire and

injury. For repairs, call your sales agency.

prohibited

Don't stick your fingers into openings such as cable wiring hole and cooling fan

Prohibited

covers. This can result in electric shock or other injury. Don't place or insert any kind of object into the inverter (electrical wire cuttings. rods, wires). This can result in electric shock or fire.

 Do not allow water or any other fluid to come in contact with the inverter. That may result in electric shock or fire.

# Warning



When transporting or carrying, do not hold by the front panel covers. The covers may come off and the unit will drop out resulting in injury.

#### 2.1 Cautions on wiring

# Danger



Never remove the front cover when power is on or open door if enclosed in a cahinet The unit contains many high voltage parts and contact with them will result in

electric shock. Turn power on only after attaching the front cover or closing door if enclosed in a



cabinet. If power is turned on without the front cover attached or closing door if enclosed in

a cabinet. This can result in electric shock or other injury. Electrical construction work must be done by a qualified expert.

Connection of input power by someone who does not have that expert knowledge may result in fire or electric shock.

Connect output terminals (motor side) correctly.

If the phase sequence is incorrect, the motor will operate in reverse and that may result in injury.

· Wiring must be done after installation.

If wiring is done prior to installation that may result in injury or electric shock.

· The following steps must be performed before wiring.

1 Shut off all input power.

2Wait at least 15 minutes and check to make sure that the charge lamp is no longer lit.

3Use a tester that can measure DC voltage (400VDC or more), and check to make sure that the voltage to the DC main circuits (across PA/+-PC/C) is 45V or

If these steps are not properly performed, the wiring will cause electric shock.

 Tighten the screws on the terminal board to specified torque. If the screws are not tightened to the specified torque, it may lead to fire.

Ground must be connected securely.

If the ground is not securely connected, it could lead to electric shock or fire when a malfunction or current leak occurs.

Grounded

# 



 Do not attach devices with built-in capacitors (such as noise filters or surge absorber) to the output (motor side) terminal.
 This could cause a fre.

### ■Preventing radio noise

To prevent electrical interference such as radio noise, separately bundle wires to the main circuit's power terminals (R/L1, S/L2, T/L3) and wires to the motor terminals (U/T1, V/T2, W/T3).

#### ■ Control and main power supply

The control power supply and the main circuit power supply for the VF-nC1 are the same. If a malfunction or trip causes the main circuit to be shut off, control power will also be shut off. When checking the cause of the malfunction or the trip, use the trip holding retention selection parameter.

#### ■Wiring

- Because the space between the main circuit terminals is small use sleeved pressure terminals for the connections. Connect the terminals so that adjacent terminals do not touch each other.
- For ground terminal use wires of the size that is equivalent to or larger than those given in table 10.1 and always ground the inverter (200V voltage class: D type ground! (former type 3 ground!)
  - Use as large and short a ground wire as possible and wire it as close as possible to the inverter.
- See the table in 10.1 for wire sizes.
- The length of the main circuit wire in 10.1 should be no longer than 30 meters. If the wire is longer than 30 meters, the wire size (diameter) must be increased.

#### 2.2 Standard connections





 Do not connect input power to the output (motor side) terminals (U/T1, V/T2, W/T3). Connecting input power to the output could destroy the inverter or cause a

Prohibited

- Do not connect resistors to DC terminals (across PA/+-PC/- or across PO-PC/-).
   It could cause a fire.
- First shut off input power and wait at least 15 minutes before touching wires on equipment (MCCB) that is connected to inverter power side.
   Touching the wires before that time could result in electric shock.



Be grounded

· Securely connect to ground with a ground wire


If a secure connection to ground is not made, this could cause electric shock or fire when a malfunction or leak current occurs.

#### 2.2.1 Standard connection diagram (1)

This diagram shows a standard wiring of the main circuit.


(1) Sink <common: CC>


## ■When using V1/S3 terminal as an analog input terminal (F 109:0 or 1)



- \*1: Only European model has a built-in noise filter.
- \*2: The terminal can be switched between FM/OUT and VI/S3 by changing a parameter.
- \*3: The terminal can also be used as an input terminal by changing a parameter.
- \*4: European models are not provided with PO terminal.
- \*5: 1-phase 100V models cannot be used with DC reactors.

## ■When using V1/S3 terminal as a logic input terminal (F 109: 2)






- \*1: Only European model has a built-in noise filter.
- \*2: The terminal can be switched between FM/OUT and VI/S3 by changing a
- \*3: The terminal can also be used as an input terminal by changing a parameter.
- \*4: To use VI/S3 terminal as an input terminal, P15 and VI/S3 must be short-circuited with a resistor (recommended resistance: 4.7kΩ-1/4W).
- \*5: European models are not provided with PO terminal.
- \*6: 1-phase 100V models cannot be used with DC reactors.

### 2.2.2 Standard connection diagram (2)


(2) Source <common: P15>


■When using V1/S3 terminal as an analog input terminal (F 109:0 or 1)

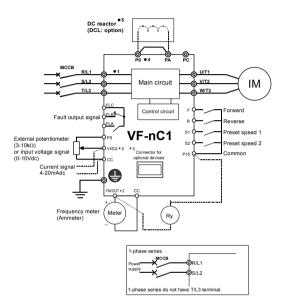

- \*1: Only European model has a built-in noise filter.
- \*2: The terminal can be switched between FM/OUT and VI/S3 by changing a parameter.
- \*3: The terminal can also be used as an input terminal by changing a parameter.
- \*4: European models are not provided with PO terminal.
- \*5: 1-phase 100V models cannot be used with DC reactors.

## ■When using V1/S3 terminal as a logic input terminal (F 109:2)






- \*1: Only European model has a built-in noise filter.
- \*2: The terminal can be switched between FM/OUT and VI/S3 by changing a parameter.
- \*3: The terminal can also be used as an input terminal by changing a parameter.
- \*4: European models are not provided with PO terminal.
- \*5: 1-phase 100V models cannot be used with DC reactors.

## 2.3 Description of terminals


#### 2.3.1 Main circuit terminals

This diagram shows an example of wiring of the main circuit. Use options if necessary.

## ■Power supply and motor connections



## ■ Connections with peripheral equipment



### ■ Main circuit

Terminal symbol	Terminal function
<u></u>	Grounding terminal for connecting inverter case. 2 grounding terminals.
R/L1, S/L2, T/L3 100V class: 1-phase 100V to 115V - 50/60Hz 200V class: 1-phase 200V to 240V - 50/60Hz, 3-phase 200V-240V - *1-phase series have R/L1 and S/L2 terminal.	
U/T1, V/T2, W/T3	Connect to a (3-phase induction) motor
PC/-	This is a negative potential terminal in the internal DC main circuit.
PO, PA/+	Terminals for connecting a DC reactor (DCL: optional external device). Shorted when shipped from the factory. Before installing DCL remove the short bar. 1-phase 100V models cannot be used with DC reactors. 1-phase 200V models for Europe are not provided with PO terminal.

## 2.3.2 Control circuit terminals (sink logic (common: CC))

The control circuit terminal board is the same for all models.






Termina I symbol	Input/ output	Function Sp	ecifications	Inverter internal circuit
F	Input	Shorting across F-CC causes forward rotation; copen causes slowdown and stop. (If ST is always ON)  Shorting across R-CC causes reverse artificity.		
R	Input	open causes slowdown and stop. (If ST is always ON) Shorting across R-CC/F- CC causes reverse  Dry 15Vd *Sink/s	contact input c - 5mA or less ource selectable ging a parameter	
S1	Input	Shorting across S1-CC causes preset speed operation. Shorting across S2-CC causes preset speed	5 5 2	S 0.047 μ 122K 1K
S2	Input	Shorting across S2-CC causes preset speed operation.	C	° P
СС	Common to input/ output	Control circuit's equipotential terminal.		
P5	Output	Power output for analog input setting. (permis	5Vdc sible load current: 1 10mAdc)	+5V
VI/S3	Input	frequency 0-80Hz.	10Vdc: nal impedance: 42kΩ) 4-20mA: nal impedance: 250Ω)	/3 200 200 p 200 x


Termina I symbol	Input/ output	Function	Specifications	Inverter internal circuit
FM/ OUT	Output	Multifunction programmable output. Standard default setting: output frequency. Meters connectable to FM/OUT: fmAdc full-scale ammeter or 7.5 Vdc (10Vdc) - 1mA full-scale voltmeter (PWM output). Possible to switch to programmable open collector output by changing a parameter.	1mA full-scale DC ammeter or 7.5Vdc (10Vdc) full-scale DC voltmeter Open collector output: 24Vdc-50mA	74 15V
P15	Output	15Vdc power output.	15Vdc-100mA	+15V
FLA FLB FLC	Output	Multifunction programmable relay contact output. Contact ratings: 250Vac - 2A (cos#=1), 30Vdc - 1A, 250Vac - 1A (cos#=0.4). Standard default setting: Monitoring of slatus of inverter's protection function. Activation of the protection function causes circuit FLA-FLC to close and circuit FLB-FLC to open.	250Vac-2A (cos∉=1): at resistance load 30Vdc-1A 250Vac-1A (cos∉=0.4)	FLB +15V FLB + 150 - FLD + 100

## ■Sink logic (negative common)/source logic (positive common)


## ··· Logic switching of input output terminals

Current flowing out turns control input terminals on. These are called sink logic terminals. (For all models except models with a built-in noise filter, control input terminals are factory-set to sink logic.) The general used method in Europe is source logic in which current flowing into the input terminal turns it on.





Output terminals cannot be switched between sink logic and source logic. See the figures below for connection to sink logic and source logic terminals.



#### ■Switching the input terminal logic between sink and source

Input terminals of the VF-nC1 inverter can be switched between sink logic and source logic, using the F 12.7 parameter.

When switching between sink logic and source logic, do it before connecting cables to inverter's control circuit terminals. When the confirmation message  $\mathcal{E} S \mathcal{Q}$  or  $\mathcal{E} S \mathcal{I}$  is displayed after switching between sink logic and source logic, using the  $\mathcal{F} \mathcal{I} 2^{\gamma}$  parameter, reset the inverter, using the operation panel, by turning the power off, or by inputting a reset signal from an external control device.

#### ■ Switching the VI/S3 terminal between logic input and analog input

The VI/S3 terminal of the VF-nC1 inverter can be switched between contact input and analog input by changing a parameter setting. When switching between contact input and analog input, do it before connecting cables to inverter's control circuit terminals (F = 1.09).

If switching between contact input and analog input is done after cable connection, the inverter and/or the external device connected might be damaged. Before turning on the inverter, make sure all cables are connected correctly to the control terminals.

When using the VI/S3 terminal as an contact input terminal (sink logic), be sure to insert a resistor\* between the P15 and VI/S3 terminals. (Recommended resistance: 4 7k0-1/4W).

# ■ Switching the FM/OUT terminal between meter output (PWM output) and open collector output

The FM/OUT terminal of the VF-nC1 inverter can be switched between meter output (PWM output) and open collector output.

When switching between meter output (PWM output) and open collector output, do it before connecting an external device to the inverter. After switching from meter output (PWM output) to open collector output, and vice versa, check using the  $F.\Pi.5t$  parameter to be sure that the desired function is assigned to the FM/OUT terminal, and then turn the power off. After the completion of cable connection, turn the power back on. If switching between meter output and open collector output is done after cable connection, the inverter might be damaged.

# Simple operation

## Danger



Do not touch inverter terminals when electrical power is connected to the inverter even if the motor is stopped.

## Prohibited

- Touching the inverter terminals while power is connected to it may result in electric shock.
- . Do not touch switches when the hands are wet and do not try to clean the inverter with a damp cloth. Such practices may result in electric shock.
- Do not go near the motor in alarm-stop status when the retry function is selected.
- The motor may suddenly restart and that could result in injury. Take measures for safety, e.g. attaching a cover to the motor, against accidents when the motor unexpectedly restarts.



 Turn power on only after attaching the front cover or closing door if enclosed in a cabinet.

If power is turned on without the front cover attached or closing door if enclosed in a cabinet, that may result in electric shock or other injury.

- . If the inverter begins to emit smoke or an unusual odor, or unusual sounds. immediately turn power off.
- If the equipment is continued in operation in such a state, the result may be fire.
- Call your local sales agency for repairs. Always turn power off if the inverter is not used for long periods of time.
- . Turn input power on after attaching the front cover.
  - When enclosed inside a cabinet and using with the front cover removed, always close the cabinet doors first and then turn power on. If the power is turned on with the front cover or the cabinet doors open, it may result in electric shock.
- . Make sure that operation signals are off before resetting the inverter after malfunction.
- If the inverter is reset before turning off the operating signal, the motor may restart suddenly causing injury.

# Warning



 Do not touch heat radiating fins. These devices are hot, and you'll get burned if you touch them

# prohibited

Prohibited

- Always observe the permissible operating ranges of motors and other equipment (see the instruction manual for the motor).
- If these ranges are not observed, it could result in injury.

## 3.1 Simple operation of the VF-nC1

The procedures for setting operation frequency and the methods of operation can be selected from the following.

Run / stop

- : (1) Run and stop from the operation panel
  - (2) Run and stop using external signals to the terminal block
    - (3) Run and stop by serial communications (with an optional external device)

Frequency setting

- (1) Setting of frequency using the potentiometer on the inverter main unit
- (2) Frequency setting using the UP and DOWN keys on the operation panel
- (3) Setting of frequency using external signals to the terminal block (0-10Vdc. 4-20mAdc)
- (4) Frequency setting by serial communications (with an optional external device)

Use the basic parameters [ \( \int \mathbb{O} \) \( d \) (command mode selection) and \( F \) \( \int \mathbb{O} \) \( d \) (frequency setting mode selection) for selection.

selection) for selecting.			
Title	Function	Adjustment range	Default setting
CUOA	Command mode selection	0: Terminal block 1: Operation panel	1
FNO4	Frequency setting mode selection	O: Terminal block     1: Operation panel     2: Internal potentiometer     3: Serial communications     4: Terminal block/ootentiometer switching	2

[Steps in setting parameters]

Key operated LED display Operation		Operation
	0.0	Displays the operation frequency (operation stopped). (When standard monitor display selection F 7 + G=G is set to [Operation frequency])
MON	ЯИН	The first basic parameter "History (RUH)" is displayed.
	Enoa	Press either the $\triangle$ key or the $\nabla$ key to select " $\mathcal{E} \Pi \mathcal{U} d$ ."
ENT	t	Press the ENTER key to display the parameter setting. (Standard default setting: ()
	0	Change the parameter to ${\mathcal G}$ (Terminal board) by pressing the $\ \triangle$ key.
ENT	0 ⇔ C N 0 d	Press the ENTER key to save the changed parameter. [ \( \Pi \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \
	FNOd	Press either the △ key or the ▽ key to select "F ∏ 🖁 ♂."
ENT	2	Press the ENTER key to display the parameter setting. (Standard default setting: ∠)
(A) (V)	t	Change the parameter to $\mbox{\em {\it i}}$ (Operation panel) by pressing the $\mbox{\em {\it \nabla}}$ key
ENT	I⇔ FNO∂	Press the ENTER key to save the changed parameter. F \( \text{I}  d \) and the parameter set value are displayed alternately.

Pressing the MON key twice returns the display to standard monitor mode (displaying operation frequency).

#### 3.1.1 How to start and stop

(1) Start and stop using the operation panel keys ([ [] [] ] ] : 1)

Use the RUN and STOP keys on the operation panel to start and stop the motor.

(RUN) : Motor starts.


(STOP): Motor stops (slowdown stop).

(2) Start and stop using external signals to the terminal board ([\( \int \)] d : [\( \int \)]

Use external signals to the inverter terminal board to start and stop the motor. (Sink logic connection)


Short F and CC terminals: run forward

Open F and CC terminals: slow down and stop



★Coast stop

The standard default setting is for slowdown stop. To make a coast stop, assign an ST terminal function to an idle terminal using the programmable terminal function. For coast stop, open the ST-CC when stopping the motor in the state described at left. The monitor on the inverter at this time will display  $B \in \mathcal{F}$ .



## 3.1.2 How to set the frequency

 Setting the frequency using the potentiometer on the inverter main unit (FNDd: 2)

Set the frequency with the notches on the potentiometer.



Move clockwise through the higher notches for the higher frequencies.

Since the potentiometer has hysteresis, it settings may change to some degree after the power is turned off and turned back on.

(2) Setting the frequency using the operation panel (FIDd: 1) Set the frequency from the operation panel.

: Moves the frequency up

Moves the frequency down


Example of operating a run from the panel

Example of operating a run from the paner			
Key operated LED display		Operation	
	0.0	Displays the operation frequency. (When standard monitor display selection F 7 I G=G is set to 0 [operation frequency])	
	5 0.0	Set the operation frequency.	
ENT		Press the ENTER key to save the operation frequency setting. F [ and the frequency are displayed alternately.	
<b>(A) (V)</b>	6 0.0	Pressing the $\triangle$ key or the $\nabla$ key will change the operation frequency even during operation.	

Press the ENTER key after changing the operation frequency, otherwise it will not be saved, although it is displayed.

## (3) Setting the frequency using external signals to the terminal board (FNDd: D) ■Frequency setting

#### 1) Setting the frequency using external potentiometer



★Potentiometer control Set frequency using the potentiometer (3-10kΩ-1/4W) For more detailed information on adjustments, see 6.4. 60Hz Frequency

MAY

MIN \*The F 189 parameter (VI/S3 terminal function selection) is used to specify a function for the VI/S3 input terminal. The FCHG parameter (frequency command forced switching) makes it possible to use both the analog input frequency signal and the frequency signal set with the internal potentiometer, which can be switched by activating or deactivating the input terminals.

See 5.1 for details. \*1It is necessary to set the FPRR (=47~50approx.) in case of using the potentiometer with P5

Note: The current input and voltage input functions cannot be used at the same time.

## 2) Setting the frequency using input voltage (0-10V)



★Voltage signal
Setting frequency using voltage signals
(0-10V). For more detailed information
on adjustments, see 6.4.



• The F 109 parameter (VIVS3 terminal function selection) is used to specify a function for the VIVS3 input terminal. The FCHG parameter (frequency command forced switching) makes it possible to use both the analog input frequency signal and the frequency signal set with the internal potentiometer, which can be switched by activating or deactivating the input terminals.
Sep 5 if or lefalis

Note: The current input and voltage input functions cannot be used at the same time.

#### 3) Setting the frequency using current input (4-20mA)



★Current signal

Setting frequency using current signals (4-20mA). For more detailed information on adjustments, see 6.4.



\* The F 109 parameter (VIVS3 terminal function selection) is used to specify a function for the VIVS3 input terminal. The FCHG parameter (frequency command forced switching) makes it possible to use both the analog input frequency signal and the frequency signal set with the internal potentiometer, which can be switched by activating or deactivating the input terminals.
See 5.1 for Idealis

Note: The current input and voltage input functions cannot be used at the same time.

## (4) Setting the frequency by serial communications (FNDd: 3)

The frequency can also be set from a higher-order external control device via optionally available communications conversion units (RS2001Z, RS20035, RS2002Z and RS4001Z).

# 4. Basic VF-nC1 operations

The VF-nC1 has the following three monitor modes.

Standard monitor mode

: The standard inverter mode. This mode is enabled when inverter power goes on.

After mode is for monitoring the output frequency and setting the frequency designated value by UP/DOWN key of operation panel. In it is also displayed information about status alarms during running and trips.

- · Setting frequency designated values see 3.1.2
- Status alarm

If there is an error in the inverter, the alarm signal and the frequency will flash alternately in the LED display.

- f : When a current flows at or higher than the overcurrent stall level.
- P: When a voltage is generated at or higher than the over voltage stall level.
  - L: When a load reaches 50% or higher of the overload trip value.
  - H: When temperature inside the inverter rises to the overheating protection alarm level.

All VF-nC1 series of inverters: About 110°C

Setting monitor mode

: The mode for setting inverter parameters.

For more on how to set parameters, see 4.1.


Status monitor mode

: The mode for monitoring all inverter status.

Allows monitoring of set frequencies, output current/voltage and terminal information.

For more on how to use the monitor, see 8.1.

Pressing the (MON) key will move the inverter through each of the modes.



## 4.1 How to set parameters

Setting monitor mode

The standard default parameters are programmed before the unit is shipped from the factory. Parameters can be divided into three major categories. Select the parameter to be changed or to be searched and retrieved.

Setup parameters

Parameters necessary for specifying a logic for control input signals and a base frequency for the motor when turning on the inverter for the first time.

This parameter setting is needed only for the VFNC1 (S)-

Basic parameters

Parameters necessary for operating the inverter.

Extended parameters

Parameters necessary for using various extended functions.

Special parameters

: Parameters necessary for using special functions. Three special parameters are included in the basic parameters of the VF-nC1.

\*1: Three special parameters

RUF: Calls up only functions necessary to meet the user's needs and, sets up the inverter.

RUH: Displays the five parameters changed last in reverse order of change. This parameter comes in very handy when readjusting inverter, using the same parameters.

£ r. £ : Displays parameters whose settings are different from the factory default settings. Use this parameter to check settings you made or you want to change.

#### ★Adjustment range of parameters

- H 1: An attempt has been made to assign a value that is higher than the programmable range. Or, as a result of changing other parameters, the programmed value of the parameter that is now selected exceeds the uoper limit.
- £ 0: An attempt has been made to assign a value that is lower than the programmable range. Or, as a result of changing other parameters, the programmed value of the parameter that is now selected exceeds the lower limit.

If the above alarm is flashing on and off, no setting can be done of values that are equal to or greater than  $\mathcal H$  or equal to or lower than  $\mathcal L$   $\mathcal G$ .

While these codes are flashing on and off, no change can be made to any parameter.

#### 4.1.1 How to set a setup parameter

Setup parameter

After you set the basic parameter  $E \not P P$  to 3 (Initialize to default setting) or the first power, the inverter will be in setup parameter mode. When the inverter is in this mode, you need to set a setup parameter, as described below, to make the inverter ready for operation.

This parameter setting is needed only for the VFNC1 (S)-

Follow these steps to change the setup parameter [Example: Changing from  $n \in \mathcal{G}$  to  $n \in \mathcal{G}$ : sink logic (negative common) and a base frequency of 60Hz]

agic (negative common) and a bace negatively of corner			
Key operated	d LED display Operation		
	n 5 0	Turn the power on.	
	n 6 0	Select a parameter among $n S \mathcal{B}$ , $P S \mathcal{B}$ and $n S \mathcal{B}$ , using the $\triangle$ and $\nabla$ keys. Select $n S \mathcal{B}$ in this case.	
ENT	In It	Press the ENTER key to confirm your change.  When In It is displayed, you can set the setup parameter.	
	0.0	The operation frequency is displayed (Standby).	

- ★You can change this parameter setting. To do so, you need to reset the basic parameter Ł Ⅎ ℙ to ∃ (default setting).
- ★You can also change the parameters in the table below individually even after setting a setup parameter.

The settings of the parameters listed below are changed by the setup parameter. When you search for \$\mathcal{U} \cdot \mathcal{L}' \text{.} y parameters, only the parameters in the shaded area will be displayed as changed parameters.

■ Values set by each setup parameter

Parameters set	n 5 0	P 5 0	n 5 O
	(Mainly in Asia)	(Mainly in Europe)	(Mainly in North America)
F 127	0 [Sink logic (negative common)]	100 (Source logic (positive common))	0 [Sink logic (negative common)]
F409/F171	220 (V)	220 (V)	230 (V)
F4 17	1410 (min <sup>-1</sup> )	1410 (min <sup>-1</sup> )	1710 (min <sup>-1</sup> )
FH,UL,F204	50.0 (Hz)	50.0 (Hz)	60.0 (Hz)
uL/F170	50.0 (Hz)	50.0 (Hz)	60.0 (Hz)

## 4.1.2 How to set the basic parameters

All of the basic parameters can be set by the same step procedures.

Basic parameters

#### [Steps in key entry for basic parameters]

MON

: Switches to the setting monitor mode.



: Selects parameter to be changed.

- ★Select a parameter you want to change from the table of parameters.
- ★If there is something that you do not understand during the operation, press the MON key to return to the fl.fl indication (or
  - operation frequency).

    ★See 11.2 for the table of basic parameters.

(ENT) : Reads the programmed parameter setting.



: Changes the parameter setting.



: Saves the changed value of the parameter setting.

Steps in setting are as follows (the example shown is one of changing the maximum frequency from 80Hz to 60Hz).

Key operated	LED display	Operation	
	0.0	Displays the operation frequency (operation stopped). (When standard monitor display selection $F$ 7 $IG = G$ is set to 0 [operation frequency]).	
MON	ЯИН	The first basic parameter "History (###)" is displayed.	
	FH	Press either the $\triangle$ key or the $\nabla$ key to select "F H".	
ENT	80.0	Pressing the ENTER key reads the maximum frequency.	
<b>(A) (V</b> )	60.0	Press the $  \nabla $ key to change the maximum frequency to 60Hz.	
ENT	60.0 ⇔ F H	Press the ENTER key to save the changed maximum frequency. F H and frequency are displayed alternately.	
After this ENT → Displays the same programmed parameter.		MON Switches to the display in the status monitor mode.	

#### 4.1.3 How to set extended parameters

The VF-nC1 has extended parameters to allow you to make full use of its functions. All extended parameters are expressed with F and three digits.





F 100~F 173 F200~F294 F300~F363 F400~F419 F500~F505 F600~F633 F700~F710

Press the MON key once and use the  $\blacktriangle$  key and the  $\blacktriangledown$  key to select "F ———" from the basic parameters.

Press the ▲ key and the ▼ key to select the parameter to be changed. Then, press the ENTER key to display the set parameter.

★See 11.3 for the table of extended parameters.

## [Steps in key entry for extended parameters]

(MON) : Switches to the setting monitor mode. (displays ₩ # #)



: Selects "F --- " from basic parameters.



: Displays the first extended parameter.



: Selects the extended parameter to be changed.



: Reads the programmed parameter setting.



: Changes the parameter setting.



: Saves the changed value of the extended parameter setting.

Pressing the MON key instead of the ENT key moves back to the previous status.

■Example of parameter setting

The steps in setting are as follows. (Example of changing the starting frequency selection

F 2 4 U HOM U.S to 1.U.)			
Key operated	LED display	Operation	
	0.0	Displays the operation frequency (operation stopped).  (When standard monitor display selection F 7 ! G=G is set to [operation frequency])	
MON	ЯИН	The first basic parameter "History (# ##)" is displayed.	
<b>●</b>	F	Press either the $\triangle$ key or the $\nabla$ key to change to the parameter group $F$ .	
ENT	F 100	Press the ENTER key to display the first extended parameter F 100.	
<b>▲ ▼</b>	F240	Press the $\triangle$ key to change to the dynamic braking selection $F \in \mathcal{H} \mathcal{G}$ .	
ENT	0.5	Pressing the ENTER key allows the reading of parameter setting.	
	1.0	Press the △ key to change the dynamic braking selection from 0.5Hz to 1.0Hz	
ENT	1.0 ⇔ F 2 4 0	Pressing the ENTER key alternately flashes on and off the parameter and changed value and allows the save of those values.	

If there is anything you do not understand during this operation, press the  $(\!\!\text{MON}\!\!)$  key several times to start over from the step of R UH display.

### 4.1.4 How to set (use) special parameters

### (1) Setting a parameter, using the wizard function $(\mathbf{A} \sqcup \mathbf{F})$

\*Wizard function (RIIF):

The wizard function refers to the special function of calling up only functions necessary to set up the inverter in response to the user's needs. When a purpose-specific wizard is selected, a group of parameters needed for the specified application (function) is formed and the inverter is switched automatically to the mode of setting the group of parameters selected. You can set up the inverter easily by simply setting the parameters in the group one after another. The wizard function (RUF) provides four purpose-specific wizards.

Title	Function	Adjustment range	Default setting
RUF	Wizard function	0:-	0
		1 : Basic setting wizard	
		2 : Preset speed operation wizard	
		3 : Analog signal operation wizard	
		4 : Motor 1/2 switching operation wizard	
		5 · Torque un wizard*	

This parameter is valid only for VFNC1 (S)-□□□□□□-W type.

■ How to use the wizard function

Here are the steps to follow to set parameters, using the wizard function. (When the basic setting wizard (BILE) is set to 1)

Key operated	LED display	Operation	
	0.0	Displays the operation frequency (operation stopped). (When standard monitor display selection F 7 10=0 is set to 0 [operation frequency]).	
MON	ЯИН	The first basic parameter "History (# ## )" is displayed.	
<b>▲ ▼</b>	RUF	Select the wizard function ( $\textit{RUF}$ ) by pressing the $ \triangle $ or $ \nabla $ key.	
ENT	0	Press the ENTER key to confirm your choice. $\vec{u}$ is displayed.	
<b>(A) (V)</b>	1	Switch to purpose-specific wizard $\mbox{\it I}$ by pressing the $\mbox{\it \triangle}$ or $\mbox{\it \nabla}$ key.	
ENT	cuaa	Press the ENTER key to confirm your choice. The first parameter in the purpose-specific wizard parameter group is displayed. (See Table below)	
<b>▲ ▼</b>	****	After moving to the purpose-specific wizard parameter group, change the setting of each parameter by pressing the $\triangle$ or $\nabla$ key and the ENTER key.	
	End	$\mathcal{E} \cap \mathcal{G}$ is dialyzed on completion of the setting of the wizard parameter group.	
(MON) (MON)	Display of parameter  ##################################	Press the MON key to exit the wizard parameter group. By pressing the MON key, you can return to the default monitoring mode (display of operation frequency).	

If there is anything you do not understand during this operation, press the (MON) key several times to start over from the step of RUH display. HERD or  $E \cap D$  is affixed respectively to the first or last parameter in each wizard parameter group.

Table of parameters that can be changed using the wizard function

Basic setting wizard	Preset-speed setting wizard	Analog input operation wizard	Motor 2 switching operation wizard	Torque UP wizard*
.00d -00d -00d -00d -00d -00d -00d -00d	COUNTY CONTROL OF THE	COOD ROC REC RM RC	FILL FILE FILE FILE FILE FILE FILE FILE	LL FYG: FYG: FY:

<sup>\*</sup> This parameter is valid only for VFNC1 (S)-

## (2) Searching for a history of changes, using the history function (AUH)

History function (用じH)

The history function automatically searches for the five parameters set or changed last and displays them in reverse order of setting or change. This parameter can also be used to set or change narameters.

#### Notes

- Parameters set or changed using the setup parameter also are included among parameters
- HER d and End are added respectively to the first and last parameters in a history of changes.

#### ■How to use the history function

Key operated	LED display	Operation
	0.0	Displays the operation frequency (operation stopped). (When standard monitor display selection $F$ ? $!G=G$ is set to 0 [operation frequency]).
MON	яин	The first basic parameter "History (# ##)" is displayed.
ENT	REE	Press the ENTER key to search for and display the next parameter set or changed last.
ENT	8.0	Press the ENTER key to display the setting of the parameter found.
	5.0	Change the setting by pressing the $\triangle$ or $\nabla$ key.
ENT	5.0⇔8€€	Press the ENTER key to confirm the new setting. The name and new setting of the parameter are displayed alternately and the setting is saved.
( <b>(</b> )	****	Similarly, press the $\triangle$ or $\nabla$ key to display the parameter you want to set or change next, and change and confirm the setting.
<b>((()</b> )	End	On completion of a search for all parameters, $\mathcal{E} \cap \mathcal{G}$ is displayed again.
(MON) (MON)	Display of parameter  # # # # # # # # # # # # # # # # # # #	To abort the search operation, press the MON key. Press the MON key once during a search to return to setting mode. Similarly, by pressing the MON key, you can go back to the status monitor mode and default monitor mode (display of operation frequency).

# (3) Searching for and changing parameters, using the user parameter group function $\mathcal{L}_{\mathit{\Gamma}}.\mathcal{U}$

User parameter group function (fire.!!):

The user parameter group function automatically searches for only parameters whose settings are different from the factory default settings, and displays them as  $\mathcal{L}_r \cdot \mathcal{U}$  parameters. This parameter can also be used to set and change parameters in  $\mathcal{L}_r \cdot \mathcal{U}$ .

#### Notes

- Parameters that have been returned to their factory default settings are not displayed as
  fire ### parameters.
- Parameters that have been set using the setup parameter are also displayed as \$\mathbb{U}\_{\sigma}\text{.}U\$ parameters.

#### ■ How to search for and change parameters

Follow the steps below to search for and change parameters.

Key operated	LED display	Operation Operation
	0.0	Displays the operation frequency (operation stopped). (When standard monitor display selection F ? ! ### is set to 0 [operation frequency]).
MON	яин	The first basic parameter "History (ℛℋн)" is displayed.
	Gr.U	Select $\mathcal{L}_{\Gamma}.\mathcal{U}$ by pressing $\triangle$ or $\nabla$ key.
ENT	U	Press the ENTER key to enter the user parameter search/ setting change mode.
ENT) or	IJF (IJr)	Parameters whose settings are different from the factory default setting are searched for and displayed. To change the parameter displayed, press the ENTER key or the $\ \triangle$
(A) (V)	REE	key. (Press the   key to make a search in the reverse direction.)
ENT	8.0	Press the ENTER key to display the setting.
<b>(A) (V)</b>	5.0	Change the setting by pressing the $\triangle$ or $\nabla$ key.
ENT	5.0⇔REE	Press the ENTER key to confirm the new setting. The name and new setting of the parameter are displayed alternately, and the setting is saved.
<b>((V</b> )	UF (Ur)	Similarly, press the $\triangle$ or $\nabla$ key to display the parameter you want to set or change next, and change and confirm the setting.
<b>((V</b> ))	Gr.U	On completion of a search for all parameters, $\mathcal{L}_{r}.\mathcal{U}$ is displayed again.
MON	Display of parameter	the MON key once during a search to return to the setting
MON	F	mode. Similarly, by pressing the MON key, you can go back to the status monitor mode and default monitor mode (display of operation frequency).

If you feel puzzled as to how to operate, press the MON key several times to go back to the step where RUH is displayed, and perform these steps all over again.

#### 4.1.5 Parameters that cannot be changed while running

For reasons of safety, the following parameters have been set up so that they cannot be reprogrammed while the inverter is running.

```
[Basic parameters]
FROW (Command mode selection)

Set FROW and FROW can be changed while the inverter is running.
                                                  F 25 1 (DC braking current (%))
F4P
       (Standard setting mode selection)
ĒΗ
                                                  F 300 (PWM carrier frequency)
        (Maximum frequency (Hz))
        (Base frequency 1 (Hz))
                                                  F 30 1 (Auto-restart control selection)
υĻ
       (V/f control mode selection)
                                                   F 3 17 2 (Regenerative power ride-though
                                                            control)
[Extended parameters]
                                                   F 3 77 5 (Over voltage limit operation)
F 189 (Analog input/logic input function
                                                   F 4 II 1 (Slip frequency gain)
        selection)
                                                   F 4 [] 9 (Base frequency voltage 1 (V))
F ! !! (Always active function selection (ST))
                                                   F 4 15 (Motor rated current)
F !!! (Input terminal selection 1 (F))
                                                   FY 15 (Motor no-load current)
F 1 12 (Input terminal selection 2 (R))
                                                   F4 17 (Motor rated speed)
F 1 13 (Input terminal selection 3 (S1))
                                                   F 4 18 (Speed control gain)
E 1 14 (Input terminal selection 4 (S2))
                                                   F 4 19 (Speed control stable coefficient)
F 1 15 (Input terminal selection 5 (VI/S3))
                                                   F F C 1 (Stall prevention level)
F 127 (Sink/Source selection)
                                                   F F ∏ ₹ (External input trip stop mode
F 1317 (Output terminal selection 1 (OUT/FM))
                                                            selection)
F 132 (Output terminal selection 3 (FL))
                                                   F 5 0 8 (Input phase failure detection
F 170 (Base frequency 2 (Hz))
                                                            mode selection)
F 17 (Base frequency voltage 2 (V))
                                                   FF27 (Under voltage trip selection)
```

## 4.1.6 Returning all parameters to standard default setting

Setting the standard default setting parameter  $\xi \ \mathcal{GP}$  to 3, all parameters can be returned to the those factory default settings.

Note: For more details on the standard default setting parameter £ 4P, see 5.3.

# Notes on operation

 We recommend that before this operation you write down on paper the values of those parameters, because when setting £ \$P\$ to 3, all parameters with changed values will be returned to standard factory default setting.

■Steps for returning	ng all parameters t	o standard default setting
Key operated	LED display	Operation
	0.0	Displays the operation frequency (perform during operation stopped).
MON	ЯИН	The first basic parameter "History (###)" is displayed.
<b>▲ ▼</b>	£ YP	Press the $\triangle$ key or the $\nabla$ key to change to $\mathcal{L}\mathcal{GP}$ .
ENT	3 0	Pressing the ENTER key displays the programmed parameters. (£ ½ P will always display zero "";" on the right, the previous setting on the left.)
<b>(A) (V)</b>	3 3	Press the △ key or the ▽ key to change the set value. To return to standard factory default setting, change to "∃".
ENT	In It	Pressing the ENTER key displays " In It" while returning all parameters to factory default setting.
	n 5 0	Turn the power on.
<b>▲ ▼</b>	n 5 O	Select a parameter among $n \in \mathcal{D}$ , $P \in \mathcal{D}$ and $n \in \mathcal{D}$ , using the $\triangle$ and $\nabla$ keys. Select $n \in \mathcal{D}$ in this case.
ENT	In IE	Press the ENTER key to confirm your change. When In It is displayed, you can set the setup parameter.
	0.0	The operation frequency is displayed (Standby).
	0.0	The operation frequency is displayed again.

If there is something that you do not understand during this operation, press the MON key several times and start over again from the step of RUH display.

## Basic parameters 5

Basic parameters refer to parameters you have to set first before using the inverter.

#### 5.1 Selecting an operation mode

## [ [ [ ] ] : Command mode selection

## F [ ] [ ] : Frequency setting mode selection

#### Function

[ [ ] [ ] d (command mode selection):

Used to select a mode of entering Run and Stop commands from the inverter (operation panel or terminal board).

EDDA (frequency setting mode selection):

Used to select a mode of entering frequency setting commands from the inverter (internal potentiometer, operation panel, terminal board, serial communications with an external control device, or internal potentiometer/terminal board switching).

#### <Command mode selection>

Title	Function	Adjustment range	Default setting	
	Command mode selection	0: Terminal block 1: Operation panel	1	

#### [Settings]

Terminal block operation

A Run or Stop command is entered by inputting an ON or OFF signal from an external control device.



A Run or Stop command is entered by pressing the key on the operation panel.

(When an optional expansion operation panel is used)

There are two kinds of functions; function of responding to signals from the device specified with the [ ] ] d parameter, and function of responding to singles from the terminal board only. External input signal Function

 $\Gamma \Pi \Pi H = 1$ Input terminal function 12 (PNL/TB: ON) Terminal board operation When the highest-priority command is entered from an external control device or a terminal block.

it takes priority over commands from the device specified with the [ ] [ ] d parameter.

#### <Franuency setting mode selection>

Title	Function	Adjustment range	Default setting
	Frequency setting mode selection	Terminal block     To Operation panel     Internal potentiometer     Serial communications (with an optional control device)     Terminal block/internal potentiometer switching	2

## [Settings]

A frequency setting command is entered by inputting a signal\* from an Terminal block external control device. (\*: VI/S3 terminal: 0~(5)10Vdc or 4~20mAdc)

Operation panel The operation frequency is set by pressing the

control device.

Input terminal function 12 (PNL/TB; OFF)



Operation panel operation

operation panel or an expansion operation panel (optional). Potentiometer The operation frequency is set using the internal potentiometer built into the

inverter. Turning the knob clockwise increases the frequency. Serial The operation frequency is set by serial communications with an optional nmunication

erminal block/ internal otentiometer

Switching between frequency setting by means of analog signals and that by means of the internal potentiometer is done by activating or deactivating the input terminals (multi-function programmable input terminals).

☆The following control input terminals are always operative, no matter how the € \( \pi \text{Q} \) d parameter (command mode selection) and the \( \xi \text{P} \text{Q} \) d parameter (frequency setting mode selection) are

- · Reset terminal (enabled only when a trip occurs.)
- Standby terminal
- · External input trip stop terminal

 $\dot{x}$ Before changing the setting of the [  $\Pi G d$  parameter (command mode selection) or the F  $\Pi G d$  parameter (frequency setting mode selection), be sure to put the inverter out of operation. (When F  $\Pi G G d$  set to 2, the settings of these parameters can be changed even during operation.)

- There are two kinds of functions: function of responding to signals from the device specified with the FRITA parameter and function of responding to signals from the terminal board only.
- When the highest-priority command is entered from an external device or a terminal board, it takes priority over commands from the device specified with the FRQ d parameter.

F N O d = 0	VI input	
FNOd=1	PNL/TB:OFF	UP and DOWN keys on operation panel
	PNL/TB:ON	VI input End: Terminal board
FNOd=2	PNL/TB:OFF	Internal potentiometer
	PNL/TB:ON	VI input End: Terminal board
F N O d = 3	PNL/TB:OFF	Serial communications
	PNL/TB:ON	VI input E∏@d: Terminal board
FN0d=4	FCHG:OFF PNL/TB:OFF	Internal potentiometer
	FCHG:ON PNL/TB:OFF	VI input
	PNL/TB:ON	VI input € ∏ ⊕ d: Terminal board

To switch between current input and voltage input, use the F 189 parameter (Analog input / logic input function selection).

## 5.2 Meter setting and adjustment

F # 15 L : FM/OUT terminal functions selection

: Meter adjustment

# F II

The FM/OUT terminal can be switched between meter output (PWM output) and open collector. When connecting a meter to the FM/OUT terminal, set the  $F\Pi 5 \downarrow$  parameter to a number other than -1 (open collector output) and connect the meter between FM/OUT (positive side) and CC (negative side).


If you want to connect a meter to the inverter, choose a full-scale 0~1mAdc ammeter or a full-scale 0~7.5Vdc-1mA voltmeter.

The meter output of VFNC1 may have some errors because of PWM waveform.


Especially if the meter output is near 0, the errors may be increased.

## ■Adjustment scale with meter adjustment F ∏ parameter

Connect meters as shown below.







☆Make the maximum ammeter scale at least 150 percent of the inverter's rated output current.

[Connected meter selection parameters]

Title	Function	Adjustment range	Default setting
FNSL	Meter selection	-1: Open collector output 0: Output frequency 1: Output current 2: Set frequency 3: For adjustment (current fixed at 100%) 4: For adjustment (current fixed at 50%) 5: For adjustment (current fixed at the max frequency) 6: For adjustment (option fixed at the max frequency)	0

#### ■ Resolution

All FM terminals have a maximum of 1/256

[Example of how to adjustment the FM terminal frequency meter]

Use the meter's adjustment screw to pre-adjust zero-point. Key operated LED display Operation Displays the operation frequency, (When standard monitor ភព.ព display selection F 7 10 is set to 0 [operation frequency]) BUH MON The first basic parameter "R!!H" is displayed. E O Press either the  $\triangle$  key or the  $\nabla$  key to select " $F \Pi$ ." Press the ENTER key to confirm your choice. A value ភ ៣.៣ ENT corresponding to the setting of F 1751 (FM/OUT terminal functions selection) is displayed. Press the △ key or the ▽ key to adjust the meter. The meter reading will change at this time but be careful because there will be no change in the inverter's digital LED (monitor) indication. 60.0 [Hint] It's easier to make the adjustment if you push and hold for several seconds. The adjustment is complete.  $F \Pi$  and the frequency are FNT  $F \cap A \Leftrightarrow F \cap A$ displayed alternately. The display returns to its original indications (displaying the 50.0 operation frequency). (When standard monitor display MON (MON selection F 7 10 is set to 0 [operation frequency].)

#### Adjusting the meter in inverter stop state

If, when adjusting the meter for output current, there are large fluctuations in data during adjustment, making adjustment difficult, the meter can be adjusted in inverter stop state. If FRSL is set to 3 for adjustment (current fixed at 100%)', the inverter puts out signals via the FM / OUT terminal, assuming that 100% of current (inverter's rated current) is flowing. In this state, adjust the meter with the FR (Meter adjustment) parameter. (FRSL: 4, 5, 6, 7 can be adjusted in the same way.)

After meter adjustment is ended, set F # 5 L to 1 (output current).

## 5.3 Standard default setting

#### E 4P : Standard setting mode selection

#### • Function

Allows setting of all parameters to the standard default setting, etc. at one time. (Except the setting of F (?))

Title	Function	Adjustment range	Default setting
£ YP	Standard setting mode selection	0:- 1: Default setting 50Hz 2: Default setting 60Hz 3: Default setting 4: Trip clear 5: Cumulative operation time clear	0

★This function will be displayed as 0 during reading on the right. This previous setting is displayed on the left. Ex [3 0]

 $\bigstar$   $\xi$   $\xi$  P cannot be set during the inverter operating. Always stop the inverter first and then program.

#### [Setting values]

## 50Hz standard setting (£ 4P = 1)

To set the following parameters for a base frequency of 50Hz, set the  $\not$   $\not$   $\not$  P parameter to 1. (This setting does not affect the settings of any other parameters.)

Maximum frequency F H : 50Hz
 Base frequency 2 F ! 7 □ : 50Hz
 VI/S3 point 2 frequency F ≥ □ Y : 50Hz

Upper limit frequency # : 50Hz
 Motor rated speed F 4 : 7 : 1410min<sup>-1</sup>

: 50Hz

Base frequency 1 , , !

## 60Hz standard setting (£ 4P=2)

To set the following parameters for a base frequency of 60Hz, set the  $\xi \ \mathcal{GP}$  parameter to 2. (This setting does not affect the settings of any other parameters.)

Maximum frequency F H
 Base frequency 2 F 170 : 60Hz
 VI/S3 point 2 frequency F 204 : 60Hz

Base frequency 1 1/2 : 60Hz

Upper limit frequency 1/2 : 60Hz

Motor rated speed F 4 1 7 : 1710min<sup>-1</sup>

## Default setting (£ 4P=3)

Setting  $\xi$   $\mathcal{GP}$  to  $\mathcal{F}$  will return all parameters to the standard values that were programmed at the factory.

☆When 3 is programmed, < [In It] will be displayed for a short time after setting and will then be erased and displayed the original indication "n 5 the "(Setup parameter). (Only for VFNC1 (S)-□□□□P□-W type) This setting clears all trip history data but it does not clear cumulative operation time data. This setting does not affect the settings of the following parameters.
</p>

FM/OUT terminal functions selection F ?? 5 L
 Meter adjustment F ??

Analog input/logic input function selection F 1₽9
 Sink/source selection F 127

Free notes F 8 8 0

See 4.1.1 for setting of setup parameters.

## Trip clear (£ 4P=4)

Setting £ 4P to 4 initializes the past four sets of recorded error history data.

\* (The parameter does not change.)

#### Cumulative operation time clear (£ 4P=5)

Setting  $\mathcal{L}$   $\mathcal{L}$  to 5 allows the initial resetting of the cumulative operation time monitor (0 [zero] time).

\* (The parameter does not change.)

ſF

see 8.1.

## 5.4 Selecting forward and reverse runs (operation panel only)

Fr : Forward/reverse selection (Operation panel)

#### Function

Program the direction of rotation when the running and stopping are made using the RUN key and STOP key on the operation panel. Valid when  $\mathcal{L}\Pi\mathcal{B}d$  (command mode) is set to 1 (operation panel).

	settir	

Title	Function	Adjustment range	Default setting
Fr	Forward/reverse selection (Operation panel)	0: Forward run 1: Reverse run	0

★Check the direction of rotation on the status monitor.

 $F_{r} - F$ : Forward run  $F_{r} - r$ : Reverse run  $\Rightarrow$  F

★When the F and R terminals are used for switching between forward and reverse rotation from the terminal board, the F<sub>F</sub> forward/reverse run selection is rendered invalid.

Short across the F-CC terminals: forward rotation

Short across the R-CC terminals: reverse rotation

 $\bigstar$ This function is valid only when  $[\Pi G G]$  is set to I (operation panel).

## 5.5 Setting acceleration/deceleration time


: Acceleration time 1 (s)

dE[ : Deceleration time 1 (s)

#### Function

- For acceleration time R [ [ , program the time that it takes for the inverter output frequency to go from 0Hz to maximum frequency F H.
- For deceleration time d E C, program the time that it takes for the inverter output frequency to go from maximum frequency F H to 0Hz.

Set acceleration time from 0Hz operation frequency to maximum frequency  $F\ H$  and deceleration time as the time when operation frequency goes from maximum frequency  $F\ H$  to 0Hz.



[Parameter setting]

Title	Function	Adjustment range	Default setting
REE	Acceleration time 1 (s)	0.1-3000 seconds	10.0
dE[	Deceleration time 1 (s)	0.1-3000 seconds	10.0


☆ If the programmed value is shorter than the optimum acceleration/deceleration time determined by load conditions, overcurrent stall or overvoltage stall function may make the acceleration/deceleration time longer than the programmed time. If an even shorter acceleration/deceleration time is programmed, there may be an overcurrent trip or overvoltage trip for inverter protection. (For further details, see 13.1).

## 5.6 Maximum frequency

F H : Maximum frequency (Hz)

#### Function

- 1) Programs the range of frequencies output by the inverter (maximum output values).
- 2) This frequency is used as the reference for acceleration/deceleration time.



- This function determines the maximum value in line with the ratings of the motor and load.

  Maximum frequency cannot be
- Maximum frequency cannot b adjusted during operation. To adjust, first stop the inverter.

★If F H is increased, adjust the upper limit frequency UL as necessary.

#### ■Parameter setting

Title	Function	Adjustment range	Default setting
FH	Maximum frequency (Hz)	30.0~200 (Hz)	*

The value is changed according to the set-up parameter condition.

(VFNC1 (S)-□□□□P□-W type)

80 [Hz] for VFNC1 (S)-□□□□P□-W type.


## 5.7 Upper limit and lower limit frequencies

: Upper limit frequency (Hz)


LL : Lower limit frequency (Hz)

#### Function

Programs the lower limit frequency that determines the lower limit of the output frequency and the upper limit frequency that determines the upper limit of that frequency.



★ Signals with a frequency higher than the frequency set with UL will not be put out.



★ The output frequency cannot be set below the frequency set with ¿ ¿ .

#### ■Parameter setting

Title	Function	Adjustment range	Default setting
UL	Upper limit frequency (Hz)	0.5∼F H (Hz)	*
LL	Lower limit frequency (Hz)	0.0~じL (Hz)	0.0

- \* The value is changed according to the set-up parameter condition.
  - (VFNC1 (S)-

80 [Hz] for VFNC1 (S)-□□□□P□-W type.


## 5.8 Base frequency

: Base frequency 1 (Hz)

#### • Function

Sets the base frequency in conformance with load specifications or the motor's rated frequency.

Note: This is an important parameter that determines the constant torque control area.



 A voltage higher than the voltage set with F Y (I) g is applied to the motor at a frequency higher than the base frequency set with u i... even if the F Y (I) g parameter is set at a voltage lower than the input voltage.

#### Parameter setting

	Title	Function	Adjustment range	Default setting
Ī	υĹ	Base frequency 1 (Hz)	25~200 (Hz)	*

When operating the inverter with  $P \vdash 3$  selected, change the setting of  $F \lor 1$  to the value printed on the rating plate, in addition to the setting of  $U \vdash 1$ .

\* The value is changed according to the set-up parameter condition. (VFNC1 (S)-□□□□P□-W type).

60 [Hz] for VFNC1 (S)-□□□□P□ type.

## 5.9 Selecting control mode

PE : V/F control mode selection

: Torque boost 1 (%)

F 40 1 : Slip frequency gain

Function
 With VF-nC1, the V/F controls shown below can be selected.

· V/F constant

Vector control

\* When torque is not produced enough at low speeds, adjust the rotational speed using the torque boost parameter. To correct the slip frequency, use the F 4 B 1 parameter (slip correction gain).

### ■Parameter setting

Title Function Adjustment range Defau	
V/F control mode 0 (1,2): V/F constant	t setting
selection 3: Sensorless vector control	0

Follow the steps below to set the P & parameter.


(Example: Setting the V/E control mode selection parameter (P F ) to 3 (Vector control))

(Example: Setting t	he V/F control mod	e selection parameter (P E ) to 3 (Vector control))
Key operated	LED display	Operation
	0.0	Displays the operation frequency (operation stopped). (When standard monitor display selection F ? !!=! is set to 0 [operation frequency]).
ENT	ЯИН	The first basic parameter "History (用じH)" is displayed.
<b>(A)</b>	PE	Switch to the control mode selection parameter ( $P \not = 1$ ) by pressing the $\triangle$ key.
ENT	0	Press the ENTER key to display the parameter setting. (Default setting: 0 (V/F))
<b>▲</b> 3		Change the setting to 3 (Vector control) by pressing the $\ \triangle$ key.
ENT	3⇔₽Ł	Press the ENTER key to save the new setting. P & and the parameter setting "3" are displayed alternately.

## 1) Constant torque characteristic

### Setting of V/F control mode selection P to [] (V/F constant)

This setting is applied to loads, such as conveyers and cranes that require the same torque as the rated torque even at low speeds.



To further increase the torque, increase the setting of the torque boost parameter (u b).

## ■Parameter setting

Title	е	Function	Adjustment range	Default setting
uЬ	Torqu	e boost 1 (%)	0.0~30.0(%)	Depends on the model.

The default torque characteristic is set based on the torque characteristic of World Energy series 4P motors manufactured by Toshiba Industrial Machinery.


When using the inverter with a VF motor or a motor with 6 or more poles, set the torque boost parameter at 80% or so of the default setting.

When the inverter is used with a special motor with a particular V/F ratio, it requires adjustments.

Excessively boosting torque could results in an overcurrent trip. To avoid this, do not increase torque by more than 1.2 times the default torque.

# 2) Correcting the error in rotational speed due to the slippage of the motor Setting of V/F control mode selection P + to 7 (Vector control)

Setting this parameter to 3 causes the inverter to monitor the load currents and automatically correct the error in speed caused by the slippage of the motor. Slip correction gain is adjusted to correct the error in speed caused by the slippage of the motor.  $\Rightarrow$  See 6.12 for details.



## 5.10 Setting the electronic thermal

IL II : Electronic thermal protection characteristics

EHr : Motor thermal protection level 1 (%)

Function

Selects the electronic thermal protection characteristics that fit with the ratings and characteristics of the motor.

#### ■Parameter setting

Title	Function		Adjus	Default setting		
				Overload protection	Overload stall	
		0		0	×	
		1	Standard	0	0	
0.0	Electronic thermal protection characteristics	2	motor	×	×	
OLN		3		×	0	0
		4		0	×	
		5	VF motor (special	0	0	
		6	motor)	×	×	
		7	motory	×	0	
Ł H r	Motor thermal protection level 1 (%)					

★ ○ : valid. × : invalid

The electronic thermal protection characteristics selection  $\partial L \Omega$  is used to enable or disable the motor overload trip function  $(\partial L \partial)$  and the overload stall function.

While the inverter overload trip ( $\Omega U$ ) will be in constant detect operation, the motor overload trip ( $\Omega U$ ) can be selected using the parameter  $\Omega U$ .

#### Explanation of terms

Overload stall: When the inverter detects an overload, this function automatically lowers the output frequency before the motor overload trip £1.2 is activated. The soft stall function allows the drive to run with balanced load current frequency without a trip. This is an optimum function for equipment such as fans, pumps and blowers with variable torque characteristics that the load current decreases as the operating speed decreases.

Note: Do not use the overload stall function with loads having constant torque characteristics (such as conveyor belts in which load current is fixed with no relation to speed).

#### [Using standard motors (other than motors intended for use with inverters)]

When a motor is used in the lower frequency range than the rated frequency, that will decrease the cooling effects for the motor. This speeds up the start of overload detection operations when a standard motor is used in order to prevent overheating.


#### ■ Setting of electronic thermal protection characteristics selection □ L □

Setting	Overload	Overload
value	protection	stall
0	0	×
1	0	0
2	×	×
3	×	0

○ : valid, × : invalid

■ Setting of motor electronic thermal protection level 1 FHr

If the capacity of the motor is smaller than the capacity of the inverter, or the rated current of the motor is smaller than the rated current of the inverter, adjust the electronic thermal protection level 1 E.H.F. so that it fits the motor's rated current.



Note: The motor overload protection start level is fixed at 30Hz.

#### [Using a VF motor (motor for use with inverter)]

■Setting selection □L Π of electronic thermal protection characteristics

value	protection	Overload stall
4	0	×
5	0	0
5	×	×
7	×	0


O : valid. X : invalid

A VF motor (motor for use with an inverter) can be used in lower frequency ranges than the general-purpose motor, but if that frequency is extremely low, the effects of cooling on the motor will deteriorate.

#### ■Setting the motor electronic thermal protection level 1 E Hr


If the capacity of the motor being used is smaller than the capacity of the inverter, or the rated current of the motor is smaller than the rated current of the inverter, adjust the electronic thermal protection level 1 £ H - so that if fits the motor's rated current.

\* If the indications are in percentages (%), then 100% equals the inverter's rated output current (A).



#### 2) Inverter over load characteristics

Set to protect the inverter unit. Cannot be changed or turned off by parameter setting. If the inverter overload trip function  $(\mathcal{Q}\mathcal{L})$  is activated frequently, this can be improved by adjusting the stall operation level  $F\mathcal{E}\mathcal{E}$  / downward or increasing the acceleration time  $\mathcal{E}\mathcal{E}$  or deceleration time  $\mathcal{E}\mathcal{E}$ .



\*To protect the inverter, overload trip may activate in a short period of time when output current reaches 150% or higher.

Inverter overload protection characteristics

## ■Motor 150%-overload time limit : F 6 0 7

Using the  $F \in \mathcal{G}$  ? parameter (motor 150%-overload withstanding time), you can set the time (between 10 and 800 seconds) elapsed before an overload trip occurs ( $\mathcal{GL}$ ?) when the motor is operated under a load of 150%

Title	Function	Adjustment range	Default setting
F607	Motor 150%-overload time limit	10~800 (sec)	300

## 5.11 Preset speed operation (speeds in 15 steps)

<u>5 r 1</u> ~ <u>5 r 7</u>: Preset speed operation frequencies 1~7 (Hz)

#### Function

A maximum of 15 speed steps can be selected just by switching an external contact signal. Multi-speed frequencies can be programmed anywhere from the lower limit frequency  $\xi$ ,  $\xi$  to the upper limit frequency U.

#### [Setting method]

#### 1) Run/stop

The starting and stopping control is done from the terminal board

Title	Function	Adjustment range	Default setting	Setting
	Command mode selection	0: Terminal board 1: Operation panel	1	0

Note: If speed commands (analog signal or digital input) are switched in line with preset speed operations, select the terminal board using the frequency setting mode selection F \( \Pi \) \( \text{d} \) \( \text{Sec} \) 3 or 5.1 \( \text{Sec} \)

#### 2) Preset speed frequency setting

Set the speed (frequency) of the number of steps necessary.

Setting from speed 1 to speed 7

Title	Function	Adjustment range	Default setting
5r 1~5r7	Preset speed operation frequencies 1~7	L L ∼UL (Hz)	0.0
Setting from speed	8 to speed 15		

Tu speca o to speca 10

Title	Function	Adjustment range	Default setting
F287~F294	Preset speed operation frequencies 8~15	L L ∼UL (Hz)	0.0

### ■Example of a frequency setting for forward 15-speed operation

Examples of preset speed contact input signals: When the input terminals are placed in sink logic mode


○ : ON — : OFF (Speed commands other than preset speed commands are valid when all are OFF)

L			Terminal		Preset speed													
Г		CC	Terrinia	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
Γ		S1	S1-CC	0	-	0	-	0	_	0	-	0	_	0	-	0	_	0
r		S2	S2-CC	_	0	0	_	_	0	0	_	_	0	0	_	_	0	0
H		VI/S3	VI/S3-CC	_	_	_	0	0	0	0	_	_	_	_	0	0	0	0
Ł		I <sub>R</sub>	R-CC	ı	_	_	_	ı	-	-	0	0	0	0	0	0	0	0

☆ Terminal functions are as follows.

★SS3 (preset speed 3) and SS4 (preset speed 4) are not assigned to any terminals at the factory. Before use, therefore, assign SS3 and SS4 to reserved terminals, using the input terminal function selection parameter. In the above example, these functions are assigned to the R and VIS3 terminals.

[Example of a connection diagram] (When the input terminals are placed in sink logic mode)




\*1: When using the VI/S3 terminal as a contact input terminal, be sure to insert a resistor\* between the P15 and VI/S3 terminals. (\* Recommended resistance: 4.7kΩ-1/4W)

#### 3) Using other speed commands with preset speed command

Comman selec	tion	О	: Terminal bo	pard	1 : Operation panel			
Frequency setting mode selection FNDd		O : Terminal board (Analog signal)	1 : Operation panel	2 : Potentiometer	O : Terminal board (Analog signal)	1 : Operation panel	2 : Potentiometer	
Entered		Preset speed command Valid Note)			Analog signal	Operation	Potentiometer	
Preset speed command	Not entered	Analog signal Valid	Operation panel Command Valid	Potentiometer Valid	Valid (The inverter does	panel Command Valid n't accept prese	Valid et speed command.)	

Note) The preset speed command is always given priority when other speed commands are input at the same time.

Below is an example of 3-step speed operation with standard default setting.



Example of 3-step speed operation

# 6. Extended parameters

Extended parameters are used for sophisticated operation, fine adjustment and other special purposes. Change parameter settings as required. See Table of extended parameters in Section 11.

## 6.1 Output signal-related parameters

### 6.1.1 Low speed signal

F 100 : Low speed signal output frequency (Hz)

F 130 : Output terminal selection 1 (FM/OUT)
F 1151 : FM/OUT terminal functions selection

F 132 : Output terminal selection 3 (FLA, FLB, FLC)

#### • Function

If the output frequency exceeds the frequency set with F:IG, an ON signal will be put out. This signal can be used as an electromagnetic brake excitation/release signal. When using a low speed signal for reversing the direction of rotation of the motor, set the

F 100 parameter (low speed signal output frequency) above 1 kHz.

- ★The low speed signal output frequency function is assigned by default to the FM/OUT terminal.
  ★Before using the FM/OUT terminal, you need to make a selection between meter (PWM)
- output and open collector output.

  To use the FM/OUT terminal as an open collector output terminal, set F # 5 ½ to -1 (open collector output).
- ★Signals can be sent to the relay output terminals FLA, FLB and FLC by changing a parameter setting.

[Parameter setting]

Title	Function	Adjustment range	Default setting
F 100	Low speed signal output frequency (Hz)	0.6∼ <i>F H</i> (Hz)	0.6

#### ■Related parameters

Title	Function	Adjustment range	Default setting
FNSL	FM/OUT terminal functions selection	1-f. Open collector output 0: Output frequency 1: Output current 2: Frequency setting 3: Adjustment (current output fixed at 100%) 4: Adjustment (current output fixed at 50%) 5: Adjustment (toutput fixed at the max frequency) 6: Adjustment (gain display)	0
F 130	Output terminal selection 1 (FM/OUT)	0~13 (See 6.2.6 for details.)	4
F 132	Output terminal selection 3 (FL)	0~13 (See 6.2.6 for details.)	10

#### Output terminal setting


The F 130 parameter (output terminal selection 1 (FM/OUT)) is set by default for low speed signal (ON signal).

To switch from ON signal to OFF signal, and vice versa, change the output terminal function setting.

(Darameter	eattingl

Title	Function	Adjustment range	Setting
F 130	Output terminal selection 1 (FM/OUT)	0~13 (See Section 11.)	4 (ON signal) or 5 (OFF signal)

To output signals to the FLA, FLB and FLC terminals, set the  $\digamma + 3$   $\digamma$  parameter.



\* FM/OUT terminal function selection (F # 5 t ): 0 (Output frequency)

#### [Connection diagram]



If using the relay with the rated voltage DC12V of operating coil, the maximum allowable voltage should be higher than 120% of rated voltage, and the maximum ampere value should not exceed 50mA.

(Operating coil resistance 250 ~ 800  $\Omega$  approx.).

## 6.1.2 Output of specified speed reach si+gnal (output of arbitrarily set frequency)

F 10 1 : Speed-reach setting frequency (Hz)

F 130 : Output terminal selection 1 (FM/OUT)
F (151) : FM/OUT terminal functions selection

F 132 : Output terminal selection 3 (FLA, FLB, FLC)

#### •Function

If the output frequency exceeds the  $\mathit{F}$  10 1-set frequency  $\pm 2.5$  Hz, an OFF signal will be put out.


- ★ The low speed signal output frequency function is assigned by default to the FM/OUT terminal.
- ★ Before using the FM/OUT terminal, you need to make a selection between meter (PWM) output and open collector output.
  To use the FM/OUT terminal as an open collector output terminal, set F ?? 5 ½ to -1 (open collector output).
- ★ Signals can be sent to the relay output terminals FLA, FLB and FLC by changing a parameter setting.

■ Parameter for specifying a frequency

Title	Function	Adjustment range	Default setting
F 10 1	Speed-reach setting frequency (Hz)	0.0∼ <i>F H</i> (Hz)	0.0

■Related parameters

Title	Function Adjustment range		Default setting
FNSL	FM/OUT terminal functions selection	Open collector output     Output frequency     Utput frequency     Cutput current     Frequency setting     Adjustment (current output fixed at 100%)     Adjustment (current output fixed at 50%)     Adjustment (output fixed at the max frequency)     Adjustment (gain display)	0
F 130	Output terminal selection 1 (FM/OUT)	0~13 (See 6.2.6 for details.)	4
F 132	Output terminal selection 3 (FL)	0~13 (See 6.2.6 for details.)	10



Note: Activate F 130 to output signals to the FM/OUT terminal, or set F 132 to 8 or 9 to output signals to the FLA. FLC and FLB terminals.

## 6.2 Parameters related to terminal function selection

## 6.2.1 Changing the function of the VI/S3 terminal

## F 109 : Analog input/logic input function selection

## Function

This parameter is used to switch the function of the VI/S3 terminal between analog signal input and contact signal input.

## ■Parameter setting

Title	Function	Adjustment range	Default setting
F 109		0: Voltage signal, 1: Current signal, 2: Contact input	0

<sup>\*</sup> To use the VI/S3 terminal as a contact input terminal in sink connection, be sure to insert an adequate resistor\* between P15 and VI/S3. (\* Recommended resistance: 4.7 kΩ-1/4W)

## 6.2.2 Keeping an input terminal function always active

## F 1 10 : Always active function selection (ST)

#### Function

This parameter allows you to select a function you want to keep always active (ON). (Only one function can be selected.)

#### ■Parameter setting

Title	Function	Adjustment range	Default setting
F 1 10	Always active function selection (ST)	0~40, 49, 54~57 (See Section 11.)	1 (ST)

#### 6.2.3 Changing the function of an input terminal

F 111 : Input terminal selection 1 (F)

F 112 : Input terminal selection 2 (R)

F 113 : Input terminal selection 3 (S1)

F 1 14 : Input terminal selection 4 (S2)

F 109 : Analog input/logic input function selection \*1

F 1 15 : Input terminal selection 5 (VI/S3)

#### Function

These parameters are used to specify a function for each individual input terminal. With these parameters allowing selection from among 45 functions for each input terminal, you can design a system with great flexibility. (For F ! 15 (input terminal selection 5), you can make a selection from among 13 functions.)

\*1 Using the F 189 parameter, you can select a function between analog input (frequency command input) and contact input for the VI/S3 terminal. The VI/S3 terminal is set by default as a voltage signal input terminal. When using the VVS3 terminal as a contact input terminal you need to set  $F \ III \ 9$  to 2 (contact input enabled), and then to specify a contact input function for it, using  $F \ I \ I \ 5$ , because it is set by default as a voltage signal input terminal.

Note: Do not set E 10.9 parameter if VI/S3 terminal is not used as contact input.

#### Setting of contact input terminal function

0	ang or contact input terminal function					
Terminal symbol	Title	Function	Adjustment range	Default setting		
-	F 109	Analog input/logic input function selection	0~2	0 (voltage input)		
_	F 1 10	Always active function selection (ST)		1 (standby)		
F	FIII	Input terminal selection 1 (F)	0~40, 49,	2 (forward run)		
R	F 1 12	Input terminal selection 2 (R)	54~57	3 (reverse run)		
S1		Input terminal selection 3 (S1)	(See	6 (preset speed 1)		
S2	F 1 14	Input terminal selection 4 (S2)	Section 11.)	7 (preset speed 2)		
The parame		is enabled only when F 109 is set to 2.		-		
VI/S3	F 1 15	Input terminal selection 5 (VI/S3)	5~17	8 (preset speed 3)		
Note 1: The	Note 4: The F 1 1 B accounts (above a setting for above a setting) allows the setting and a setting a setting and a setting a setting and a setting and a setting a setting and a setting and a setting a setting and a setting a setting and a setting and a setting and a setting a setting a setting and a setting a setting a setting and a setting a setting a setting a setting and a setting a setting a setting a setting and a setting					

Note 1: The F ! ! ! parameter (always active function selection) allows you to select a function you want to keep always active.

Note 2: The F 115 parameter (input terminal selection 5 (VI/S3)) is enabled only when F 109 is set to 2


It is necessary to insert an adequate resistor\* between P15 and VI/S3. (\*Recommended resistance : 4.7kΩ-1/4W)

#### ■Connection method






2) Connection with transistor output (Sink logic



★Operation can be controlled by connecting the input and CC (common) terminals to the output (non-contact switch) of a programmable controller. This function is used to specify forward/reverse run or preset speed operation Use a transistor that operates at 15Vdc-5mA.

Interface between inverter and programmable controller When an open collector output type programmable controller is being used for operation control, turning off the programmable controller with the inverter left ON causes a wrong signal to flow into the inverter, as shown in the figure below, because of a difference in control power potential. To avoid this, be sure to interlock the inverter and the programmable controller so that the programmable controller cannot be turned off when the inverter is on.



Sink logic/source logic input

Switching between sink logic and source logic (input terminal logic) is possible.

#### Joa run 6.2.4

• Function

The VF-nC1 inverter is capable of log operation if its input terminal selection function is so set. Jog run refers to logging or inching a motor. Input of a log run signal causes the VF-nC1 inverter to produce a jog run signal (fixed at 5Hz) for 0.1 seconds (fixed), regardless of the specified acceleration time. Cutting off a jog run signal causes the motor to coast to a stop.

■ The motor continues to run in iog mode as long as both the iog run signal and the operation signal are put out. To enable the jog run function, you need to assign the jog run function (4) to an unassigned input terminal.

For the VF-nC1 inverter, all settings for jog run are fixed, as shown below. Jogging frequency 5Hz


Jogging stop pattern Coast stop Acceleration time 0.1 sec.

<Examples of iog run> (When the iog run function is assigned to the S1 terminal: F ! ! 3=4)

S1-CC (JOG) ON + F-CC ON: Forward iog run S1-CC (JOG) ON + F-CC ON: Reverse iog run

Normal operation frequency signal input + F-CC ON: Forward run

Normal operation frequency signal input + R-CC ON: Reverse run



- The jog run terminals (S1-CC) are enabled when the operation frequency is below 5Hz. They do not function when the operation frequency is higher than the jog run frequency (5Hz).
- . The motor continues to run in jog mode while the jog run terminals (S1-CC) are electrically
- . Jog run has priority, and it continues even if any other operation command is entered during operation.

Note: During jog run, the VF-nC1 inverter may produce an Low-speed detection signal (LOW) signal but not Designated frequency reach signal (RCH) signal, and therefore PI control is not performed.

#### 6.2.5 Switching between control logics

#### F 127 : Sink/Source selection

Function

This parameter is used to switch between sink logic (negative common) and source logic (positive common).

Parameter s	etting
Title	Function

Title	Function	Adjustment range	Default setting
F 127	Sink/Source selection	Adjustable within a range of 0 to 200 0: Sink 100: Source Others: Invalid	0

The value is changed according to the set-up parameter condition. (VFNC1 (S)- PD-W type) 0 (sink) for VFNC1 (S)-

## 6.2.6 Changing the function of an output terminal

F 138 : Output terminal selection 1 (OUT/FM)

F 132 : Output terminal selection 3 (FLA, FLB, FLC)

#### • Function

These parameters are used to send various signals from the inverter to an external device. With these parameters allowing selection from among 14 functions for each output terminal, you can design a system with great flexibility.

#### ■How to use

Function of FLA, FLB, FLC: Use the  $\digamma$  132 parameter to set it.

- \*: The function of the FM/OUT terminal can be switched between meter output (PWM) and open collector output. To use the FM/OUT terminal as an open collector output terminal, set F // 5 t to -1 (open collector output).
- \*1 If using the relay with the rated voltage DC12V of operating coil, the maximum allowable voltage should be higher than 120% of rated voltage, and the maximum ampere value should not exceed 50mA.

(Operating coil resistance 250 ~ 800 Ω approx.).

Setting of output terminal functions

Terminal symbol	Title	Function	Adjustment range	Default setting	
FM/OUT	F 130	Output terminal selection 1 (FM/OUT)	0~13	4 (low speed detection signal)	
FL	F 132	Output terminal selection 3	(See Section 11.)	10 (failure FL)	

See 2.3 for details.

#### ■Related parameters

Title	Function	Adjustment range	Default setting
1 1 !! 5 !	FM/OUT terminal functions selection	-1: Open collector output 0: Output frequency 1: Output current 2: Frequency setting 3: Adjustment (current output fixed at 100%) 5: Adjustment (ourput fixed at the max frequency) 6: Adjustment (ain display)	0

## 6.3 Basic parameters 2

#### 6.3.1 Switching motor characteristics via input terminals

F 170 : Base frequency 2 (Hz)

F 171 : Base frequency voltage 2 (V)

F 172 : Torque boost 2 (%)

F 173 : Motor thermal protection level 2 (%)

#### Function

These parameters are used to switch between two different types of motors connected to the inverter or to change the

characteristic of the motor according to the use conditions or operation mode.

Note: The P \( \frac{L}{L} \) parameter (V/F control mode selection) is effective only for motor 1. If motor 2 is selected, V/F control will be selected regardless of the setting of the P \( \frac{L}{L} \) parameter (V/F control will onde selection).

#### ■Parameter setting

Title	Function	Adjustment range	Default setting
F 170	Base frequency 2 (Hz)	25~200(Hz)	*1
F 171	Base frequency voltage 2 (V)	50~500	*2
F 172	Torque boost 2 (%)	0.0~30.0(%)	Depends on the model. (See Section 11.)
F 173	Motor thermal protection level 2 (%)	30~100(%)	100

<sup>\*1. \*2.</sup> The value is changed according to the set-up parameter condition.

(VFNC1 (S)-□□□□P□-W type)

\*1 60 [Hz] for VFNC1 (S)-


\*2 200 [V] for VFNC1 (S)-□□□□P□ type.

### ■Setting of switching terminals

The function of switching from motor 1 to motor 2 is not assigned by default to any terminal. So, assign this function to an unassigned terminal if necessary.

Parameters to be switched vary depending on the function number selected with an input terminal selection parameter.

Function number of input terminal		Parameters to be used and switched		
40:MCHG	39:THR2	5:AD2		
OFF	OFF	OFF	Parameter to be used	PŁ,uL,F409,ub,ŁHr,R[[, dE[
OFF	OFF	ON	Parameter to be switched	REC→F500, dEC→F501
OFF	ON	OFF	Parameter to be switched	PE→ PE:0, uL→ F 170, F409→ F 171, ub→ F 172, EHr→ F 173
OFF	ON	ON	Parameter to be switched	PE→ PE:0,uL→ F170、 RCC→ F500,dEC→ F501, F409→ F171,ub→ F172, EHr→ F173
ON	-	-	Parameter to be switched	PE→ PE:0, uL→ F170, RCC→ F500, dEC→ F501 F409→F171, ub→ F172, EHr→ F173



## 6.4 Analog signals for frequency setting

## 6.4.1 Setting frequency command characteristics

F 109 : Analog input/logic input function selection

F201: VI/S3 reference point 1 setting (%) F202: VI/S3 point 1 frequency (Hz)
F203: VI/S3 reference point 2 setting (%) F204: VI/S3 point 2 frequency (Hz)

#### Function

By changing the setting of  $F \wr \mathbb{D} \mathcal{G}$ , the function of the Vl/S3 terminal can be switched between 0~(5)10Vdc voltage input and 4~20mAdc current input.

The  $F \wr \mathbb{D} \mathcal{G}$  is to  $F \wr \mathbb{D} \mathcal{G}$  y parameters are used to adjust the output frequency according to the

The F 2 !! I to F 2 !! I parameters are used to adjust the output frequency according to the analog signal (voltage: 0~(5)10Vdc, current: 4~20mAdc) from an external device.

#### ■Parameter setting


Title	Function	Adjustment range	Default setting					
F 109		0: Voltage signal input (0~10(5)Vdc) 1: Current signal input (0(4)~20Adc) 2: Contact input	0					
F 2 0 1	VI/S3 reference point 1 setting (%)	0~100(%)	0					
F202	VI/S3 point 1 frequency (Hz)	0.0~200.0(Hz)	0.0					
F 2 0 3	VI/S3 reference point 2 setting (%)	0~100(%)	100					
F 2 0 4	VI/S3 point 2 frequency (Hz)	0.0~200.0(Hz)	*					

Note 1: Do not specify the same value for input points 1 and 2. If you do so, the error message "Err!" will be displayed.


80 [Hz] for VFNC1 (S)-□□□□P□ type.

 <sup>\*</sup> The value is changed according to the set-up parameter condition.
 (VFNC1 (S)-□□□□P□-W type)


## 1) Adjustment of 0~10Vdc voltage input



## 2) Adjustment of 4~20mAdc current input



## 3) Adjustment of 0~5Vdc voltage input and external potentiometer (P5-VI/S3-CC)



\* When an external potentiometer is connected to the inverter via the P5V terminal, it is necessary to set the F ≥ 0 3 (= 47 ~ 50 approx.) a voltage drop might occur, depending on the resistance of the resistor connected. Therefore, if there is no need to increase the output frequency above the frequency set with F ≥ 0 4, use F ≥ 0 3 for this adjustment.

## 6.5 Operation frequency

## 6.5.1 Starting frequency


## F 2 40 : Starting frequency setting (Hz)

• Function

The frequency set with the  $F \ge 40$  parameter is put out immediately after the completion of frequency setting.

[Parameter setting]

Title	Function	Adjustment range	Default setting
F240	Starting frequency setting (Hz)	0.5~10.0(Hz)	0.5



## 6.5.2 Start/stop control by means of frequency setting signals

F241 : Operation starting frequency (Hz)


F242 : Operation starting frequency hysteresis (Hz)

Function

The start/stop of operation can be controlled, by simply using frequency setting signals.

[Parameter setting]

Title Function		Adjustment range	Default setting	
F241	Operation starting frequency (Hz)	0.0∼ <i>F H</i> (Hz)	0.0	
	Operation starting frequency hysteresis (Hz)	0.0∼ <i>F H</i> (Hz)	0.0	



## 6.6 DC braking

## 6.6.1 DC braking

F 250 : DC braking starting frequency (Hz)

F 25 1 : DC braking current (%)


F252 : DC braking time (s)

#### Function

Large braking torque can be obtained by applying a direct current to the motor. These parameters are used to set the direct current to be applied to the motor, the application time and the starting frequency.

[Parameter setting]

arameter setting,			
Title	Function	Adjustment range	Default setting
F250	DC braking starting frequency (Hz)	0.0:(OFF), 0.1∼ <i>FH</i> (Hz)	0.0
F251	DC braking current (%)	0~100(%)	50.0
F252	DC braking time (s)	0.0:(OFF) 0.1~20.0(sec)	1.0




Note: During DC braking, the overload protection sensitivity of the motor increases. To prevent tripping, the DC braking current is adjusted automatically in some cases.

## 6.7 Jump frequency - Jumping resonant frequencies

F270 : Jump frequency (Hz)

• Function

Resonance due to the natural frequency of the mechanical system operated can be avoided by jumping the resonant frequency during operation. During jumping, hysteresis characteristics with respect to the resonant frequency are given to the motor.



[Parameter setting]

Title	Function	Adjustment range	Setting
F270	Jump frequency (Hz)	L L ~ U L (Hz)	0.0
F271	Jump width (Hz)	0.0~ 30.0 (Hz)	0.0

<sup>☆</sup> Do not set jump frequencies that overlap each other.

## 6.8 Preset speed operation frequencies 8 to 15

F287 ~ F294 : Preset speed operation frequencies 8 to 15 (Hz)
See Section 5.11 for details.

## 6.9 PWM carrier frequency

## F 300 : PWM carrier frequency

## Function

 This parameter is used for changing the carrier frequency in order to change the tone of the magnetic noise produced by the motor. This parameter is also effective in preventing the motor from resonating with its load machine or fan cover.

2) In addition, this parameter is used to reduce the electromagnetic noise produced by the inverter. To reduce the electromagnetic noise, decrease the carrier frequency.

Note: This reduces the electromagnetic noise but increases the magnetic noise from the motor. 3) If the PWM carrier frequency is set above 4kHz, it may fall automatically during acceleration or under certain circumstances where an overcurrent flows.

[Parameter setting]

Title	Function	Adjustment range	Setting
F 300	PWM carrier frequency	0:2kHz   1:2kHz(random control)   2:4kHz   3:4kHz(random control)   4:8kHz (automatic reduction mode) *1   5:12kHz(automatic reduction mode) *1   6:16kHz(automatic reduction mode) *1	5

<sup>\*1</sup> Cartain models require to reduce the rated load current according to carrier frequency setting as following table.

<sup>☆</sup> During acceleration or deceleration, the jumping function is disabled for the operation frequency.

Reduction in rated load current

When the PWM carrier frequency is set above 4kHz, the rated current needs to be decreased.

VFNC1S-	Ambient		Carrier f	requency	
VFNC1-	temperature	4kHz or less	8kHz	12kHz	16kHz
2001P	50°C or less	0.7A	0.7A	0.7A	0.7A
2002P	50°C or less	1.4A	1.4A	1.4A	1.4A
2004P	40°C or less	2.4A	2.4A	2.4A	2.4A
2004P	40 to 50°C	2.4A	2.4A	2.4A	2.2A
2007P	40°C or less	4A	4A	3.6A	3A
2007	40 to 50°C	4A	3.6A	3.2A	2.8A
2015P	40°C or less	7.5A	7.5A	7.5A	7.1A
2015F	40 to 50°C	7.5A	7.5A	7.1A	6.3A
2022P	40°C or less	10.0A	9.5A	8.5A	7.5A
20221	40 to 50°C	10.0A	8.5A	7.5A	6.5A
1001P	50°C or less	0.7A	0.7A	0.7A	0.7A
1002P	50°C or less	1.4A	1.4A	1.4A	1.4A
1004P	40°C or less	2.4A	2.4A	2.4A	2.4A
	40 to 50°C	2.4A	2.4A	2.4A	2.2A
1007P	50°C or less	4A	4A	4A	4A
2002PI	40°C or less	1.2A	1.2A	1.2A	1.2A
2002FL	40 to 50°C	1.1A	1.1A	1.1A	1.1A
2004PI	40°C or less	2.3A	2.3A	2.3A	2.3A
20041 L	40 to 50°C	2.1A	2.1A	2.1A	2.1A
2007PI	40°C or less	4A	3.6A	3.2A	2.8A
2007FL	40 to 50°C	3.6A	3.2A	2.9A	2.5A
2015PL	40°C or less	7.5A	7.5A	7.5A	7.1A
2013FL	40 to 50°C	6.8A	6.8A	6.8A	6.4A
2022PL	40°C or less	10.7A	10.1A	9.1A	8A
2022FL	40 to 50°C	9.6A	9.1A	8.2A	7.2A

#### Function

Although the rated current at 4kHz is shown on the rating plate, the PWM carrier frequency is set to 12kHz by default.

Note: In order to protect the inverter, PWM carrier frequency may fall automatically depending on the circumstances even if it is under the derating in accordance with above table. If using foot-mounted type noise reduction filter EMFAS2011Z or EMFA2006Z with VF-nC1, it is necessary to decrease 5% more of rated current in above table.

## 6.10 Trip-less intensification

## 6.10.1 Auto-restart (restart during coasting)

F 30 1 : Auto-restart control selection

## **⚠** Caution

0

Stand clear of motors and mechanical equipment.

If the motor stops because of a momentary power failure, the equipment will start suddenly when the power is restored, and could cause injury.

Mandatory

To prevent accidents, attach labels warning that there is the risk of a sudden start in the event
of a power failure to all inverters, motors and machines.

#### Function


This parameter detects the rotational speed and direction of rotation of the motor during coasting in the event of a momentary power failure, and restarts the motor smoothly as soon as power is restored (motor speed search function). Also, this parameter makes it possible to switch from commercial power operation to inverter operation without stopping the motor.

During restart operation, the message "r Er Y" is displayed.

Title	Function	Adjustment range	Default setting
F301	Auto-restart control selection	O: Disabled 1: At auto-restart after momentary stop 2: When ST-CC is turned on or off 3: At auto-restart after momentary stop or when ST-CC is turned on or off when ST-CC is turned on or off	0


<sup>\*</sup> When the motor restarts in retry mode, this function will be activated regardless of the parameter setting.

## 1) Auto-restart after momentary power failure (auto-restart function)



★ F 3 0 1 set to 1 (3): This function is activated when the power is restored after the main circuits and control power supply has detected an undervoltage.

## 2) Start of motor during coasting (Motor speed search function)



<sup>\*</sup> The ST (standby signal) function is not assigned to any terminal. If necessary, assign this function to an unassigned terminal, using the multi-function programmable terminal function.

★ F 3 3 1 set to 2 (3): The auto-restart function is activated when R(ST)-CC is short-circuited after they have been opened.

#### Notes

- A waiting time between 200 and 300 msec is preset to allow the residual voltage in the motor to come down to a specified level during restart. For this reason, the start-up takes more time than usual.
- Use this function when operating a system with one inverter connected with one motor.
   This function may not be performed properly in a system with one inverter connected with multiple motors.

## Application to a crane or hoist

The crane or hoist might allow the load to move downward during the time elapsed before the motor starts after receiving an operation starting command. When applying the inverter to such a lifting gear, set the auto-restart control selection parameter to 0 (disabled) and avoid using the retry function.

## 6.10.2 Regenerative power ride-through control/slowdown stop control

## F 302 : Regenerative power ride-through control

• Function

Regenerative power ride-through control:

Function of letting the motor continue to run using its regenerative energy in the event of a momentary power failure. (Enabled if E 30.2 is set to 1 (enabled))

a momentary power failure. (Enabled if F 3 3 2 is set to 1 (enabled) Slowdown stop control:

Function of quickly stopping the motor in case a momentary power failure occurs during operation. Motor regenerative energy is used to forcibly bring the motor to a stop. (Enabled if  $\vec{F} \ni \vec{D} \vec{c}$  is set to 2 (slowdown stop))


If the motor is stopped forcibly, it remains at a standstill until the operation command is cancelled temporarily or the power is turned off.

[Parameter setting]

Title	Function	Adjustment range	Default setting
F 3 0 2	Regenerative power ride- through control	0: Disabled, 1: Enabled, 2: Slowdown stop	0

Note: Even if this parameter is set to 1 (enabled), the motor may coast to a stop under some load conditions. In that case, use this function along with the auto-restart function.

[When the power is interrupted]




- ★The time for which the operation of the motor is continued depends on the machine's inertia or load conditions. Before using this function, therefore, perform a test to determine the inertial and load conditions. ★The use of the retry function along with this function allows the
- motor to be restarted automatically without being brought to a stop.

  \*\*Regenerative power ride-through control is performed for about

  10ms (if £ 30.7 is set to 1)

[When momentary power failure occurs]



## 6.10.3 Retry function

## F 303 : Retry selection (Selecting the number of times)

## ♠ Caution

Mandatory

- Stand clear of motors and machines when the retry function is activated.

  When the retry function is enabled, the motor and machine in alarm-stop status will restart.
- suddenly after the specified time, and could cause injury.

 To prevent accidents, attach words of warning saying that the retry function is enabled to the inverter, motor and machine.

#### Function

This parameter resets the inverter automatically when the inverter gives an alarm. During the retry process, the motor search faction is activated automatically, if necessary for restarting the motor smoothly.

[Parameter settin	g]		
Title	Function	Adjustment range	Default setting
F 3 0 3	Retry selection (number of times)	0: Disabled, 1~10: 1~10 times	0

Here are typical causes of tripping and the corresponding retry processes.

Cause of tripping	Retry process	Canceling conditions
Momentary power failure Overcurrent Overvoltage Overload	Up to 10 times of retry in succession 1st retry: About 1 sec. after tripping 2nd retry: About 2 sec. after tripping 3rd retry: About 2 sec. after tripping 10th retry: About 10 sec. after tripping	The retry function will be cancelled at once if:  Tripping occurs for any reason other than momentary power failure, overcurrent, overvoltage or overload.  The motor does not restart within the specified number of times.

★The retry function is not activated if tripping is caused by one of the following:

```
• 0 C A
                                                        . 5 - - 3
           : Arm overcurrent at start-up
                                                                    : Main body RAM fault
                                                                    : Main body ROM fault
            : Overcurrent on the load side at start-up
·ĔPĤN
                                                        · Err 4
                                                                    : CPU fault
           : Output open-phase failure
                                                        · Errs
٠Ē
            : External tripping stop
                                                                    : Remote control error
. UP 1
            : Undervoltage stop
                                                                     Driver fault
            : Ground fault trip
                                                                    : EEPROM fault
```

- · EPH ! Input open-phase failure
- ★Protective operation detection relay signals (FLA, FLB and FLC terminals) are not sent during the retry process.
- ★A virtual cooling time is provided for overload tripping (@L 1, @L 2), so that the retry process is started after the virtual cooling time and retry time.
- ★In the case of overvoltage tripping (GP 1~GP3), tripping may recur unless the DC voltage falls below a predetermined level.
  ★In the case of overheating tripping (GH), tripping may recur unless the internal temperature of the
- inverter falls below a predetermined level, since the internal temperature is monitored.  $\bigstar$ Even if trip retention selection parameter (FBRZ) is set to 1. the retry function is enabled if the
- number of times of retry is set with  $F \ni D \ni$ .  $\bigstar$ During the retry process, the message " $r \not\in r \not\subseteq$ " and the item specified with the status monitor

## 6.10.4 Avoiding overvoltage tripping


## F 305 : Over voltage limit operation

selection parameter F 7 10 are displayed alternately.

## • Function

This parameter is used to keep the output frequency constant or increase the frequency to prevent overvoltage tripping due to an increase in DC voltage during deceleration or constantspeed operation. The deceleration time may be prolonged during overvoltage limit operation.

## Overvoltage limiting level



[Parameter setting]

Title	Function	Adjustment range	Default setting
F 3 0 5	Over voltage limit operation	0: Enabled, 1: Disabled, 2: Enabled (forced quick deceleration)	0

## 6.11 Performing PI control

F 360 : PI control

F 362 : Proportional (P) gain


F 3 6 3 : Integral (I) gain

#### Function

These parameters are used to perform various kinds of process control, such as keeping the air quantity, flow rate or pressure constant by inputting feedback signals (4~20mA, 0~10V) from a detector.

[	Parameter setting]			
	Title	Function	Adjustment range	Default setting
ſ	F360	PI control	0: Disabled, 1: Enabled	0
ſ	F362	Proportional (P) gain	0.01~100.0	0.30
ſ	F363	Integral (I) gain	0.01~100.0	0.20

#### 1) External connection



Feedback signal: 4~20mA, 0~10V

## 2) Types of PI control interfaces

The following combinations of process quantity data (frequency setting) and feedback data can be entered for PI control.

entered for in Control.				
Process quantity input data (frequency setting)		Feedback input data		
Setting mode	Frequency setting mode			
	FNOd	F 109:0 (voltage input)		
1 Internal potentiometer setting	2	①VI/S3 (DC: 0~10V)		
②Panel input setting	1	F ID9:1 (current input)		
③Preset speed setting	/ or ∂	②VI/S3 (DC: 4~20mA)		

Note: When the PI control function is enabled (F 3 & 2: 1), the VI/S3 terminal is used exclusively as a feedback signal input terminal.

Note: Do not set Frequency setting mode (FRBd) parameter to 0 if VI/S3 terminal is not used as contact input.

If all terminals for preset speed are off, a speed command other than the preset speed

#### 3) Setting the PI control parameter

Set the extended parameter F 3 5 0 (PI control) to 1 (enabled).

- (1) It is recommended to set the parameters R [ [ (acceleration time) and d [ [ (deceleration time) to as small values as possible.
- (2) If there is a need to limit the output frequency, set it with the parameters #L (upper limit frequency) and £ (lower limit frequency). When process quantities are set from the operation panel, their adjustment ranges are limited by the settings of #L (upper limit frequency) and £ £ (lower limit frequency).

## 4) Adjusting the PI control gain level

Adjust the PI control gain level according to the process quantity, the feedback signal and the object to be controlled.


The following parameters are provided for gain adjustment.

Parameter	Adjustment range	Default setting
F 3 6 2 (P gain)	0.01~100.0	0.30
F 3 6 3 (I gain)	0.01~100.0	0.20

## F 3 5 2 (Proportional (P) gain adjustment parameter)

This parameter is used to adjust the proportional gain level during PI control. A correction factor, which is proportional to the particular deviation (the difference between the set frequency and the feedback value), is obtained by multiplying this deviation by the parameter setting.

Increasing the  $\dot{P}$  gain increases response. However, increasing it higher than required results in an undesirable event such as hunting.



## F 3 6 3 (Integral (I) gain adjustment parameter)

This parameter is used to adjust the integral gain level during PI control. Any deviations remaining after proportional control are cleared to zero (residual deviation offset function).


Increasing the I gain increases response. However, increasing it higher than required results in an undesirable event such as hunting.



## 5) Adjusting an analog command voltage

To use feedback input (VI/S3 terminal), perform a voltage-scaling adjustment as required. See Section 6.4.1 for details.

If the feedback input value is very small, the voltage-scaling adjustment value can also be used for gain adjustment.



## 6.12 Improving torque and speed characteristics

## 6.12.1 Setting motor constants

P : V/F control mode selection

: Base frequency 1 (Hz)

F 489 : Base frequency voltage 1 (V) (rated voltage of motor)

★When setting the PŁ parameter (V/F control mode selection) to 3 (slip correction), adjust the following parameters, too.

Title	Function	Adjustment range	Default setting
υL	Base frequency 1 (Hz)	25~200 (Hz)	60
F40 I	Slip frequency gain	0~150 (%)	50
F409	Base frequency voltage 1 (V) (rated voltage of motor)	50∼500 (V)	*

<sup>\*</sup> The value is changed according to the set-up parameter condition. (VFNC1 (S)-\\_\P\=\W type) 200 IVI for VFNC1 (S)-\\_\P\=\P\= type.

F 4 (i) 1: Used to set a motor slippage correction factor. There is no need to change the factory default setting under normal conditions. However, if the motor speed fluctuaties considerably with load fluctuations increase the gain to refuge fluctuations of the motor speed.

F 409: Used to set the rated voltage of the motor. There is no need to change the factory default setting when using ordinary motors. However, when using a motor with a rated voltage and a base frequency other than 200V-50Hz, 200V-60Hz, or 220V-60Hz, enter the rated voltage of the motor printed on its rating plate, in addition to its base frequency (¿ I).

## 6.12.2 Optimizing control characteristics

Although there is no need to change the settings of the following parameters under normal conditions, control characteristics may be improved by adjusting the parameters according to the motor specifications and load characteristics.

F4 15	: Motor rated current
F4 16	: Motor no-load current
	: Motor rated speed
F4 18	: Speed control gain

F 4 19 : Speed control stable coefficient

Title	Function	Adjustment range	Default setting
F4 15	Motor rated current	0.1-50.0(A)	Depends on the model (See Section 11.)
F4 15	Motor no-load current	30-80(%)	Depends on the model (See Section 11.)
FYIT	Motor rated speed	100-12000(min <sup>-1</sup> )	*
F4 18	Speed control gain	0~100(%)	40
E4 !9	Speed control stable coefficient	0~100(%)	20

The value is changed according to the set-up parameter condition. (VFNC1 (S)-\Box P\Box Vpe) 1710 [min 1] for VFNC1 (S)-\Box P\Box Vpe.

## ★Enabled if the PL parameter (V/F control mode selection) is set to 0 (V/F)

F 4 18: Used to adjust the effective response to the frequency command.

- Increase the value to increase response.
- Decrease the value to decrease response.
- Adjust the value in increments of 10 (%) or so while checking the effective response.
- F 4 19: Used to adjust the effective response to the frequency command.

   Increase the value if overshooting or hunting occurs.
  - Increase the value if the speed reducer makes a gear noise.
  - . Increase the value if overvoltage tripping occurs on completion of deceleration.

Adjust the value in increments of 10 (%) or so while checking the effective response.

## ★Enabled if the P | parameter (V/F control mode selection) is set to 3 (slip correction)

- F 4 15: Used to set the rated current (A) of the motor. Enter the rated current printed on the motor's rating plate.
- F Y 15: Used to set the no-load current in percentage with respect to the rated current of the motor. Enter the value calculated from a motor test report value or the power factor printed on the ratino plate of the motor.
- F Y 17: Used to set the rated rotational speed (min<sup>-1</sup>) of the motor. Enter the rotating speed printed on the motor's rating plate
- E 4 18: Used to adjust the response to the frequency command.
  - Increase the value to increase response.
    - Decrease the value to decrease response.
  - Adjust the value in increments of 10 (%) or so while checking the effective response.
- F 4 19: Used to adjust the effective response to the frequency command.
  - . Increase the value if overshooting or hunting occurs.
  - . Increase the value if the speed reducer makes a gear noise.
  - Increase the value if overvoltage tripping occurs on completion of deceleration.
  - Adjust the value in increments of 10 (%) or so while checking the effective response.

## 6.13 Acceleration/deceleration patterns and acceleration/deceleration 2


### : Acceleration time 1 (s) ### : Acceleration time 2 (s) #### : Deceleration time 2 (s) #### : Deceleration time 2 (s)

F 5 0 5 : Acceleration/deceleration 1 and 2 switching frequency


Title	Function	Adjustment range	Default setting
REE	Acceleration time 1 (s)	0.1~3000(s)	10.0
d E C	Deceleration time 1 (s)	0.1~3000(s)	10.0
F500	Acceleration time 2 (s)	0.1~3000(s)	10.0
F501	Deceleration time 2 (s)	0.1~3000(s)	10.0
F505	Acceleration/deceleration 1 and 2 switching frequency	0~ <i>UL</i> (Hz)	0

## Switching between acceleration and deceleration

Changing the acceleration/deceleration time by adjusting the internal frequency (F 5 0 5)
 Changing the acceleration/deceleration time by adjusting the frequency set with F 5 0 5



## Changing the acceleration/deceleration time by adjusting the contact input signal Changing the acceleration/deceleration time, using external terminals –



 $\Rightarrow$ This switching is done when acceleration/deceleration 2 (AD2) is assigned to the R terminal (when  $F + I \neq 0$  (input terminal selection 2) is set to 5 (acceleration/deceleration 2)), using the multifunction programmable input terminal function.

In this case, set [ ] [] d to 0 (terminal block).

No signal for switching to acceleration/deceleration 2 is set by default. If necessary, assign function 5 (AD2) to an unassigned terminal, using the input terminal selection function.

## 6.14 Protection functions

## 6.14.1 Current stall setting

F 6 0 1 : Stall prevention level

#### Function

If a current exceeding the level specified with  $F \mathcal{E} \mathcal{D} I$ , the stall prevention function is activated to decrease the output frequency.

When specifying a value larger than 100 (%), set also the £ hr parameter (motor electronic thermal protection level) properly.

#### ■Parameter setting

Title	Function	Adjustment range	Default setting
F60 I	Stall prevention level	30~199 (%) 200: Invalid	150

[Message displayed along with an [] [ alarm]

If an  $\mathcal{GL}$  alarm goes off (if a current exceeding the stall prevention level), the output frequency displayed will change and the " $\mathcal{E}$ " on the left of it will blink.

Example of display : [ 5 ]

#### 6.14.2 Inverter trip retention

## F 502 : Inverter trip retention selection


#### Function

This parameter is used to prevent the tripped inverter from being restored to working order when the power is turned back on. The inverter can be restored by resetting it from the operation panel (terminal).

[Parameter setting]

Title	Function	Adjustment range	Default setting
F602	Inverter trip retention selection	0: Not retained 1: Retained	0

- ★Up to four sets of latest trip information displayed by the status monitor function can be stored in memory.
- ★When the power is turned back on, trip information (such as trip current and voltage) stored by the status monitor function will be cleared.



## 6.14.3 External input trip stop

## F 6 0 3 : External input trip stop mode selection


F 2 5 2 : DC braking time (s)

#### Function

These parameters allow you to specify a method for stopping the inverter when it receives an external trip stop signal via input terminals or an emergency stop signal from the operation panel. When the inverter shuts down, the error message  $\, \mathcal{E}^*$  is displayed on the inverter's display panel and the error FL relay (trip output) is activated. When F &  $D\!\!\!/$  3 is set to  $\mathcal{Z}$  (emergency DC braking), DC braking) time also needs to be set using F &  $\mathcal{Z}$  &  $\mathcal{Z}$ .

## 1) External trip stop by means of a terminal

External trip stop can be performed by means of the a-terminal. Perform the following steps to assign the external stop function to a terminal and to specify a stopping method.



[Parameter setting]

Title	Function	Adjustment range	Default setting
F603	External input trip stop mode selection	0: Coast stop 1: Slowdown stop 2: Emergency braking stop	0
F250	DC braking starting frequency (Hz)	0.0:OFF 0.1∼F H(Hz)	0.0
F251	DC braking current (%)	0~100(%)	50
F252	DC braking time (s)	0.0:OFF 0.1~20.0(sec)	1.0

(An example of terminal assignment) Assigning the trip stop function to the R terminal				
Title Function Adjustment range		Default setting		
F 1 12	Input terminal selection 2 (R)	0~40, 49, 54~57	11 (External trip stop)	

#### Notes:

- Emergency stop by means of the specified terminal is possible, even when operation is controlled from the operation panel.
- 2) If F 250 (DC braking starting frequency) is set to 0.0 (Hz) and F 252 (DC braking time to 0.0 (sec), the DC braking function will not be activated even if F 50 3 is set to 2 (emergency DC braking).

#### 2) Emergency stop by means of the operation panel

The emergency stop function can be controlled from the operation panel when the RUN and STOP keys on the panel are not in use for operation (when they are inoperative).

To activate the emergency stop function, press the STOP key on the operation panel twice.

①Press the STOP key ----- "E □ F F" will blink.

②Press the STOP key again — Operation will be stopped in accordance with the setting of F & D 3. At the same time, "\( \xi \) " will be displayed and a failure detection sional (FL) will be out out (FL activated).

## 6.14.4 Output phase failure detection

## F 5 7 5 : Output phase failure detection mode selection

#### Function

This parameter allows you to select a mode of detecting an output open-phase failure. If an open-phase failure persists for one second or more, the tripping function and the FL relay will be activated, and at the same time, the error message EPHD will be displayed. Set FEDS to "2" to open the motor-inverter connection by switching commercial power operation to inverter operation.

Detection errors may occur for special motors such as high-speed motors.

 $F \, \delta \, G \, S = \, \mathcal{G}$  (Disabled) No tripping (FL relay not activated)  $F \, \delta \, G \, S = \, I \, \text{(Enabled)} \qquad \qquad \text{An open-phase check is performed when operation is started for the first time after power has been turned on.} The inverter will trip if an open-phase failure persists for one second or more. (FL relay activated)$ 

Title	Function	Adjustment range	Default setting
F 6 0 5	Output open-phase failure detection mode selection	Disabled     Enabled (Checked at the first start of operation)     Enabled (Checked at each start of operation)	0

#### 6.14.5 Motor 150%-overload time limit

## F 6 0 7 : Motor 150%-overload time limit

#### Function

This parameter is used to set the time elapsed before the inverter trips when the motor is operated under a load of 150%.

	Title	Function	Adjustment range	Default setting
Ī	F607	Motor 150%-overload time limit	10~800 (sec)	300

#### 6.14.6 Input phase failure detection

## F 6 0 8 : Input phase failure detection mode selection

#### Function

This parameter allows you to select a mode of detecting an input open-phase failure. If the ripple voltage in the main circuit capacitor remains very high for a certain period of time, the inverter will trip and the FL relay will be activated. At the same time, the error message FPHI will be disolaved.

If the power capacity is far larger than the inverter capacity (by more than 200kVA and more than 10 times), a detection error may occur. If this occurs, install an AC or DC reactor.

If the motor capacity is very small as compared with the inverter capacity, no open-phase failures may be detected.

F & C 8 = C (Disabled) · · · No tripping (FL relay not activated)

F & B = ! (Enabled) · · · An open-phase check is performed during operation. The inverter trips if the ripple voltage in the main circuit capacitor remains unusually high for a certain period of time. (FL relay activated)

Title	Function	Adjustment range	Default setting
F 6 0 8	Input phase failure detection mode selection	0: Disabled, 1: Enabled	1

## 6.14.7 Over-torque alarm

F 5 15 : Over-torque alarm level

F 5 18 : Over-torque detection time

F 130 : Output terminal selection 1 (OUT/FM) (F 132: Output terminal selection 3 (FL))

## Function


An over-torque alarm signal is put out if a torque current exceeding the level set with F & 15 (over-torque alarm level) flows for a period of time longer than that set with F & 18 (over-torque detection time). To put out the signal via the FMOUT or FL terminal, this function needs to be assigned to it in advance, using the output terminal function selection parameter.

Title	Function	Adjustment range	Default setting
F 5 1 5	Over-torque alarm level	0~200(%)	150
F5 18	Over-torque detection time	0.00~10.0(sec)	0.5
F 130	Output terminal selection 1 (OUT/FM)	0~13	4
F 132	Output terminal selection 3 (FL)	0~13	10

#### <Example of operation>

1) If function 12 (OT: over-torque detection) is assigned to the FM/OUT terminal, using the output terminal selection parameter F 130

#### F 130 (FM/OUT terminal selection 1): 12 (OT: over-torque detection)



 The VF-nC1 inverter has 10% of hysteresis to prevent the occurrence of over-torque hunting. Therefore, the over-torque signal is turned off at a level lower than the setting of F5 15 by 10% (hysteresis).

## 6.14.8 Undervoltage trip

## F627 : Under voltage trip selection

## Function

This parameter is used to select the control mode activated when an undervoltage is detected. The error message "up" i" will be displayed if the inverter trips because of an undervoltage.

F & 2 ?=3: Disabled ····The inverter shuts down but not trip. (FL relay not activated) The inverter shuts down if the voltage drops below 64% of the rated voltage.

F & 2 7= 1: Enabled · · · · The inverter shuts down. It trips if the voltage drops below 64% of the rated voltage. (FL relay activated)

F 6 2 7 = 2: Disabled ···· The inverter shuts down but not trip. (FL relay not activated) The inverter shuts down if the voltage drops below 50% of the rated voltage. When setting F 6 2 7 to 1, be sure to install the input reactor of an option.

Title	Function	Adjustment range	Default setting
F627	Under voltage trip selection	Disabled     Enabled (shutdown below 64%,     FL relay activated)     Sieabled (shutdown below 50%,     FL relay not activated)	0

## 6.14.9 Analog input disconnection detection

## F633 : Analog input disconnection detection

## Function

This parameter is used to detect a break in an analog signal to the VI/S3 terminal. If an analog signal is below the level set with  $F \in 3$   $\beta$  for 0.3 seconds (approx.), the inverter will assume the signal to be broken and it will trip and display the error message " $\mathcal{E} - 18$ ." (The Analog input disconnection detection function is disabled if  $\mathcal{E} \in 3$   $\beta$  is set to 0.0%.)

Title	Function	Adjustment range	Default setting
F633	Analog input disconnection detection	0: Disabled 1~100%	0

## 6.15 Operation panel parameters

## 6.15.1 Prohibiting the change of parameter settings

## F 700 : Prohibition of change of parameter settings

#### • Function

This parameter specifies whether parameter setting is changeable or not.

#### ■Setting methods

[Parameter setting]

Title	Function	Adjustment range	Default setting
F 700	Prohibition of change parameter settings	0~7 (See the explanation below.)	

- 3: Prohibited —— Frequency can be changed from the operation panel but all other parameters are read/write-protected.

but all parameters are read/write-protected.

- 4 : Permitted —— The emergency stop function cannot be controlled from the operation panel
- and [ \( \Pi \Pi \Pi \) and \( F \Pi \Pi \) d settings cannot be changed during operation.

  5: Prohibited —— The emergency stop function cannot be controlled from the operation panel
- 5 : Permitted The emergency stop function cannot be controlled from the operation panel and [ \( \Pi \Pi \Pi \right) \) and \( F \Pi \Pi \Pi \right) \) settings also can be changed during operation.
- 7 : Prohibited The emergency stop function cannot be controlled from the operation panel, frequency can be changed on the operation panel, but any other parameters are write/read-protected.

Note: Some parameters cannot be changed during operation, no matter how F 700 is set. (See 4.1.4.)

## ■Canceling the setting

Only the setting of F 700 can be changed anytime, no matter how it is set.

## 6.15.2 Changing the unit displayed (A/V/min<sup>-1</sup>)

F 70 1 : Unit selection

F 702 : Frequency units selection

Function

These parameters are used to change the unit displayed on the display panel.

% ⇔ A (ampere)/V (volt)

Frequency 

Motor speed or load speed

## ■Parameter setting

Title	Function	Adjustment range	Default setting
F 70 I	Unit selection	0: No change 1: % → A (ampere)/V (volt) 2: Free unit selection enabled (F 7 € 2) 3: % → A (ampere)/V (volt) Free unit selection enabled (F 7 € 2)	0
F 702	Frequency units selection	0.01~200.0	1.00

Note: For the settings in the parameter list, no units can be **converted from % into A (ampere)/ V (volt)**.

Conversion from % into A (ampere)/V (volt) can be made in monitor mode only.

# ■An example of setting for changing the unit of volt/current displayed from % to A/V Set F 7 0 1 to 1 or 3.

When the VF-nC1-2007P inverter (current rating: 4.0A) is operated under the rated load (full-load).

1) Displayed in percentage
2) Displayed in amperes/volts

C 100 Output current:
4.0A

U 100 De voitage: 100%
100%
100%

 Conversion from % into A (ampere)/V (volt) can be made in status monitor mode only. For the settings in the parameter list, no units can be converted from % into A (ampere)/V (volt).

## ■An example of setting for displaying the motor or load speed

Set F 70 1 to 2 or 3.

The value obtained by multiplying the operation frequency by the value set with  $F \ 7DZ$  will be displayed, as shown below.

Value displayed = Frequency displayed or parameter-set frequency × Value set with F102

1) Displaying the rotational speed of the motor

To switch from frequency (default: 60Hz) to speed (rotational speed of the 4P motor operated: 1800 (min<sup>-1</sup>)

2) Displaying the speed of the load

To switch from frequency (default: 60Hz) to speed (speed of the conveyer operated: 6m/min<sup>-1</sup>)

**6.0.00 6.** 

Note: This parameter is designed to display the value obtained by multiplying the output frequency of the inverter by an integer. Even if the rotational speed of the motor fluctuates with load conditions, the output frequency will always be displayed.

\* Using F 70 1, the following parameters can be converted.

A display
 Display of the monitored current
 V display
 Display of the monitored voltage

Free unit
 Display of the monitored frequency

## 6.15.3 Changing the standard monitoring item

F 7 10 : Selection of monitor display selection

#### Function

This parameter is used to change the item displayed when the power is turned on.

 $\bigstar$ When the power is turned on, the operation frequency is displayed by default like this: "0.0" or "0.7FF". You can change this default monitoring item, using F 7 10. In that case, however, no prefixes (such as  $\not$  and  $\not$  1) will be displayed.

#### ■Parameter settings

Title	Function	Adjustment range	Default setting		
F710	monitor display	O: Operation frequency (Hz/free unit)     Frequency command (Hz/free unit)     Output current (%/A)	0		

## 6.16 Communication function (common serial)

C000	$\neg$	Communication baud rate	
- HIII		Communication hand rate	

F 8 0 1 : Parity

FB02 : Inverter number

FBD3 : Communication error trip time

For details, refer to the Communications Equipment User's Manual.

#### Function

The VF-nC1 series of inverters can be connected to a host computer, controller, and so on (referred to as the computer) via RS232C or RS485 conversion units, so that they can be operated on a network.

<Computer linking function>

Data is exchanged between an inverter and a computer.

(1) Monitoring the inverter's operation status (such as output frequency, current and voltage)

2Commands to the inverter (such as RUN and STOP commands)

3Reading, changing and writing inverter parameter settings

<RS232C communications>

Data is exchanged between one inverter and one computer.

<RS485C communications>

Data is exchanged between one computer and multiple inverters (a maximum of 64, or 63 for binary codes)

☆The following unit and cables are optionally available for common serial communications.

- RS232C conversion unit (Model: RS2001Z)
- Communications cable (Model: CAB0011 (1m), CAB0013 (3m), CAB0015 (5m))
- . Cable with a built-in RS232C conversion unit (Model: 20035)
- · RS485C conversion unit with a terminal board (Model: RS4001Z, RS4002Z)
- Communications cable (Model: CAB0011 (1m), CAB0013 (3m), CAB0015 (5m))

Note: Use a cable 5 m or less in length to connect an inverter and an optional common serial unit.

## ■Communications parameters (Common serial options)

The data transfer rate, parity type, inverter ID number and communication error trip time can be changed from the operation panel or the computer on the network.

Title	Function	Adjustment range	Default setting
F800	Communication baud rate	0: 1200bps 1: 2400bps 2: 4800bps 3: 9600bps 4:19200bps	3
F80 I	Parity (Common serial)	0: Non (non parity) 1: Even (even parity) 2: Odd (odd parity)	1
F802	Inverter number	0~99	0
F803	Communication error trip time	0: Disabled 1~100 (sec)	0

<sup>\*:</sup> Disabled · · · Means that the inverter will not trip even if a communication error occurs. Trip · · · · · · Means that the inverter will trip if a time-out occurs.

If a time-out occurs, the error message "Erro 5" will blink on the display panel.

## 6.16.1 Using RS232C/RS485 conversion units

#### ■Setting up the communications function


Commands (RUN/STOP commands) entered across a network have priority (over commands from the operation panel or terminal boards).

#### ■ Data transmission specifications

Item	Specifications
Data transmission scheme	Half-duplex
Connection scheme	Centralized control
Synchronization scheme	Asynchronous
Data transfer rate	Default: 9600 baud (parameter setting) Selectable from among 1200, 2400, 4800, 9600 and 19200 baud
Character	ASCII mode JIS X 0201, 8-bit (fixed, ASCII)
transmission	Binary code Binary code, 8-bit (fixed)
Stop bit length	Receive (inverter): 1bit, Send (inverter): 2 bits
Error detection	Parity: Selectable among Even, Odd and Non by parameter setting,
	Check sum method
Character	Receiving: 11-bit, Sending: 12-bit
transmission format	
Order of bit	Lower-order bits first
transmission	
Frame length	Variable to a maximum of 17 bytes


## ■Examples of connection for RS485 communications

<Example of connection>



## <Selective communications>

When an operation frequency command is sent from the host computer to No. 3 inverter



"Thrown away": On receipt of data from the host computer, only inverters with specified ID numbers perform the specified operation, while all other inverters throw the data away and move to the ready state for receivi

- \*: Use terminal boards to branch cables.
- 1) The host computer sends data to all inverters on the network.
- ②On receiving the data from the computer, each inverter checks the inverter ID number contained in it.
- ③Only the inverter with the specified ID number (No. 3 in this case) decodes the command and performs the specified operation.
- 4No. 3 inverter sends the processing results to the host computer, along with its ID number.
- ©Thus, only No. 3 inverter operates in response to the operation frequency command from the host computer.

#### 6.16.2 Free notes

## FBBD : Free notes

\_\_\_\_\_\_

## Function

This parameter allows you to specify an ID number for each inverter for management and maintenance purposes.

#### Parameter setting

Title	Function	Adjustment range	Default setting
F880	Free notes	0~65535	0

Note: Adjustment range of the above mention can set by the computer on the network.


The operation panel can set to the maximum 9999.

## 7. Variety of operation


#### 7.1 Setting the operation frequency

Applied operation can be performed by selecting the inverter frequency setting, using the basic parameter F \( \Pi \( \text{d} \) (frequency setting mode selection).

## (1) Internal potentiometer setting




(2) Operation panel key setting



F N D d: 1

Enter the number with the operation panel keys, then press the ENTER key to confirm.


(3) External potentiometer setting



F 109:0 (Input voltage signal) Use the parameters F 20 1 to F 20 4 for this


To use P5, set F 2 0 3 at 50% or so.

(4) Input voltage setting (0 to 10Vdc)



F N O d:0 F 109:0 (Input voltage signal) Use the parameters F 20 1 to F 20 4 for this setting.


(5) Input current setting (4 to 20mAdc)



F N O d:0

F 109: I (Input current signal)
Use the parameters F20 I to F204 for

this setting. Set F 2 0 1 at 20% or so. (6) Preset-speed setting




#### Frequency setting

5 c / to 5 c 7 : 1 to 7-speed run

- F287 to F294 : 8 to 15-speed run
- (1) To select 3-speed run, use the terminals S1 and S2.
- (2) To select 7-speed run, use the terminals S1 to S3 (Add S3.).
  - F 109: 2 (Contact input)
- F 1 15 : 8 (SS3)
- (3) To select 15-speed run, use the terminals S1 to S4 (Add S4.).
  - F 109: 2 (Contact input)
  - F 1 15 : B (SS3)
  - F 1 12 : 3 (SS4)


Note: When using VI/S3 as an input terminal, be sure to short-circuit P15 and VI/S3 with a resistor.

(7) Setting by means of a remote input device



F \(\Od\) d:3 (Serial communications)


(8) Setting for switching between voltage/current and internal potentiometer



F \( \text{O} \) d:\( \text{Terminal block/internal potentiometer switching} \)
F \( \text{I 3:38} \) (Frequency command forced switching)


## 7.2 Setting the operation mode

Applied operation can be performed by selecting the operation mode. To set the operation mode, use the basic parameter  $\mathcal{E} \Pi \mathcal{G} d$  (command mode selection) and the input terminal selection parameter.



[ II G d: I (Operation panel)

[ N D d:D (Terminal block)



E fill d: ! (Operation panel)
F ! ! 3: !2 (Panel/terminal board switching)
Switching from panel operation to terminal board
operation is done by inputting a panel/terminal board
switching signal.

Priority is given to the external input device when the communications function is so set.

# 8. Monitoring the operation status

## 8.1 Status monitor mode

In this mode, you can monitor the operation status of the inverter. To display the operation status during normal operation:

Press the (MON) key twice.

	Setting procedure (eg. operation at 60Hz)				
	Item displayed	Key operated	LED display	Communication No.	Description
Note 1			60.0		The operation frequency is displayed (during operation).  (When the standard monitor display selection parameter F 7 10 is set at 0 [operation frequency])
	Parameter setting mode	MON	ЯИН		The first basic parameter "History (#UH)" is displayed.
	Direction of rotation	NOM	Fr-F	FE01	The direction of rotation is displayed. (F: forward run, r: reverse run)
	Operation frequency command	$\bullet$	F 6 0.0	FE02	The operation frequency command value is displayed.
Note 2	Load current	<b>(</b>	€ 80	FE03	The inverter output current (load current) is displayed. (Default setting : unit %)
Note 3	Input voltage	lacktriangle	9 100	FE04	The inverter input (DC) voltage is displayed. (Default setting: unit %)
Note 3	Output voltage	<b>(</b>	P 100	FE05	The inverter output voltage is displayed. (Default setting: unit %)
	Torque current	<b>(</b>	c 80	FE20	The torque current is displayed in %.
	PI feedback	<b>(</b>	d 50	FE22	The PI feedback value is displayed. (Unit: frequency)
	Inverter load factor	<u>(A)</u>	L 80	FE27	The inverter load factor is displayed in %.
	Output power	( <u>A</u> )	н 80	FE30	The inverter output power is displayed in %.
	Operation frequency	( <b>A</b> )	o 6 O.O	FE00	The operation frequency is displayed.
	Input terminal	•	Я нин	FE06	The ON/OFF status of each of the control signal input terminals (F, R, S1, S2 and VI/S3) is displayed in bits.  ON: /
	Output terminal	•	0 11	FE07	The ON/OFF status of each of the control signal output terminals (FM/OUT and FL) is displayed in bits.  ON: / OFF: , Output terminal FL Output terminal FM/OUT

(Continued overleaf)

(Continued)

(Continued)						
	Item displayed	Key operated	LED display	Communication No.	Description	
	CPU1 version	<b>(</b>	u 11	FE08	The version of the CPU1 is displayed.	
	CPU2 version	<b>(</b>	uc 0 1	FE73	The version of the CPU2 is displayed.	
	Memory version	<b>(</b>	u E O 1	FE09	The version of the memory mounted is displayed.	
Note 4	Past trip 1	<b>(</b>	0E3 ⇔1	FE10	Past trip 1 (displayed alternately at 0.5-sec. intervals)	
Note 4	Past trip 2	lack	0н ⇔г	FE11	Past trip 2 (displayed alternately at 0.5-sec. intervals)	
Note 4	Past trip 3	<b>(</b>	0₽3 ⇔3	FE12	Past trip 3 (displayed alternately at 0.5-sec. intervals)	
Note 4	Past trip 4	lack	nErr ⇔4	FE13	Past trip 4 (displayed alternately at 0.5-sec. intervals)	
Note 5	Cumulative operation time	•	£ 0.0 1	FE14	The cumulative operation time is displayed. (0.01 corresponds to 1 hours.)	
	Default display mode	MON	6.0.0		The operation frequency is displayed (during operation).	

Note 1: Press the ( ) or ( ) key to change items displayed in the status monitor mode.

Note 2: With the current unit selection parameter or voltage unit selection parameter, you can choose between percentage and ampere (A) for current or between percentage and volt (V) for voltage, respectively.

Note 3: The input (DC) voltage displayed is  $1/\sqrt{2}$  times as large as the rectified d.c. input voltage.

Note 4:  $n \notin r$  is displayed to show the absence of error.

Note 5: The cumulative operation time increments only when the machine is in operation.

## 8.2 Display of trip information

If the inverter trips, an error code is displayed to suggest the cause. In the status monitor mode, all trip records are retained.

■Display of trip information

Error code	Communication No.	Description
n E r r (*)	0000	No error
0C I	0001	Overcurrent during acceleration
002	0002	Overcurrent during deceleration
003	0003	Overcurrent during operation
OCL	0004	Load-side overcurrent during start-up
0 C R	0005	Armature-side overcurrent during start-up
EPHI	0008	Input phase failure
EPHO	0009	Output phase failure
0P I	000A	Overvoltage during acceleration
0 P Z	000B	Overvoltage during deceleration
0 P 3	000C	Overvoltage during constant-speed operation
0L 1	000D	Inverter overload trip
0 L 2	000E	Motor overload trip
OH E	0010	Overheat trip
Ε	0011	Emergency stop
EEPI	0012	E2PROM fault 1
EEP2	0013	E2PROM fault 2
EEP3	0014	E2PROM fault 3
Errz	0015	Inverter RAM fault
Err3	0016	Inverter ROM fault
Erry	0017	CPU fault trip
Err5	0018	Communication error
Err7	001A	Current detector fault
UP I	001E	Undervoltage trip
EF2	0022	Ground fault
0C IP	0025	Overcurrent flowing in element during acceleration
0C2P	0026	Overcurrent flowing in element during deceleration
0 C 3 P	0027	Overcurrent flowing in element during low-speed operation
E - 18	0032	Trip caused by a break in an analog signal cable
E - 19	0033	CPU communication error
E-20	0034	Excessive torque boosted

(Note) Past trip records (trip records retained or trips that occurred in the past) can be called up. (Refer to 8.1 "Status monitor mode" for the call-up procedure.)

(\*) Strictly speaking, this code is not an error code; this code is displayed to show the absence of error when the past trip monitor mode is selected.

■Example of call-up of trip information Kev LED Communication Description displayed onerated dioplay ... Status monitor mode (The code blinks if a trip occurs.) nee Note 1 The motor coasts and comes to a stop (coast stop). Parameter setting BUH The first basic parameter "History (811.1)" is displayed mode Direction of The direction of rotation at the occurrence of a trip is displayed F - - F EE01 rotation (F : forward run, r : reverse run) Operation The operation frequency command value at the occurrence of a E 6 0.0 EE02 frequency trip is displayed. command The inverter output current at the occurrence of a trip is Load r 130 FE03 current displayed. (Default setting: unit %) The inverter input (DC) voltage at the occurrence of a trip is Innut 4 14 1 FF04 voltage displayed. (Default setting: unit %) Output The inverter output voltage at the occurrence of a trip is • P 100 FF05 voltage displayed. (Default setting: unit %) Torque • FF20 c 80 The torque current at the occurrence of a trip is displayed in %. current The PI feedback value at the occurrence of a trip is displayed. PI feedback d 50 FF22 (Unit: frequency) Inverter The inverter load factor at the occurrence of a trip is displayed • 1 100 FF27 load factor Output The output power of the inverter at the occurrence of a trip is • FF30 H 100 power displayed in %. Operation o 6 O .O FF00 The operation frequency at the occurrence of a trip is displayed. frequency The ON/OFF status of each of the control signal input terminals (F. R. S1, S2 and VI/S3) at the occurrence of a trip is displayed in bits. ON: / Input Input terminal 8 11111 FF06 OFF · terminal Input terminal VI/S3 Input terminal R Input terminal S2 Input terminal F The ON/OFF status of each of the control signal output terminals (FM/OUT and FL) at the occurrence of a trip is displayed in bits. Output FE07 Note 2 terminal ON: / OFF: , Output terminal

(Continued overleaf)

Output terminal FL

FM/OUT

(Continued)

Item	Key	LED	Communication	Description	
displayed	splayed operated display		No.	Description	
CPU1 version	·   (🔺 )   ,, , , , ,		FE08	The version of the CPU1 is displayed.	
CPU2 version	<b>(</b>	uc01	FE73	The version of the CPU2 is displayed.	
Memory version	<b>(</b>	u E O 1	FE09	The version of the memory mounted is displayed.	
Past trip 1	<b>(</b>	0P2 ⇔1	FE10	Past trip 1 (displayed alternately at 0.5-sec. intervals)	
Past trip 2	<b>(</b>	0н ⇔г	FE11	Past trip 2 (displayed alternately at 0.5-sec. intervals)	
Past trip 3	lack	0₽3 ⇔3	FE12	Past trip 3 (displayed alternately at 0.5-sec. intervals)	
Past trip 4	<b>(</b>	nErr ⇔4	FE13	Past trip 4 (displayed alternately at 0.5-sec. intervals)	
Cumulative operation time	<b>(</b>	£ 0.0 1	FE14	Cumulative operation time (0.01 corresponds to 1 hours.)	
Default display mode	MON	0P2		Status monitor mode (The LED blanks if trip occurs.)	

Note 1: Press the ( ) or ( ) key to change items displayed in the status monitor mode.

Note 2: The FL output is held OFF in case of a trip, since the operation status immediately before the occurrence of the tip is retained by the status monitor output terminal board retention function.

Note 3: Failure trip information is cleared if the power is turned off or the inverter is reset. Therefore, the operation status is displayed and all failure information except for the cause of the failure is cleared, even if the trip information retention function is activated.

# 9. Taking measures to satisfy the CE / UL / CSA

## 9.1 Compliance with CE Marking

## 9.1.1 Abstract

In Europe, EMC directive is enforced starting 1<sup>st</sup> Jan. of 1996, and Low Voltage Directive starting 1<sup>st</sup> Jan. of 1997. The display of CE mark that demonstrates that products imported to European Union conform to these directives is required. Inverter itself cannot function alone, but is de-signed as a component in order to control machines or equipment which includes that inverter installed in a cobicle. Therefore the conformance to EMC directive is not required on inverter itself. But since the object of the Low Voltage directive is equipment that is designed to be used with rated voltage of 50 to 1,000 VBC. CE should be marked on inverter as to the low Voltage directive.

But CE has to be marked on the final product installing inverters, that conforms to the EMC directive and the Low Voltage directive. And the product also may conform to Machine directive. The user that makes the final products have to take the responsibility for Marking of CE. For that reason, we recommend installation for Low Voltage directive and measurement for EMC directive, so that the products including our inverter should conform to the EMC and Low Voltage directive.

TOSHIBA carried out Approval testing and confirmation testing on representative models under the circumstances based on installation and measurement so that our products should conform to each directive. But we cannot confirm the conformance of the user's products to the EMC directive. Since EMC environment changes according to the construction of the cubicle and the relation of other installed electric equipment and the condition of wiring and installation, please confirm the conformance to the EMC directive for the final products on your side.

#### 9.1.2 EMC directive

#### An inverter itself is not an object of CE marking.

A machine which consists of an inverter and a motor is an object of CE marking.

The EMC directive includes the emission section and the immunity section. VF-NC1 can conform to EMC directive by means of installing the recommended EMI noise filter to the input side, and wiring property.

- → Emission: Emission of electromagnetic wave and electromagnetic interference
- → Immunity: Resistance to electromagnetic interference

## [EMC directive]

89/336/EEC

Table 1 Relative standard

Noise type	Test item	Standard	Applicable standards
Emission	Conducted Emission		EN55011 Group 1 class A
EIIIISSIOII	Radiated Emission		EN55011 Group 1 class A
	Electrostatic Discharge		IEC61000-4-2
	Radiated Electromagnetic field		IEC61000-4-3
	Electrical Fast Transient/Burst	EN61800-3	IEC61000-4-4
Immunity	Surge Immunity		IEC61000-4-5
	Conducted Disturbances		IEC61000-4-6
	Voltage dips, short interruptions		IEC61000-4-11
	and voltage variations		

## 9.1.3 Compliance with EMC directive

#### 9 1 3 1 The model noise filter inside

- (1) Single-phase 200V class: VFNC1S-2002PL to 2022PL
  - The above mentioned models install EMI noise filter inside. So the conducted and radiated noise can be reduced, optional EMI noise filters are not needed.
  - (The additional noise filter should be installed, when more effective reduction is required.)
- (2) The main cables such as input to the EMI filter and output of the inverter and the signal cables should be shielded, then cable length should be wired as short as possible. The main input cable should be separated from the main output cable, and cables for control signal also should be separated from main cables, not wiring parallel and not bundling, cross the wires where necessary.
- (3) Install EMI filter and inverter on the same metal back plate in an inverter panel. The metal back plate or the cubicle must be grounded absolutely, by using short thick wires, separated from the main capiles
- (4) Shielded cables should be grounded on the metal back plate in order to reduce the radiated noise from the other cables. It is an effective measure that shielded cables are grounded close to the inverter or/and coeration panel or/and EMI filter(less than 10cm).
- (5) Installation of the zero-phase and/or the ferrite core can also effectively reduce the radiated noise further.(Input or/and output of inverter)

## [Ex. Countermeasure - main circuit wiring]





Fig. 1



Strip the cable and fix it to the metal plate by means of a metal saddle for electrical work or equivalent.

## 9.1.3.2 The models without EMI filters

(1) Shingle-phase 100V class: VFNC1-1001P to 1007P
Three-phase 200V class: VFNC1-2001P to 2022P
Shingle-phase 200V class: VFNC1S-2002P to 2022P

This subsection explains what measures must be taken to satisfy the EMC directive. Insert a recommended EMI filter (Table 2) on the input side of the inverter to reduce radiation and transmission noises. In the combinations listed in Table 2, inverters were checked for conformity with the EMC directive. For inverters used in Japan, it is recommended to use the NF series of noise filters.

Table 2 lists noise filters recommended for the inverters.


Table 2 Recommended FMI filter selection


Table 2. Recommended Livil litter Scientific						
Voltage class	Inverter	Filter for class A Compliance Motor cable	Filter for class B Compliance Motor cable			
	1	length 20m or less	length 5m or less			
	VFNC1-2001P	EMFA2006Z	-			
	VFNC1-2002P	EMFA2006Z	-			
Three-phase	VFNC1-2004P	EMFA2006Z	-			
200V class	VFNC1-2007P	EMFA2006Z	-			
	VFNC1-2015P	EMFA2015Z	-			
	VFNC1-2022P	EMFA2015Z	-			
	VFNC1S-2002P	EMFAS2011Z	-			
0: 1 1	VFNC1S-2004P	EMFAS2011Z	-			
Single-phase 200V class	VFNC1S-2007P	EMFAS2011Z	-			
200V class	VFNC1S-2015P	EMFAS2025Z	-			
	VFNC1S-2022P	EMFAS2025Z	-			
	VFNC1S-1001P	EMFAS2011Z	-			
Single-phase	VFNC1S-1002P	EMFAS2011Z	-			
100V class	VFNC1S-1004P	EMFAS2011Z	-			
	VFNC1S-1007P	EMFAS2025Z	-			
Single-phase	VFNC1S-2002PL	With a built-in filter	With a built-in filter			
200V class	VFNC1S-2004PL	With a built-in filter	With a built-in filter			
(Built-in filter	VFNC1S-2007PL	With a built-in filter	With a built-in filter			
type)	VFNC1S-2015PL	With a built-in filter	With a built-in filter			
type)	VFNC1S-2022PL	With a built-in filter	With a built-in filter			

- (2) The main cables such as input to the EMI filter and output of the inverter and the signal cables should be shielded, then cable length should be wired as short as opossible. The main input cable should be separated from the main output cable, and cables for control signal also should be separated from main cables, not wiring parallel and not bundling, cross the wires where necessary.
- (3) Install EMI filter and inverter on the same metal back plate in an inverter panel. The metal back plate or the cubicle must be grounded absolutely, by using short thick wires, separated from the main cables.
- (4) Please separate input cable to EMI filter from output cable as much as possible.
- (5) Shielded cables should be grounded on the metal back plate in order to reduce the radiated noise from the other cables. It is an effective measure that shielded cables are grounded close to the inverter or/and operation panel or/and EMI filter(less than 10cm).

(6) Installation of the zero-phase and/or the ferrite core can also effectively reduce the radiated noise further. (Input or/and output of inverter)

## [Ex. Countermeasure - main circuit wiring]






ı ıg.

## [Operating with external signals]

To operate with external signals, process as following figures.



I-4

## [Accessories for countermeasure]

- Shielded cable : Showa electric Wire & Cable Co. LTD.

Type form/ CV-S, 600V or less

- Shielded cable : SUMITOMO 3M Co. Ltd. Electro-magnetic guard shielded sleeve

Type form/ DS-5,7,10,14

- EMI filter : Toshiba Schneider Inverter Corporation

Type form/ For further details, see Table2

- Ferrite core 1 : TDK Co. Ltd.

Type form/ ZCAT3035-1330

[Apply if needed]

- Grounding plate : Toshiba Schneider Inverter Corporation

Type form/ EMP001Z

- Ferrite core : NEC TOKIN Corporation Type form/ ESD-R-47D-1

- Zero-phase reactor : Soshin denki Co. Ltd.

Type form/ RC5078 or RC9129

- Radio noise filter : Soshin denki Co. Ltd.

Type form/ NF series

## 9.1.4 Low voltage directive

## Inverter itself is an object of the CE marking.

The Low Voltage Directive defines the safety of the electric equipment. VF-NC1 series conform to the Low Voltage directive based on EN50178.

Normative standard : EN50178/Electronic equipment for use in power installation

Pollution degree : 2(5.2.15.2)

Over-voltage category: 3 200V class 3.0 mm (5.2.16.1)

EN50178 provides that for electronic equipment used in power installations. The main intention is to stipulate minimum requirements for the design and manufacture of electronic equipment, for protection against electric shock, for testing and for the integration into systems for power installations.

#### 9.1.5 Compliance with Low voltage directive

Please carry out the below mentioned countermeasures for the Low Voltage Directive in case of using VF-NC1 as components of your products.

- (1) Inverter should be installed in a panel. Pay attention to wiring openings, so that it should prevent someone from touching live parts through the opening in case of maintenance.
- (2) No more than 1 cable should be connected to one earth terminal of the main terminal board. In this case, other cables for ground should be grounded on the metal back plate and/or in the cubicle. The cross-sectional area of grounding cable shall be, in any case, not less than;

Table 3. Grounding cable

Voltage class	Capacity of applicable	Inverter model	Wire size
voltage class	motor(kW)	mverter model	Grounding cable
0:!	0.1	VFNC1S-1001P	AWG 12 / 3.5 mm <sup>2</sup>
Single-phase 100V	0.2	VFNC1S-1002P	AWG 12 / 3.5 mm <sup>2</sup>
class	0.4	VFNC1S-1004P	AWG 12 / 3.5 mm <sup>2</sup>
Class	0.75	VFNC1S-1007P	AWG 12 / 3.5 mm <sup>2</sup>
	0.2	VFNC1S-2002P(L)	AWG 12 / 3.5 mm <sup>2</sup>
Single-phase	0.4	VFNC1S-2004P(L)	AWG 12 / 3.5 mm <sup>2</sup>
200V	0.75	VFNC1S-2007P(L)	AWG 12 / 3.5 mm <sup>2</sup>
class	1.5	VFNC1S-2015P(L)	AWG 12 / 3.5 mm <sup>2</sup>
	2.2	VFNC1S-2022P(L)	AWG 10 / 5.5 mm <sup>2</sup>
	0.1	VFNC1-2001P	AWG 12 / 3.5 mm <sup>2</sup>
Th	0.2	VFNC1-2002P	AWG 12 / 3.5 mm <sup>2</sup>
Three-phase 200V	0.4	VFNC1-2004P	AWG 12 / 3.5 mm <sup>2</sup>
class	0.75	VFNC1-2007P	AWG 12 / 3.5 mm <sup>2</sup>
Class	1.5	VFNC1-2015P	AWG 12 / 3.5 mm <sup>2</sup>
	2.2	VFNC1-2022P	AWG 12 / 3.5 mm <sup>2</sup>

(3) MCCB or fuse should be connected to the input side of the EMI filter.

## 9.2 Compliance with UL Standard and CSA Standard

The VF-NC1 models, that conform to the UL Standard and CSA Standard have the UL/CSA mark on the nameplate.

## 9.2.1 Compliance with Installation

The VF-NC1 inverter must be installed in a panel, and used within the ambient temperature specification.

They can be used at ambient temperature of up to 50 degrees by peeling off the label on the top of the inverter

#### 9.2.2 Compliance with Connection

Use the UL conformed cables (Rating 75 ℃ or more) with the ring terminal at wiring to the inverter input/ output terminals (R/L1, S/L2, T/L3, U/T1, V/T2, W/T3).

## 9.2.3 Compliance with Peripheral devices

Use the UL listed fuses at connecting to power supply.

Refer to the instruction manual about selecting the rating of them.

Short circuit test is performed under the condition of the power supply short-circuit currents in below.

These currents and fuse currents depend on the applicable motor capacities.

Table 4. AIC and fuse AIC Capacity of Fuse class and (Interrupting Voltage class applicable motor Inverter model currents (A) (kW) capacity) 0.1 VENC1S-1001P AIC 1000A CC/J 6 max Single-phase VFNC1S-1002P AIC 1000A CC/J 8 max 100V class 0.4 VFNC1S-1004P AIC 1000A CC/J 12 max AIC 1000A CC/J 22 max VFNC1S-1007P VFNC1S-2002P(L) AIC 1000A CC/J 4 max 0.4 VFNC1S-2004P(L) AIC 1000A CC/J 8 max Single-phase VFNC1S-2007P(L) AIC 1000A CC/J 12 max 200V class 1.5 VFNC1S-2015P(L) AIC 5000A CC/J 22 max 2.2 VFNC1S-2022P(L) AIC 5000A CC/J 30 max 0.1 VFNC1-2001P AIC 1000A CC/J 3 max AIC 1000A VFNC1-2002P CC/J 3 max AIC 1000A CC/J 5 max Three-phase 0.4 VFNC1-2004P 0.75 VFNC1-2007P AIC 1000A CC/J 8 max 200V class AIC 5000A 1.5 VFNC1-2015P CC/J 15 max AIC 5000A VFNC1-2022P CC/J 20 max

#### 9.2.4 Motor thermal protection

Selects the electronic thermal protection characteristics that fit with the ratings and characteristics of the motor. In case of multi motor operation with one inverter, thermal relay should be connected to each motor.

## 10. Peripheral devices

## ♠ Danger



. When using wiring materials and their optional devices for the inverter, they must be installed in a cabinet.

Failure to do so can lead to risk of electric shock and can result in death or serious

Be Grounded

. Connect earth cables securely. Failure to do so can lead to risk of electric shock or fire in case of a failure, short-circuit or leak current.

#### 10.1 Selection of wiring materials and devices

	Capacity of			Wire size	
Voltage class	applicable motor (kW)	Inverter model	Main circuit (See Note 1.)	DC reactor (optional)	Grounding cable
Single-	0.1	VFNC1S-1001P	AWG 14 / 2.0 mm <sup>2</sup>	-	AWG 12 / 3.5 mm <sup>2</sup>
phase	0.2	VFNC1S-1002P	AWG 14 / 2.0 mm <sup>2</sup>	-	AWG 12 / 3.5 mm <sup>2</sup>
100V	0.4	VFNC1S-1004P	AWG 14 / 2.0 mm <sup>2</sup>	-	AWG 12 / 3.5 mm <sup>2</sup>
class	0.75	VFNC1S-1007P	AWG 14 / 3.5 mm <sup>2</sup>	-	AWG 12 / 3.5 mm <sup>2</sup>
	0.2	VFNC1S-2002P(L)	AWG 14 / 2.0 mm <sup>2</sup>	AWG 16 / 1.25 mm <sup>2</sup>	AWG 12 / 3.5 mm <sup>2</sup>
Single-	0.4	VFNC1S-2004P(L)	AWG 14 / 2.0 mm <sup>2</sup>	AWG 16 / 1.25 mm <sup>2</sup>	AWG 12 / 3.5 mm <sup>2</sup>
phase 200V	0.75	VFNC1S-2007P(L)	AWG 14 / 2.0 mm <sup>2</sup>	AWG 14 / 2.0 mm <sup>2</sup>	AWG 12 / 3.5 mm <sup>2</sup>
class	1.5	VFNC1S-2015P(L)	AWG 10 / 3.5 mm <sup>2</sup>	AWG 14 / 2.0 mm <sup>2</sup>	AWG 12 / 3.5 mm <sup>2</sup>
Ciass	2.2	VFNC1S-2022P(L)	AWG 10 / 5.5 mm <sup>2</sup>	AWG 14 / 2.0 mm <sup>2</sup>	AWG 10 / 5.5 mm <sup>2</sup>
	0.1	VFNC1-2001P	AWG 14 / 2.0 mm <sup>2</sup>	AWG 16 / 1.25 mm <sup>2</sup>	AWG 12 / 3.5 mm <sup>2</sup>
Three-	0.2	VFNC1-2002P	AWG 14 / 2.0 mm <sup>2</sup>	AWG 16 / 1.25 mm <sup>2</sup>	AWG 12 / 3.5 mm <sup>2</sup>
phase	0.4	VFNC1-2004P	AWG 14 / 2.0 mm <sup>2</sup>	AWG 16 / 1.25 mm <sup>2</sup>	AWG 12 / 3.5 mm <sup>2</sup>
200V	0.75	VFNC1-2007P	AWG 14 / 2.0 mm <sup>2</sup>	AWG 14 / 2.0 mm <sup>2</sup>	AWG 12 / 3.5 mm <sup>2</sup>
class	1.5	VFNC1-2015P	AWG 10 / 2.0 mm <sup>2</sup>	AWG 14 / 2.0 mm <sup>2</sup>	AWG 12 / 3.5 mm <sup>2</sup>
	2.2	VFNC1-2022P	AWG 10 / 2.0 mm <sup>2</sup>	AWG 14 / 2.0 mm <sup>2</sup>	AWG 12 / 3.5 mm <sup>2</sup>

Note 1: Sizes of the wires connected to the input terminals R, S and T and the output terminals U, V and W when the length of each wire does not exceed 30m.

Note 2: For the control circuit, use shielded wires 0.75 mm2 or more in diameter.

Note 3: For grounding, use a cable with a size equal to or larger than the above.

Note 4: When using a crimp terminal, cover its caulked part with a tube or use an insulated terminal.

#### ■ Selection of wiring devices

			Non-fi	use circuit	breaker	(MCCB)		Magnetic	contacto	ır	Overload	relay
	Capacity of		Eartl	n leakage	breaker	(ELCB)		(M	C)		(THR	)
\/oltago	applicable		Withou	it reactor	With D	C reactor	Withou	it reactor	With DC reactor		Adjusted	
class	motor (kW)	Inverter model	Rated current (A)	Type MCCB / (ELCB) Note1)	Rated current (A)	Type MCCB / (ELCB) Note1)	Rated current (A)	Type Note1)	Rated current (A)	Type Note1)	current (A) (For reference)	Type Note1)
Single-	0.1	VFNC1S-1001P	5		-	-	9		-		0.7	LR3D056
phase	0.2	VFNC1S-1002P	10	NJ30E (NJV30E)			9	LC1D096			1.3	LR3D066
100V	0.4	VFNC1S-1004P	15				9				2.3	LR3D076
class	0.75	VFNC1S-1007P	30				18	LC1D186			3.6	LR3D086
	0.2	VFNC1S-2002P(L)	5		5	NJ30E (NJV30E)	9	LC1D096	9	LC1D096	1.3	LR3D066
Single-	0.4	VFNC1S-2004P(L)	10	NJ30E	10		9		9		2.3	LR3D076
phase 200V	0.75	VFNC1S-2007P(L)	15	(NJV30E)			9	9		3.6	LR3D086	
class	1.5	VFNC1S-2015P(L)	20	(N3V3UE)	15	(NJV3UE)	18	LC1D186	12	LC1D126	6.8	LR3D126
Class	2.2	VFNC1S-2022P(L)	30		30		25	LC1D256	18	LC1D186	9.3	LR3D146
	0.1	VFNC1-2001P	5		5		9		9		0.7	LR3D056
Three-	0.2	VFNC1-2002P	5		5		9		9		1.3	LR3D066
phase	0.4	VFNC1-2004P	5	NJ30E	5	NJ30E	9	LC1D096	9	LC1D096	2.3	LR3D076
200V	0.75	VFNC1-2007P	10	(NJV30E)	5	(NJV30E)	9		9		3.6	LR3D086
class	1.5	VFNC1-2015P	15		10		9		9		6.8	LR3D126
	2.2	VFNC1-2022P	20		15	1	12	LC1D126	12	LC1D126	9.3	LR3D146

Note 1: Produced by Toshiba Schneider Electric Ltd.

Note 2: Be sure to attach a surge killer to the exciting coil of the relay and the magnetic contactor.

Selection of surge killers for Toshiba magnetic contactors

200V class: Surge absorbing units are optionally available for Toshiba C11J to C20J

Note 3: When using the auxiliary contacts 2a of the magnetic contactor MC for the control circuit, connect the contacts 2a in parallel to increase reliability.

Of the wiring devices listed in the above table, the magnetic contactors (MC) and the overload relays (Th-Ry) are intended for use with the Mighty J series. When using the old series (ESPER Mighty series), refer to the table below showing the correspondence between the two series.

table below enewing the center			
Magnetic contact	ctor (MC)	Overload	relay
ESPER Mighty series	Mighty J series	ESPER Mighty series	Mighty J series
C12A	C13J	T11A	T13J
C20A	C20J		


#### 10.2 Installation of a magnetic contactor

If using the inverter without installing a magnetic contactor (MC) in the primary circuit, use an MCCB (with a power cutoff device) to open the primary circuit when the inverter protective circuit is activated.

#### ■ Magnetic contactor in the primary circuit

A magnetic contactor, if installed in the power supply circuit of the inverter, cuts off the power supply to the circuit and prevents the inverter from restarting, in the event of a power failure, a trip of the overload relay (thermal relay) or the activation of the inverter protective circuit.

In addition, if the FL contact of the failure detection relay in the VF-nC1 is connected to the operation circuit of the magnetic contactor on the primary side, the magnetic contactor (MC) will be tripped when the inverter protective circuit is activated.



Example of connection of a magnetic contactor in the primary circuit

#### Notes on wiring

- When frequently switching between start and stop, do not use the magnetic contactor on the primary side as no no-ff switch for the inverter. Instead, stop and start the inverter by using terminals F and CC (forward run) or R and CC (reverse run).
- Be sure to attach a surge killer to the exciting coil of the magnetic contactor (MC).

#### ■ Magnetic contactor in the secondary circuit

A magnetic contactor may be installed on the secondary side to switch controlled motors or supply commercial power to the load when the inverter is out of operation.

#### Notes on wiring

- Be sure to interlock the magnetic contactor on the secondary side with the power supply to
  prevent commercial power from being applied to the inverter output terminals.
- When installing a magnetic contactor (MC) between the inverter and the motor, avoid turning the magnetic contactor on or off during operation. Turning the magnetic contactor on or off during operation causes a current to rush into the inverter which could lead to malfunction.

#### 10.3 Installation of an overload relay

- The VF-nC1 inverter has an electronic-thermal overload protective function. In the following cases, however, the activation level of the electronic thermal protection unit must be adjusted and an overload relay suitable for the motor installed between the inverter and the motor.
  - When using a motor with a current rating different to that of the corresponding Toshiba general-purpose motor
  - When operating a single motor with an output smaller than that of the applicable standard motor or more than one motor simultaneously
- When using the VF-nC1 inverter to operate a constant-torque motor, such as the Toshiba VF
  motor, adjust the protection characteristic of the electronic thermal protection unit to the VF
  motor use
- It is recommended to use a motor with a thermal relay embedded in the motor coil to give sufficient protection to the motor, especially when it runs in a low-speed range.

# 11. Table of parameters and data

### 11.1 User parameters

Title	Function	Unit	Minimum setting unit Panel/ Communication	Adjustment range	Default setting	User setting	Reference
	Operation frequency of	Hz	0.1/0.01	L L - U L	0.0		3.1.2

### 11.2 Basic parameters

		o parametero						
Title	Communication No.	Function	Unit	Minimum setting unit Panel/ Communication	Adjustment range	Default setting	User setting	Reference
ЯШН	-	History function	-	-	Display latest 5 changed parameters as a group. * Parameters can be edited within a group.	-		4.1.3
AUF	-	Wizard function	-	-	0:- 1:Basic setting wizard 2:Preset speed operation wizard 3:Analog signal operation wizard 4:Motor 1/2 switching operation wizard 5:Torque up wizard *1	0		4.1.3
CUDA	0003	Command mode selection	-	-	0:Terminal block 1:Operation panel	1		5.1
FNOA	0004	Frequency setting mode selection	-	-	0:Terminal block 1:Operation panel 2:Internal potentiometer 3:Serial communication 4:Terminal block/internal potentiometer switchinq	2		5.1
FNSL	0005	FM/OUT terminal functions selection	-	-	1: Open collector output     0:Output frequency     1:Output current     2:Set frequency     3:For adjustment     (current fixed at     100%)     5:For adjustment     (current fixed at     50%)     5:For adjustment     (output of max.     frequency)     6:For adjustment     (display of gain)	0		5.2
FΠ	0006	Meter adjustment	-	-	-	-		5.2

	Communication			Minimum setting				Default	User	
Title	No.	Function	Unit	unit Panel/	Adjust	ment ran	ge	setting	setting	Reference
E SP	0007	Standard setting mode		Communication	0:-			0		5.3
237	0007	selection	-	-	0:- 1:Set at 5	OH-		U		5.3
		Selection			2:Set at 6					
					3:Default					
					4:Trip cle		'			
					5:Cumula					
					operation		clear			
Fr	0008	Forward/reverse	-	-	0:Forward	d run		0		5.4
		selection (Operation			1:Revers	e run				
		panel)								
REE	0009	Acceleration time 1	s	0.1/0.1	0.1-3000			10.0		5.5
336	0010	Deceleration time 1	S	0.1/0.1	0.1-3000			10.0		5.5
FH	0011	Maximum frequency	Hz	0.1/0.01	30.0-200			*2		5.6
UL	0012	Upper limit frequency	Hz	0.1/0.01	0.5- F H			*2		5.7
LL	0013	Lower limit frequency	Hz	0.1/0.01	0.0- <i>LL</i>			0.0		5.7
υĹ	0014	Base frequency 1	Hz	0.1/0.01	25-200			*2		5.8
PE	0015	V/F control mode	-	-	0 (1, 2): \			0		5.9
		selection			3: Sensor	rless v	ector			
⊢.	0040		0/	0.4/0.4	control			+0		
ub	0016	Torque boost 1	%	0.1/0.1	0.0-30.0			*3		5.9
EHr	0600	Motor thermal	%	1/1	30-100			100		5.10
nın	0017	protection level 1 Electronic thermal	-					0		5.10
ULII	0017	protection	-	-	Setting	Overload protection	Overload stall	U		5.10
		characteristic *4			囊	운항	운표			
		Characteristic 4			Se	g &	S			
					-					
					0 0	0	X			
					1 andar	0	0			
						×	X			
					3 0	$\times$	0			
					4 🛌	0	×			
					5 uotou	0	0			
					6 E	×	X			
					7 5	X	Ô			
5-1	0018	Preset speed operation	Hz	0.1/0.01	L'L - UL			0.0		5.11
3, ,	3310	frequencies 1		3 0.01	1. 0.			0.0		0.11
5-2	0019	Preset speed operation	Hz	0.1/0.01	LL-UL			0.0		1
		frequencies 2	_							
5-3	0020	Preset speed operation	Hz	0.1/0.01	LL-UL			0.0		1
		frequencies 3								
5-4	0021	Preset speed operation	Hz	0.1/0.01	LL-UL			0.0		
		frequencies 4								
5-5	0022	Preset speed operation	Hz	0.1/0.01	LL-UL			0.0		
		frequencies 5								
5-6	0023	Preset speed operation	Hz	0.1/0.01	LL-UL			0.0		
		frequencies 6						L		
5-7	0024	Preset speed operation	Hz	0.1/0.01	LL-UL			0.0		
F	ļ	frequencies 7			<b> </b>			-	-	440
	-	Extended parameter Search for changed	-	-		-		-	-	4.1.2
G r .U	_	settings	-	-		-		-	-	4.1.3
	·	ongod coording to the								

<sup>\*2:</sup> The value is changed according to the set-up parameter condition. (VFNC1 (S)-□□□□□□-W type)

FH:80, UL:80, VL:60, F127:0, F170:60, F171:200, F204:80, F409:200, F417:1710 for VFNC1 (S)-

<sup>\*3:</sup> Parameter values vary depending on the capacity. Refer to page K-8.

<sup>\*4:</sup>  $\bigcirc$  : Applicable,  $\times$  : Inapplicable

#### 11.3 Extended parameters

#### Input/output parameters

Title	Communication No.	Function	Unit	Minimum setting unit Panel/ Communication	Adjustment range	Default setting	User setting	Reference
F 100	0100	Low speed signal output frequency	Hz	0.1/0.01	0.6-F H	0.6		6.1.1
F 10 1	0101	Speed-reach setting frequency	Hz	0.1/0.01	0.0-F H	0.0		6.1.2
F 109	0109	Analog input/logic input function selection (VI/S3)	1	,	0:Voltage signal input (0-5 or 10V) 1:Current signal input (4-20mA) 2:Contact input	0		6.2.1
F 1 10	0110	Always active function selection	-	-	0~40, 49, 54~57	1 (ST)		6.2.2
FIII	0111	Input terminal selection 1 (F)	-	-	0~40, 49, 54~57	2 (F)		6.2.3
F 1 12	0112	Input terminal selection 2 (R)	1	1	0~40, 49, 54~57	3 (R)		6.2.3
F 1 13	0113	Input terminal selection 3 (S1)	,	i	0~40, 49, 54~57	6 (SS1)		6.2.3
FIIY	0114	Input terminal selection 4 (S2)	•	1	0~40, 49, 54~57	7 (SS2)		6.2.3
F 1 15	0115	Input terminal selection 5 (VI/S3)*5	•	1	5-17	8 (SS3)		6.2.3
F 127	0127	Sink/Source selection	-	-	0: Sink 100: Source 1-99,101-200: Disabled	*2		6.2.5
F 130	0130	Output terminal selection 1 (FM/OUT)*6	1	i	0-13	4 (LOW)		6.2.6
F 132	0132	Output terminal selection 3 (FL)	-	-	0-13	10 (FL)		6.2.6
F 170	0170	Base frequency 2	Hz	0.1/0.01	25-200	*2		6.3.1
FITI	0171	Base frequency voltage 2	V	1/1	50-500	*2		6.3.1
F 172	0172	Torque boost 2	%	0.1/0.1	0.0-30.0	*3		6.3.1
F 173	0173	Motor thermal protection level 2	%	1/1	30-100	100		6.3.1

<sup>\*2:</sup> The value is changed according to the set-up parameter condition. (VFNC1 (S)-□□□□□□-W type)

FH:80, UL:80, VL:60, F127:0, F170:60, F171:200, F204:80, F409:200, F417:1710 for VFNC1 (S)-

<sup>\*3:</sup> Parameter values vary depending on the capacity. Refer to page K-8.

<sup>\*5:</sup> This function is enabled if F109 is set at 2 (logic input).

<sup>\*6:</sup> This function is enabled if FMSL (open collector output) is set at 1.

• Frequency parameters

• Freq	uency pa	rameters						
Title	Communication No.	Function	Unit	Minimum setting unit Panel/ Communication	Adjustment range	Default setting	User setting	Reference
F20 I		VI/S3 reference point 1 setting	%	1/1	0-100	0		6.4.1
F202		VI/S3 point 1 frequency	Hz	0.1/0.01	0-200	0.0		6.4.1
F203		VI/S3 reference point 2 setting	%	1/1	0-100	100		6.4.1
F204		VI/S3 point 2 frequency	Hz	0.1/0.01	0-200	*2		6.4.1
F240		Starting frequency setting	Hz	0.1/0.01	0.5-10.0	0.5		6.5.1
F241		Operation starting frequency	Hz	0.1/0.01	0.0- <i>F H</i>	0.0		6.5.2
FZ4Z		Operation starting frequency hysteresis	Hz	0.1/0.01	0.0- <i>F H</i>	0.0		6.5.2
F250	0250	DC braking starting frequency	Hz	0.1/0.01	0.0- <i>F H</i>	0.0		6.6.1
F251	0251	DC braking current	%	1/1	0-100	50		6.6.1
F252	0252	DC braking time	S	0.1/0.1	0.0-20.0	1.0		6.6.1
F270	0270	Jump frequency	Hz	0.1/0.01	LL-UL	0.0		6.7
F271	0271	Jumping width	Hz	0.1/0.01	0.0-30.0	0.0		6.7
F287		Preset speed operation frequencies 8	Hz	0.1/0.01	LL-UL	0.0		
F288		Preset speed operation frequencies 9		0.1/0.01	LL-UL	0.0		
F289	0289	Preset speed operation frequencies 10	Hz	0.1/0.01	LL-UL	0.0		
F290		Preset speed operation frequencies 11	Hz	0.1/0.01	LL-UL	0.0		5.11
F291	0291	Preset speed operation frequencies 12	Hz	0.1/0.01	LL-UL	0.0		5.11
F292		Preset speed operation frequencies 13	Hz	0.1/0.01	LL-UL	0.0		
F293		Preset speed operation frequencies 14	Hz	0.1/0.01	LL-UL	0.0		
F294	0294	Preset speed operation	Hz	0.1/0.01	LL-UL	0.0		

frequencies 15

\*2: The value is changed according to the set-up parameter condition.

(VFNC1 (S)-□□□□P□-W type)

FH:80, UL:80, VL:60, F127:0, F170:60, F171:200, F204:80, F409:200, F417:1710 for VFNC1 (S)-

Operation mode parameters

		de parameters		Minimum setting unit				
Title	Communication No.	Function	Unit	Panel/ Communication	Adjustment range	Default setting	User setting	Reference
F 300	0300	PWM carrier frequency		-	0-2kHz 1:2kHz (Random mode) 2:4kHz 3:4kHz (Random mode) 4:8kHz (auto-reduction mode) 5:12kHz (auto- reduction mode) 6:16kHz (auto- reduction mode)	5		6.9
F301	0301	Auto-restart control selection	1	-	0:Disabled 1:At auto-restart after momentary stop 2:When turning ST-CC on or off 3:At auto-restart after momentary stop or when turning ST-CC on or off	0		6.10.1
F302	0302	Regenerative power ride-though control	-	-	0:Disabled 1:Enabled 2:Deceleration stop	0		6.10.2
F303	0303	Retry selection (Number of times)	Times	1/1	0(OFF),1-10	0		6.10.3
F305	0305	Over voltage limit operation	-	-	0:Disabled 1:Enabled 2:Enabled (forced shortened deceleration)	0		6.10.4
F360	0360	PI control	-	-	0: Disabled 1: Enabled	0		6.11
F362	0362	Proportional (P) gain	-	0.01/0.01	0.01-100.0	0.30		6.11
F363	0363	Integral (I) gain	-	0.01/0.01	0.01-100.0	0.20		6.11

#### Torque boost parameters

Title	Communication No.	Function	Unit	Minimum setting unit Panel/ Communication	Adjustment range	Default setting	User setting	Reference
F40 I	0401	Slip frequency gain	%	1/1	0-150	50		6.12.1
F409	0409	Base frequency	V	1/0.1	50-500	*2		6.12.1
		voltage 1						
F4 15	0415	Motor rated current	Α	0.1/0.1	0.1-50.0	*3		6.12.2
F4 15	0416	Motor no-load current	%	1/1	30-80	*3		6.12.2
F4 17	0417	Motor rated speed	min <sup>-1</sup>	1/1	100-12000	*2		6.12.2
F4 18	0418	Speed control gain	%	1/1	0-100	40		6.12.2
F4 19	0419	Speed control stable coefficient	%	1/1	0-100	20		6.12.2

<sup>\*2:</sup> The value is changed according to the set-up parameter condition.

(VFNC1 (S)-□□□□□□-W type)

FH:80, UL:80, VL:60, F127:0, F170:60, F171:200, F204:80, F409:200, F417:1710 for VFNC1 (S)-

<sup>\*3:</sup> Parameter values vary depending on the capacity. Refer to page K-8.

Acceleration/deceleration time parameters

Title	Communication No.	Function	Unit	Minimum setting unit Panel/ Communication	Adjustment range	Default setting	User setting	Reference
F500	0500	Acceleration time 2	s	0.1/0.1	0.1-3000	10.0		6.13
F50 1		Deceleration time 2	S	0.1/0.1	0.1-3000	10.0		6.13
F505		Acceleration/decelerat ion 1 and 2 switching frequency	Hz	0.1/0.01	0-U L	0.0		6.13

Prote	ection par	rameters						
Title	Communication No.	Function	Unit	Minimum setting unit Panel/ Communication	Adjustment range	Default setting	User setting	Reference
F60 I	0601	Stall prevention level	%	1/1	30-199 (%) 200 (disabled)	150		6.14.1
F602	0602	Inverter trip retention selection	1	-	0: Not retained, 1: Retained	0		6.14.2
F603	0603	External input trip stop mode selection	-	-	0:Coast stop 1:Slowdown stop 2:Emergency DC braking	0		6.14.3
F 605	0605	Output phase failure detection mode selection	-	-	0:Disabled 1:Selected (Output open-phase is checked when operation is started for the first time after power is turned on.) 2:Selected (Output open-phase is checked each time operation is started.)	0		6.14.4
F607	0607	Motor 150%-overload time limit	S	1/1	10~800	300		6.14.5
F 6 0 8	0608	Input phase failure detection mode selection	-	-	0: Disabled, 1: Enabled	1		6.14.6
F 6 1 6	0616	Over-torque alarm level	%	1	0-200	150		6.14.7
F6 18	0618	Over-torque detection time	S	0.1	0.0-10.0	0.5		6.14.7
F627	0627	Under voltage trip selection	1	-	0:Disabled 1:Enabled (64% or less: Trip, FL relay activated) 2:Disabled (50% or less: Trip, FL relay not activated)	0		6.14.8
F633	0633	Analog input disconnection detection	%	1	0 (Disabled), 1 - 100%	0		6.14.9

Operation panel parameters

		ici parameters		Minimum setting				
Title	Communication No.	Function	Unit	unit Panel/ Communication	Adjustment range	Default setting	User setting	Reference
F100	0700	Prohibition of change parameter settings	-	-	0:Permitted (C ND d. FND d cannot be changed during operation.) 1:Prohibited 2:Permitted (C ND d. FND d also can be changed during operation) 3:Prohibited (except for panel frequency setting.) 4:0 + panel emergency stop prohibited 5:1 + panel emergency stop prohibited 6:2 + panel emergency stop prohibited 7:3 + panel emergency stop prohibited 7:3 + panel emergency stop prohibited	0		6.15.1
F70I	0701	Unit selection	1	-	0:0%, Hz (no change) 1:% to A/V 2:Free unit selection enabled (F 782) 3:% to A/V, Free unit selection enabled (F 782)	0		6.15.2
F 702	0702	Frequency units selection	-	0.01/0.01	0.01-200.0	1.00		6.15.2
F 1 10	0710	Selection of monitor display selection	1	-	0:Operation frequency (Hz/free unit) 1:Frequency command (Hz/free unit) 2:Output current (%/A)	0		6.15.3

#### Communication parameters

• Com	mumcan	ni parameters						
Title	Communication No.	Function	Unit	Minimum setting unit Panel/ Communication	Adjustment range	Default setting	User setting	Reference
F800		Communication baud rate	-	-	0:1200bps 1:2400bps 2:4800bps 3:9600bps 4:19200bps	3		6.16
F80 I		Parity	-	-	0:NON (non-parity) 1:EVEN (even parity) 2:ODD (odd parity)	1		6.16
F802	0802	Inverter number	-	1	0-99	0		6.16
F803	0803	Communication error trip time	S	1/1	0 (Disabled), 1 - 100 (s)	0		6.16
F880	0880	Free notes	-	1	0~65535 *	0		6.16

<sup>\*</sup> Adjustment range of the above mention can set by the computer on the network.

The operation panel can set to the maximum 9999.

· Factory setting parameter

	Title	Communication No.	Function	Unit	Minimum setting unit Panel/ Communication	Adjustment range	Default setting	User setting	Reference
٠	5000	naan	For factory setting	_	_	_	٥		_

<sup>\*</sup>This function is effective after software version V110.

## ■ Default settings by inverter rating

Inverter model	Torque boost	Motor rated	No-load
		current	current
	ub/F172	F4 15	F4 16
VFNC1S-1001P	8.5	0.6A	70%
VFNC1S-1002P	8.3	1.2A	70%
VFNC1S-1004P	6.2	2.0A	63%
VFNC1S-1007P	5.8	3.4A	59%
VFNC1S-2002P	8.3	1.2A	70%
VFNC1S-2004P	6.2	2.0A	63%
VFNC1S-2007P	5.8	3.4A	59%
VFNC1S-2015P	4.6	6.2A	52%
VFNC1S-2022P	4.4	8.9A	49%
VFNC1-2001P	8.5	0.6A	70%
VFNC1-2002P	8.3	1.2A	70%
VFNC1-2004P	6.2	2.0A	63%
VFNC1-2007P	5.8	3.4A	59%
VFNC1-2015P	4.6	6.2A	52%
VFNC1-2022P	4.4	8.9A	49%
VFNC1S-2002PL	8.3	1.2A	70%
VFNC1S-2004PL	6.2	2.0A	63%
VFNC1S-2007PL	5.8	3.4A	59%
VFNC1S-2015PL	4.6	6.2A	52%
VFNC1S-2022PL	4.4	8.9A	49%

Function

### ■Table of input terminal functions 1

1 OFF F
II OFF F
ndby, OFF: Free run
ward run,
celeration stop
verse run,
celeration stop (priority to
erse run)
run, OFF: Canceled
celeration/deceleration 2,
celeration/deceleration 1
of preset speeds (up to 15
using 4 bits: SS1 to SS4
F: Trip reset
Trip stop
ced switching from operation
nel/internal potentiometer to
minal board control
braking
control prohibited
control permitted
tion of parameters permitted,
tion of parameter prohibited (If
00 is so set)
nultaneous input of ST and RST
nmands
nultaneous input of ST and
L/TB commands
nultaneous input of F and JOG
nmands
nultaneous input of R and JOG nmands
nultaneous input of F and AD2
nmands
nultaneous input of R and AD2
nmands
nultaneous input of F and SS1
nmands
nultaneous input of R and SS1
nmands
nultaneous input of F and SS2
nmands
nultaneous input of R and SS2
nmands
nultaneous input of F and SS3
nmands
nultaneous input of R and SS3
nmands
nultaneous input of F and SS4
nmands

## ■Table of input terminal functions 2

Function No.	Code	Function	Action
29	R+SS4	Combination of reverse run and preset speed command 4	ON : Simultaneous input of R and SS4 commands
30	F+SS1+AD2	Combination of forward run, preset speed command 1 and acceleration/deceleration 2	ON :Simultaneous input of F, SS1 and AD2 commands
31	R+SS1+AD2	Combination of reverse run, preset speed command 1 and acceleration/deceleration 2	ON :Simultaneous input of R, SS1 and AD2 commands
32	F+SS2+AD2	Combination of forward run, preset speed command 2 and acceleration/deceleration 2	ON : Simultaneous input of F, SS2 and AD2 commands
33	R+SS2+AD2	Combination of reverse run, preset speed command 2 and acceleration/deceleration 2	ON :Simultaneous input of R, SS2 and AD2 commands
34	F+SS3+AD2	Combination of forward run, preset speed command 3 and acceleration/deceleration 2	ON :Simultaneous input of F, SS3 and AD2 commands
35	R+SS3+AD2	Combination of reverse run, preset speed command 3 and acceleration/deceleration 2	ON :Simultaneous input of R, SS3 and AD2 commands
36	F+SS4+AD2	Combination of forward run, preset speed command 4 and acceleration/deceleration 2	ON : Simultaneous input of F, SS4 and AD2 commands
37	R+SS4+AD2	Combination of reverse run, preset speed command 4 and acceleration/deceleration 2	ON : Simultaneous input of R, SS4 and AD2 commands
38	FCHG	Frequency command forced switching	Enabled if F \( \text{if } \text{if } \text{d} = 4 \) (selectable between terminal board and operation panel/internal potentiometer)  ON: VI terminal  OFF: Internal potentiometer
39	THR2	No.2 thermal switching	ON: No.2 thermal (P Ł: 0, F 170, F 171, F 172, F 173) OFF: No.1 thermal (P Ł: Setting, u Ł, F 409, u b, Ł Hr)
40	MCHG	No.2 motor switching	ON: No.2 motor (Pt.0, F:171, F:171, F:172, F:173, F:500, F:501)  OFF: No.1 motor (Pt. Setting, u.t., F:403, u.b., EHr., REE, d:EE)
49	HD	Operation holding (Stop of 3-wire operation)	ON :F (forward run) / R (reverse run) held, 3-wire operation OFF: Slowdown stop
54	FreeRun	Standby (inversion)	ON : Free run OFF : Standby
55	RSTN	Reset signal (inversion)	OFF to ON: Trip reset
56	F+ST	Combination of forward run and standby commands	ON : Simultaneous input of F and ST commands
57	R+ST	Combination of reverse run and standby commands	ON : Simultaneous input of R and ST commands

<sup>\*</sup>This function is effective after software version V110.

### ■Table of output terminal functions 1

Function No.	Code	Function	Action
0	LL	Frequency lower limit	ON : Output frequency higher than ¿ ¿ setting OFF : Output frequency equal to or lower than ¿ ¿ setting
1	LLN	Inversion of frequency lower limit	
2	UL	Frequency upper limit	ON: Output frequency equal to or higher than #L setting OFF: Output frequency lower than #L setting
3	ULN	Inversion of frequency upper limit	Inverse output of UL
4	LOW	Low-speed detection signal	ON: Output frequency equal to or higher than F: I II II setting OFF: Output frequency lower than F: II II setting
5	LOWN	Inversion of low-speed detection signal	Inverse output of LOW
6	RCH	Designated frequency reach signal (completion of acceleration/deceleration)	ON : Output frequency within command frequency ±2.5Hz  OFF: Output frequency exceeding command frequency ±2.5Hz
7	RCHN	Inversion of designated frequency reach signal (inversion of completion of acceleration/deceleration)	Inverse output of RCH
8	RCHF	Set frequency reach signal	ON: Output frequency within F: III I setting ±2.5Hz OFF: Output frequency exceeding F: III I setting ±2.5Hz
9	RCHFN	Inversion of set frequency reach signal	Inverse output of RCHF
10	FL	Failure FL (trip output)	ON : Inverter trips
11	FLN	Inversion of failure FL (inversion of trip output)	Inverse output of FL
12	ОТ	Over-torque detection	ON : Torque current is held above the torque set with F & 1 & for a period of time longer than that set with F & 1 &.
13	OTN	Inversion of over-torque detection	Inverse output of OT

### ■Order of precedence of combined functions

XX: In	npossible combination, X: Invalid	d, +:	Valid	und	er so	me c	ondit	ions,	0: V	alid,	@:P	riorit	у			
Func	tion No. / Function	2	3	4	5	6 — 9	10	11	12	13	14	15	38	1 54	39	40
2	Forward run command	$\setminus$	х	0	0	0	0	Х	0	х	0	0	0	х	0	0
3	Reverse run command	@		0	0	0	0	Х	0	Х	0	0	0	Х	0	0
4	Jog run command (18/19)	+	+	$\setminus$	@	+	0	Х	0	Х	@	0	0	Х	0	@
5	Acceleration/deceleration 2 selection	0	О	х	$\setminus$	0	0	х	0	х	0	0	0	х	0	+
6~9	Preset-speed run commands 1 to 4	0	0	х	0	$\setminus$	0	х	0	х	0	0	0	х	0	0
10	Reset command	0	0	0	0	0	$\setminus$	Х	0	0	0	0	0	0	0	0
11	Trip stop command from external input device	@	@	@	@	@	@		0	@	@	0	0	@	@	@
12	Operation panel/terminal board switching	0	0	0	0	0	0	0	/	0	0	0	0	0	0	0
13	DC braking command	@	@	@	@	@	0	Х	0	$\setminus$	@	0	0	Х	@	@
14	PI control prohibition	0	0	х	0	0	0	Х	0	Х	$\setminus$	0	0	х	0	0
15	Permission of parameter editing	0	О	0	0	0	0	0	0	0	0		0	0	О	0
38	Frequency commands forced switching	0	0	0	0	0	0	0	0	0	0	0		0	0	0
1,54	Free run stop	@	@	@	@	@	0	0	0	@	@	0	0		@	@
39	No.2 thermal switching	+	+	+	0	+	0	Х	0	Х	0	0	0	0	$\setminus$	+
40	No.2 motor switching	+	+	+	@	+	0	х	0	х	0	0	0	0	@	$\overline{\ }$

<sup>\*</sup>For the functions of combined terminals (combined functions), refer to the table of their respective functions.

## 12. Specifications

## 12.1 Models and their standard specifications

## ■ Standard specifications

	Item			Specifi	ication						
	Input voltage			3-phase	e 200V						
,	Applicable motor (kW)	0.1	0.2	0.4	0.75	1.5	2.2				
	Type	VFNC1									
	Form	2001P	2002P	2004P	2007P	2015P	2022P				
	Capacity (kVA) Note 1)	0.3	0.6	1.0	1.6	2.9	3.9				
Rating	Rated output current (A) Note 2)	0.7	1.4	2.4	4.0	7.5	10.0				
-	Rated output voltage Note 3)	3-phase 200V to 240V									
	Overload current rating		60 s	alue)							
	Voltage-frequency			3-phase 200V to	240V - 50/60Hz						
p ve	Allowable fluctuation		25/Volt	age +10%, -15% I	Note 4), frequenc	v ±5%					
Power supply	Ampere Interrupt Capacity (A) AIC	1000	1000	1000	1000	5000	5000				
	Protective method			IP20 Enclosed t	ype (JEM 1030)						
	Cooling method		Self-c	ooling		Forced a	ir-cooled				
	Color	Munsel 5Y8/0.5									
	Charge lamp	LED indicating the charge status of the capacitor in the main circuit									
	Built-in filter			-							

	Item			Specifi	cation						
	Input voltage			1-phase	e 200V						
- 1	Applicable motor (kW)	0.1	0.2	0.4	0.75	1.5	2.2				
	Type	VFNC1S									
	Form	-	2002P	2004P	2007P	2015P	2022P				
	Capacity (kVA) Note 1)	-	0.6	1.0	1.6	2.9	3.9				
Rating	Rated output current (A) Note 2)	-	1.4	2.4	4.0	7.5	10.0				
	Rated output voltage Note 3)	3-phase 200V to 240V									
ŀ	Overload current rating	60 seconds at 150%, (50%-reduction value)									
	Voltage-frequency			1-phase 200V to	240V - 50/60Hz						
Power	Allowable fluctuation		Volta	ge +10%, -15% No	te 4), frequency	±5%					
supply	Ampere Interrupt Capacity (A) AIC	-	1000	1000	1000	5000	5000				
	Protective method			IP20 Enclosed t	ype (JEM 1030)						
	Cooling method	-		Self-cooling		Forced a	ir-cooled				
	Color	Munsel 5Y8/0.5									
	Charge lamp		LED indicating t	the charge status	of the capacitor in	the main circuit					
	Built-in filter										

	Item			Specif	ication					
	Input voltage			1-phas	e 100V					
-	Applicable motor (kW)	0.1	0.2	0.4	0.75	1.5	2.2			
	Type	VFNC1S								
	Form	1001P	1002P	1004P	1007P	-	-			
	Capacity (kVA) Note 1)	0.3	0.6	1.0	1.6	-	-			
Rating	Rated output current (A) Note 2)	0.7	1.4	2.4	4.0	-	-			
_	Rated output voltage Note 3)	3-phase 200V to 230V								
	Overload current rating	60 seconds at 150%, (50%-reduction value)								
	Voltage-frequency	1-phase 100V to 115V - 50/60Hz								
百	Allowable fluctuation		Voltag	ge +10%, -15% N	ote 4), frequency :	±5%				
supply	Ampere Interrupt Capacity (A) AIC	1000	1000	1000	1000	-	-			
	Protective method			IP20 Enclosed t	type (JEM 1030)					
	Cooling method	Self-cooling			Forced air-cooled	-	-			
	Color	Munsel 5Y8/0.5								
	Charge lamp		LED indicating t	he charge status	of the capacitor in	he main circuit				
	Built-in filter				-					

	Item			Specif	ication					
	Input voltage		1-	phase 200V (built	-in EM1 noise filt	er)				
	Applicable motor (kW)	0.1	0.2	0.4	0.75	1.5	2.2			
	Type			VFN	C1S					
	Form	-	2002PL	2004PL	2007PL	2015PL	2022PL			
	Capacity (kVA) Note 1)	-	0.5	0.9	1.6	2.9	4.1			
Rating	Rated output current (A) Note 2)	-	1.2	2.3	4.0	7.5	10.7			
_	Rated output voltage Note 3)	3-phase 200V to 240V								
	Overload current rating	60 seconds at 150%, (50%-reduction value)								
	Voltage-frequency	1-phase 200V to 240V - 50/60Hz								
p e	Allowable fluctuation		Voltag	ge +10%, -15% N	ote 4), frequency	±5%				
Power supply	Ampere Interrupt Capacity (A) AIC	-	1000	1000	1000	5000	5000			
	Protective method		•	IP20 Enclosed t	ype (JEM 1030)	•	•			
	Cooling method	- Self-cooling Forced air-cooled								
	Color	Munsel 5Y8/0.5								
	Charge lamp	None								
	Built-in filter			EMC noise fi	Iter (Class B)					

#### Note

- Capacity is calculated at 220V for the 200V models.
- 2. Indicates rated output current setting when the PWM carrier frequency (parameter F 3 0 0) is 4kHz or

If the PWM carrier frequency setting is fixed above 4 kHz, the rated current needs to be reduced. If the PWM carrier frequency is set above 4 kHz, it could fall automatically if an over-current flaws during acceleration or for any other reason, depending on the amount of current that flows.

The default setting of the PWN carrier frequency is 12kHz.

3. Maximum output voltage is the same as the input voltage.

With regard to 100V models, the output voltage may decrease about 10 to 20 % if motor load is applied. When operating VFNC1 in conjunction with general purpose motor (200V), it is necessary to reduce the motor load.

4. ±10% when the inverter is used continuously (load of 100%).

	Item	Specification		
Н	Control system	Sinusoidal PWM control		
SU	Related output voltage	Adjustable of output voltage in base frequency setting by the correcting supply voltage (Unadjustable to any voltage higher than the input voltage).		
1.2	Output frequency range	0.5 to 200Hz, default setting: 0.5 to 80Hz, maximum frequency: 30 to 200Hz.		
functions	Minimum setting steps	operation panel setting, 0.2Hz: analog input (when the max. frequency is 100Hz).		
5	of frequency Frequency accuracy	Digital setting: within ±0.5% of the max. frequency (-10 to +50°C)		
control	. , ,	Analog setting: within ±1.0% of the max. frequency (25 °C ± 10°C)		
	Voltage/frequency characteristics	V/f constant, Sensorless vector control, base frequency, base frequency voltage and torque boost amount adjustable		
Principal	Frequency setting signal	Potentiometer on the front panel, external frequency potentiometer (connectable to a potentiometer with a rated impedance of $3-10k\Omega$ ), V1/S3 terminal (input impedance: $42k\Omega$ (voltage: $0-10Vd0$ ) or $250\Omega$ (current: $4-20mAdc$ )). The characteristic can be set arbitrarily by two-point setting.		
	Start-up frequency/ frequency jump	Adjustable within a range of 0.5 to 10Hz / Up to 1 frequency can be adjusted together with their widths.		
	PWM carrier frequency (Note 1)	Selectable from among 2, 4, 8, 12 and 16kHz (Standard default setting: 12kHz), Selectable between fixed mode and auto-reduction mode		
	Acceleration/decelerati on time	0.1 to 3000 seconds, switchable between acceleration/deceleration time 1 and 2.		
ions	Retry operation	Number of times of retry selectable (Max. 10 times). If the protection function is activated, the retry function restarts on completion of a check of the main circuit.		
specifications	Dynamic braking	Charging of capacitor (Deceleration time can be shortened by activating Forced Shortened Deceleration mode.)		
lĕ	Dynamic braking	Driving circuit for braking resistor is not provided.		
n S	DC braking	Braking start-up frequency: 0 to maximum frequency, braking rate: 0 to 100%,		
읉		braking time: 0 to 20 seconds.		
Operation	Input terminal functions   Selectable from among 45 functions, such as fonward/reverse run input sign (selectable)   run input signal, standby signal, preset-speed operation input signal, and re signal (Also, selectable between sink/source)			
	Output terminal functions (selectable)	Selectable from among 14 functions, such as frequency lower limit output signal, frequency upper limit output signal, low-speed detection output signal, and specified speed attainment output signal. Open collector and relay output possible		
	Failure detection signal	1c-contact output: 250Vac-1A- cosφ = 0.4		
	Output for frequency meter/output for ammeter	PWM output: (1mAdc full-scale DC ammeter or 7.5Vdc full-scale DC ammeter/Rectifier-type AC voltmeter, 225% current Max. 1mAdc, 7.5Vdc full-scale)		
e function	Protective function	Stall prevention, current limitation, over-current, output short circuit, over-voltage, over-voltage limitation, undervoltage, ground fault, power supply phase failure, output phase failure, overload protection by electronic thermal function, armature over-load at start-up, load-side over-forque at start, overheating prevention, detection of analog signal break.		
Protective	Protection against momentary power failure	Auto-restart/non-stop control after momentary power failure.		
ď	Electronic thermal	Switching between standard motor/constant-torque VF motor, overload trip, overload		
L	characteristics	stall selection.		
c	4-digit 7-segments	Frequency: inverter output frequency.		
l용	LED	Alarm: Stall alarm "C", overvoltage alarm "P", overload alarm "L", overheat alarm "H". Status: Inverter status (frequency, cause of activation of protective function,		
ΙĔ		input/output voltage, output current, etc.) and parameter settings.		
lay function		Free-unit display: Arbitrary unit (e.g. rotating speed) corresponding to output		
Displ	Indicator	frequency.  Lamps indicating the inverter status by lighting or blinking, such as RUN lamp and PRG lamp.		
¥	Use environments	Indoor, altitude: 1000m (Max.), not exposed to direct sunlight, corrosive gas,		
Environment		explosive gas or vibration (less than 5.9m/s²) (10 to 55Hz).		
١Ē	Ambient temperature	-10 to 50°C Note)1.2.3		
ΙÈ	Storage temperature	-20 to +65°C		
Ш	Relative humidity	20 to 93% (free from condensation and vapor).		

Relative humidity | 20 to 93% (free from condensation and vapor).

Note)1. Above 40°C: Remove the protective seal from the top of VF-nC1.

Note)2. When installing inverters side by side (without allowing space between them), detach the label on the top surface of each inverter and use them where the ambient temperature is below 40°C. Note)3. Single-phase 200V models (built-in EMI noise filter) should be used where the ambient


temperature will not rise above 40°C.

## 12.2 External dimensions/weights

## ■External dimensions/weights

Input voltage	Applicable	Type	1	Dimensions (mm)					Drawing	Approx.
IIIput voitage	motor (kW)	Type	W	Н	D	W1	H1	D1	Diawing	weight (kg)
	0.2	VFNC1S-2002P			100					1.0
1-phase 200V	0.4	VFNC1S-2004P	72		124	60			A	1.0
(Standard)	0.75	VFNC1S-2007P			137					1.0
(Stanuaru)	1.5	VFNC1S-2015P	117	1	155	106	1		В	1.5
	2.2	VFNC1S-2022P	117		133	100			P	1.5
	0.1	VFNC1-2001P			100					1.0
	0.2	VFNC1-2002P	72		100	60	131	8.5	А	1.0
3-phase 200V	0.4	VFNC1-2004P			124	60				1.0
3-phase 200V	0.75	VFNC1-2007P			137					1.0
	1.5	VFNC1-2015P	117	142	155	5 106			В	1.5
	2.2	VFNC1-2022P	1117	- 142	133	100				1.5
	0.1	VFNC1S-1001P			100				А	1.0
1-phase 100V	0.2	VFNC1S-1002P	72		100	60				1.0
1-phase 100V	0.4	VFNC1S-1004P	1		124	1				1.0
	0.75	VFNC1S-1007P	117		155	106			В	1.5
	0.2	VFNC1S-2002PL		1	100		1			1.0
1-phase 200V	0.4	VFNC1S-2004PL	72		124	60			A	1.0
(Europe)	0.75	VFNC1S-2007PL	1		137	1				1.0
(Luiope)	1.5	VFNC1S-2015PL	117	1	155	106		В	1.5	
	2.2	VFNC1S-2022PL	1 '1'		155	100		i	В	1.5

## **■**External dimensions



## 13. Before making a service call-Trip information and remedies

### 13.1 Trip causes/warnings and remedies

When a problem arises, diagnose it in accordance with the following table. If it is found that replacement of parts is required or the problem cannot be solved by any remedy described in the table, contact your Toshiba dealer.

[Trip information: FL relay activated]

Error	Alarm code	Problem	Possible causes	Remedies	
0C IP	0001 0025	Overcurrent during acceleration Overcurrent flowing in element during acceleration	The acceleration time #ff is too short. The VIF setting is improper. A restant signal is input to the rotating motor after a momentary stop, etc. A special motor (e.g. motor with a small impedance) is used.		
0C2P	0002 0026	Overcurrent during deceleration Overcurrent flowing in element during acceleration	The deceleration time d E L is too short.	Increase the deceleration time d E C.	
0C3 0C3P	0003 0027	Overcurrent during operation Overcurrent flowing in element during acceleration	The load fluctuates abruptly. The load is in an abnormal condition.	Reduce the load fluctuation.     Check the load (operated machine).	
OCA	0005	Arm overcurrent at start-up	<ul> <li>A main circuit element is defective.</li> </ul>	Make a service call.	
OCL	0004	Overcurrent (An overcurrent on the load side at start-up)	The insulation of the output main circuit or motor is defective. The motor has too small impedance.	Check the cables and wires for defective insulation.	
OP I	000A	Overvoltage during acceleration	The input voltage fluctuates abnormally. The power supply has a capacity of 200kVA or more. 2A power factor improvement capacitor is opened or closed. 3A system using a thyrister is connected to the same power distribution line. A restart signal is input to the rotating motor after a momentary stop, etc.	Use F 30 / (auto-restart) and F 30 2 (ride-through control).	

	(Continue	d)		
Error code	Alarm code	Problem	Possible causes	Remedies
0P2	© P ≥ 000B Overvoltage during deceleration		<ul> <li>The deceleration time of £ ∫ is too short. (Regenerative energy is too large.)</li> <li>F 3 £ 5 (overvoltage limit operation) is off.</li> <li>The input voltage fluctuates abnormally.</li> <li>The power supply has a capacity of 200kVA or more.</li> <li>A power factor improvement capacitor is opened or closed.</li> <li>As ystem using a thyristor is connected to the same power distribution line.</li> </ul>	• Increase the deceleration time $d \in \mathcal{E}$ . • Enable $F \ni 0 \ni 0$ (overvoltage limit operation). • Insert a suitable input reactor.
0P3	000C	Overvoltage during constant-speed operation	The input voltage fluctuates abnormally.     The power supply has a capacity of 200k/Va or more. 2A power factor improvement capacitor is opened or closed. 3A system using a thyristor is connected to the same power distribution line.     The motor is in a regenerative state because the load causes the motor to run at a frequency higher than the inverter output frequency.	Insert a suitable input reactor.
OL I	000D	Inverter overload	The acceleration time ACC is too short. The DC braking amount is too large. The V/F settling is improper. A restart signal is input to the rotating motor after a momentary stop, etc. The load is too large.	<ul> <li>Increase the acceleration time R ∈ E.</li> <li>Reduce the DC braking amount F ≥ 5 f and the DC braking time F ≥ 5 c.</li> <li>Check the V/F parameter setting.</li> <li>Use F ≥ 3B f (auto-restart) and F ≥ 3B c (de-through control).</li> <li>Use an inverter with a larger rating.</li> </ul>
OFS	000E	Motor overload	The V/F setting is improper. The motor is locked up. Low-speed operation is performed continuously. An excessive load is applied to the motor during operation.	Check the V/F parameter setting. Check the load (operated machine). Adjust \$\mathcal{B} L \mathcal{B}\$ to the overload that the motor can withstand during operation in a low speed range.
ЕРНО	0009	Output phase failure	<ul> <li>A phase failure occurred in the output line of the main circuit.</li> </ul>	Check the main circuit output line, motor, etc., for phase failure. Enable F & 3 5 (Output phase failure detection).

Problem   Prostable causes   Remedies		(Continue	d)		
input line of the main circuit.  *The inventer may trip because of \$\frac{F}{E} \ B\$ (input phase \$\frac{F}{E} \ B\$) (input ph		Alarm code	Problem	Possible causes	Remedies
The ambient temperature is too high.  The vent is blocked up.  The vent vent is blocked up.  The control course is the vent in the vent vent of vent or vent o	* EPH I	8000	Input phase failure	input line of the main circuit.  • The inverter may trip because of EPH 1 if switching between acceleration and deceleration is done in succession at intervals	<ul> <li>Enable F &amp; C B (input phase failure detection). Set the</li> </ul>
### ### ### ### ### ### ### ### ### ##	ОН	0010	Overheat	The ambient temperature is too high.  The vent is blocked up. A heat generating device is installed dose to the inverter. The themistor in the unit is	resetting the inverter after it has cooled down enough.  The fan requires replacement if it does not rotate during operation.  Secure sufficient space around the inverter.  Do not place any heat-generating device near the inverter.
Arm overcurrent output cable or the motor.  A main circuit element is defective.  During automatic operation or remote operation and star portion or remote operation and star portion or remote operation as top command is entered from the operation panel or a remote input device.  Err 2 0015 Main unit RAM fault The control RAM is defective.  Err 3 0016 Main unit RAM fault The control RAM is defective.  Err 5 0017 CPU fault trip  The control RAM is defective.  A Make a service call.  Err 7 0018 Remote control error  Frr 7 001A Current defector along a remote operation.  EFP 1 0012 EEPROM fault 1 Adata writing error occurs.  EFP 2 0013 EEPROM fault 2 Power supply is cut off during by poperation and data writing is aborted.  EFP 3 0014 EEPROM fault 3 A data writing error occurs.  A data writing error occurs.  Turn off the inverter, then turn on again. If it does not recover from the error, make a service call.  Turn off the inverter, then turn on again. If it does not recover from the error, make a service call.  EFP 3 0014 EEPROM fault 3 A data writing error occurs.  EFP 3 0015 EEPROM fault 3 A data writing error occurs.  A data writing is aborted.  EFP 3 0016 EEPROM fault 3 A data writing error occurs.  A data writing error occurs.  A check the error fremporation or remove fremorant and trun in back on, and then by 9 operation again.  Turn off the inverter, then turn on again. If it does not recove from the error, make a service call.  EFP 3 0014 EEPROM fault 3 A data writing error occurs.  Check the cables for breaks and change the setting of a data and trun factor or the poperation again.	*UP	001E		The input voltage (in the main	Check the input voltage. Enable F 5 2 7 (undervoltage trip selection). To cope with a momentary stop due to undervoltage, enable F 3 0 2 (ride-through control)
remote operation, a stop command is entered from the operation panel or a remote input device.  Err 2 0015 Main unit RAM fault • The control RAM is defective.  Err 3 0016 Main unit ROM fault • The control RAM is defective.  Err 9 0017 CPU fault trip • The control CPU is defective.  Err 9 0018 Remote control • An error arises during remote operation.  Err 7 001A Current defector • The current detector is defective.  EEP 1 0012 EEPROM fault 1 • A data writing error occurs.  EEP 2 0013 EEPROM fault 2 • Power supply is cut off during by Poperation and data writing is aborted.  EEP 3 0014 EEPROM fault 3 • A data writing error occurs.  EEP 3 0015 EEPROM fault 3 • A data writing error occurs.  EEP 3 0016 Remote control operation and data writing is aborted.  EEP 1 0017 EEPROM fault 3 • A data writing error occurs.  EEP 2 0018 EEPROM fault 3 • A data writing error occurs.  EEP 3 0019 EEPROM fault 3 • A data writing error occurs.  EEP 3 0019 EEPROM fault 3 • A data writing error occurs.  EEP 3 0019 EEPROM fault 3 • A data writing error occurs.  EEP 3 0019 EEPROM fault 3 • A data writing error occurs.  EEP 4 0019 EEPROM fault 3 • A data writing error occurs.  EEP 6 0019 EEPROM fault 3 • A data writing error occurs.  EEP 7 0019 EEPROM fault 3 • A data writing error occurs.  EEPROM fault 3 • A data writing error occurs.  EEPROM fault 3 • A data writing error occurs.  EEPROM fault 3 • A data writing error occurs.  EEPROM fault 3 • A data writing error occurs.  EEPROM fault 3 • Check the cables for breaks and change the setting of	EF2	0022		output cable or the motor.  • A main circuit element is	
E r r 3     0016     Main unit ROM fault the control ROM is defective.     • Make a service call.       E r r 7     0017     CPU fault tip     • The control CPU is defective.     • Make a service call.       E r r 7     0018     Remote control error     • A nerror arises during remote operation.     • Check the remote control device, cables, etc.       E r r 7     001A     Current defector fault     • The current detector is defective.     • Make a service call.       E E P I     0012     EEPROM fault 1     • A data writing error occurs.     • Turn off the inverter, then turn on again. If it does not recove from the error, make a service call.       E E P 2     0013     EEPROM fault 2     • Power supply is cut off during by 9 operation and data writing is aborted.     • Turn the power off temporarial and turn it back on, and then by 9 operation again.       E E P 3     0014     EEPROM fault 3     • A data writing error occurs.     • Turn off the inverter, then turn on again. If it does not recove from the error, make a service call.       E - 18     8     Break in analog signal cable     • The signal input via VI/S3 is below the analog signal     • Check the cables for breaks and change the setting of		0011		remote operation, a stop command is entered from the operation panel or a remote	Reset the inverter.
E r r √ y         0017         CPU fault trip         • The control CPU is defective.         • Make a service call.           E r r 7         001A         Remote control error         • A nerror arrises during remote operation.         • Check the remote control device, cables, etc.           E F r 7         001A         Current defector fault         • The current detector is defective.         • Make a service call.           E E P I         0012         EEPROM fault 1         • A data writing error occurs.         • Turn off the inverter, then turn on again. If it does not recove from the error, make a service call.           E E P 2         0013         EEPROM fault 2         • Power supply is cut off during by P operation and data writing is aborted.         • Turn off the inverter, then turn on again. If it does not recove from the error, make a service call.           E E P 3         0014         EEPROM fault 3         • A data writing error occurs.         • Turn off the inverter, then turn on again. If it does not recove from the error, make a service call.           E - 18         0032         Break in analog signal cable         • The signal input via VI/S3 is below the analog signal         • Check the cables for breaks and change the setting of	Err2				Make a service call.
Err 5         0018         Remote control error         • An error arises during remote operation.         • Check the remote control device, cables, etc.           Err 7         001A         Current defector fault         • The current detector is defective.         • Make a service call.           EEP 1         0012         EEPROM fault 1         • A data writing error occurs.         • Turn off the inverter, then turn on again. If it does not recove from the error, make a service call.           EEP 2         0013         EEPROM fault 2         • Power supply is cut off during by 9 operation and data writing is aborted.         • Turn the power off temporarial and turn it back on, and then by 9 operation again.           EEP 3         0014         EEPROM fault 3         • A data writing error occurs.         • Turn off the inverter, then turn on again. If it does not recove from the error, make a service call.           **	Err3				
Fr   T   T   T   T   T   T   T   T   T			Remote control	An error arises during remote	Check the remote control
on again. If it does not recove from the error, make a servic call.  EEPROM fault 2  Power supply is cut off during £ \$9\$ operation and data writing is aborted.  EEPROM fault 3  A data writing error occurs.  Turn the power off temporarial and turn it back on, and then £ \$9\$ operation again.  Turn the power off temporarial and turn it back on, and then £ \$9\$ operation again.  Turn of the inverter, then turn on again. If it does not recover from the error, make a servic call.  Break in analog signal cable  The signal input via VI/S3 is below the analog signal.	Errl	001A	Current defector		
### EPROM fault 3  ### EPROM fault 3  ### A data writing is aborted.  ### A data writing error occurs.  ### Turn off the inverter, then turn on again. If it does not reco from the error, make a servic call.  #### 0032  ### Break in analog  ### Signal cable  ### Break in analog  ### Signal cable  ### Coperation and data ### By Poperation again.  ### Turn off the inverter, then turn on again. If it does not reco from the error, make a servic call.  #### Countries of the signal input via VI/S3 is below the analog signal.  ###################################				A data writing error occurs.	Turn off the inverter, then turn it on again. If it does not recover from the error, make a service call.
on again. If it does not reco from the error, make a servic call.  * 0032 Break in analog signal able signal cable signal				는 당부 operation and data writing is aborted.	
E - 18 signal cable below the analog signal and change the setting of	EEP3			A data writing error occurs.	Turn off the inverter, then turn it on again. If it does not recover from the error, make a service call.
COLOCIONIOTO COL MILIT, D.J.J., P.J.J. I TIO DICARO die Todi	* E - 18	0032			

	Continue	d)		
Error code	Alarm code	Problem	Possible causes	Remedies
E - 19	0033	CPU communications error	A communications error occurs between control CPUs.	Make a service call.
E-20	0034	Excessive torque boosted	ு b is set too high.	Decrease the setting of the torque boost parameter u b     If no improvement results, contact Toshiba Technical

<sup>\*</sup> With a parameter, you can choose between trip-on and -off.

[Alarm information] Each message in the table is displayed to give a warning but does not cause the

inverter to trip.								
Error code	Problem	Possible causes	Remedies					
OFF	ST terminal OFF	<ul> <li>The ST-CC circuit is opened.</li> </ul>	<ul> <li>Close the ST-CC circuit.</li> </ul>					
NOFF	Undervoltage in main circuit	The supply voltage between R, S and T is under voltage.	Measure the main circuit supply voltage.  If the voltage is at a normal level, the inverter requires repairing.					
rtry	Retry in process	<ul> <li>The inverter is in the process of retry.</li> <li>A momentary stop occurred.</li> </ul>	The inverter is normal if it restarts after several tens of seconds.     The inverter restarts automatically. Be careful of the machine because it may suddenly restart.					
Errl	Frequency point setting error	<ul> <li>The frequency setting signals at points 1 and 2 are set too close to each other.</li> </ul>	Set the frequency setting signals at points 1 and 2 apart from each other.					
ELr	Clear command acceptable	<ul> <li>This message is displayed when pressing the STOP key while an error code is displayed.</li> </ul>	Press the STOP key again to clear the trip.					
EOFF	Emergency stop command acceptable	The operation panel is used to stop the operation in automatic control or remote control mode.	Press the STOP key for an emergency stop. To cancel the emergency stop, press any other key.					
H IIL O	Setting error alarm / An error code and data are displayed alternately twice each.	An error is found in a setting when data is reading or writing.	Check whether the setting is made correctly.					
∕End ∕End	Display of first/last data items	<ul> <li>The first or last data item in the RUH/RUF data group is displayed.</li> </ul>	Press the MON key to exit the data group.					
db	DC braking	DC braking in process	The message goes off in several tens of seconds if no problem occurs. Note)					
ΕΙ	Flowing out of excess number of digits	The numeric value displayed (e.g., frequency) has a larger number of digits than the display panel. (The number next to the E refers to the excess number of digits.)	When a frequency is displayed, decrease the setting of F 702 d (free unit).					

(Continue	(Continued)							
Error code	Problem	Possible causes	Remedies					
5 £ 0 P	Momentary power failure slowdown stop prohibition function activated	<ul> <li>The slowdown stop prohibition function set with F 3 C 2 (momentary power failure ride- through operation) is activated.</li> </ul>	To restart operation, reset the inverter or input an operation signal again.					
In IE	Parameters in the process of initialization	<ul> <li>Parameters are being initialized to default values.</li> </ul>	<ul> <li>Normal if the message disappears after a while (several seconds to several tens of seconds).</li> </ul>					
	Setup parameters in the process of being set	<ul> <li>Setup parameters are in the process of being set.</li> </ul>	<ul> <li>Normal if the message disappears after a while (several seconds to several tens of seconds). (European model only)</li> </ul>					
E - 17	Operation panel key fault	<ul> <li>The RUN or STOP key is held down for more than 5 seconds.</li> <li>The RUN or STOP key is faulty.</li> </ul>	Check the operation panel.					
E-50	Source logic switching confirmation alarm	The input terminal is switched to source logic mode.	Check whether cables are connected correctly, and then specify a proper logic. Check whether cables are connected correctly, and then reset the inverter or turn it off temporarily and turn it back on. Logics will be switched.					
E-51	Source logic switching confirmation alarm	The input terminal is switched to source logic mode.	Check whether cables are connected correctly, and then specify a proper logic. Check whether cables are connected correctly, and then reset the inverter or turn it off temporarily and turn it back on. Logics will be switched.					

(Note) When the ON/OFF function is selected for DC braking (DB), using the input terminal selection parameter, you can judge the inverter to be normal if "db" disappears when opening the circuit between the terminal and CC.

[Alarme dieplayed during operation]

[Alarms displa	yed during operation;	
C Overcurrent alarm		Same as ££ (overcurrent)
Ρ	Overvoltage alarm	Same as ### (overvoltage)
L	Overload alarm	Same as ☐ L I/☐ L 2 (overload)
н	Overheat alarm	Same as C.B. (overheat)

If two or more problems arise simultaneously, one of the following alarms appears and blinks.  $\mathcal{LP}, \mathcal{PL}, \mathcal{LPL}$ 

The blinking alarms £, P, L, H are displayed in this order from left to right.

#### 13.2 Restoring the inverter from a trip

Do not reset the inverter when tripped because of a failure or error before eliminating the cause. Resetting the tripped inverter before eliminating the problem causes it to trip again.

The inverter can be restored from a trip by any of the following operations:

- (1) By turning off the power (Keep the inverter off until the LED turns off.) Note) Refer to 6.1 4.2 (inverter trip retention selection F 5 fi 7) for details.
- (2) By means of an external signal [Short-circuiting of control terminals RST and CC
- (Assignment of functions to input terminals is necessary)]
- (3) By operation panel operation
- (4) By inputting a trip clear signal from a remote input device (Refer to the Communications Equipment User's Manual for details.)

To reset the inverter by operation panel operation, follow these steps.

- Press the STOP key and make sure that £ \( \frac{1}{2} \) \( \triangle \) is displayed.
- Pressing the STOP key again will reset the inverter if the cause of the trip has already been eliminated.
- ★When any overload function [@L | : inverter overload, @L | ≥ : motor overload,] is active, the inverter cannot be reset by inputting a reset signal from an external device or by operation panel operation before the virtual cooling time has passed.

Virtual cooling time .... BL 1: about 30 seconds after the occurrence of a trip
BL 2: about 120 seconds after the occurrence of a trip


#### [Caution]

Turning the inverter off then turning it on again resets the inverter immediately. You can use this mode of resetting if there is a need to reset the inverter immediately. Note, however, that this operation may damage the system or the motor if it is repeated frequently.

☆If the inverter trips because of overheating (⊕H), do not reset the inverter immediately but wait
until the temperature in the inverter comes down, because its internal temperature is monitored.

#### 13.3 If the motor does not run while no trip message is displayed ...

If the motor does not run while no trip message is displayed, follow these steps to track down the cause.

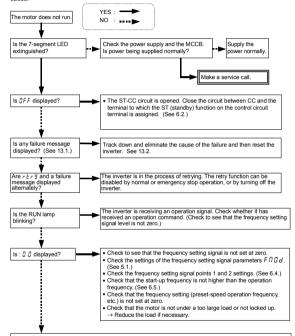

Determine the cause, using the parameter display function and the status monitoring function. Refer to Section 11 for the parameter display function or Section 8 for the status motoring function.

### 13.4 How to determine the causes of other problems

The following table provides a listing of other problems, their possible causes and remedies.

Problems	Causes and remedies
The motor runs in the wrong direction.	Invert the phases of the output terminals U, V and W.     Invert the forward/reverse run-signal terminals of the external input device. (See 6.2 'Assignment of functions to control terminals'.)
The motor runs but its speed does not change normally.	<ul> <li>The load is too heavy.</li> <li>Reduce the load.</li> <li>The soft stall function is activated.</li> <li>Disable the soft stall function. (See 5.10.)</li> <li>The maximum frequency FH and the upper limit frequency UL are set too low.</li> <li>Increase the maximum frequency FH and the upper limit frequency UL.</li> <li>The frequency setting signal is too low.</li> <li>Check the signal set value, circuit, cables, etc.</li> <li>Check the setting characteristics (point 1 and point 2 settings) of the frequency setting signal parameters. (See 6.4.)</li> <li>If the motor runs at a low speed, check to see that the stall prevention function is activated because the torque boost amount is too large. Adjust the torque boost amount (v b) and the acceleration time (R € €).</li> </ul>
The motor does not accelerate or	• The acceleration time (R £ £) or the deceleration time (d £ £) is set too short.
decelerate smoothly.	Increase the acceleration time $(R \mathcal{L} \mathcal{L})$ or the deceleration time $(d \mathcal{E} \mathcal{L})$ .
A too large current flows into the motor.	The load is too heavy. Reduce the load. If the motor runs at a low speed, check whether the torque boost amount is too large. (See 5.9.)
The motor runs at a higher or lower speed than the specified one.	The motor has an improper voltage rating. Use a motor with a proper voltage rating. The motor terminal voltage is too low. Check the setting of the base frequency voltage parameter (F 409). (See 6.12). Replace the cable with a cable larger in diameter. The reduction gear ratio, etc., are not set properly. Adjust the reduction gear ratio, etc. The output frequency is not set correctly. Check the output frequency range. Adjust the base frequency. (See 5.8.)
The motor speed fluctuates during operation.	The load is too heavy or too light. Reduce the load fluctuation. The inverter or motor used does not have a rating large enough to drive the load. Use an inverter or motor with a rating large enough. Check whether the frequency setting signal changes.
Parameter settings cannot be changed.	Change the setting of the parameter $F ? B G$ (prohibition of change of parameter setting) to $B . C . H . B$ (permitted) if it is set at $1.3.5.7$ (prohibited).  For safety's sake, some parameters cannot be set during operation. (See 4.1.4.)

low to cope with parameter setting-related problems

now to cope with parameter setting-related problems					
If you forget parameters which have been reset	You can search for all reset parameters and change their settings.  * Refer to 4.1.3 for details.				
If you want to return all reset parameters to their respective default settings	You can return all parameters which have been reset to their default settings.  * Refer to 4.1.5 for details.				

## 14. Inspection and maintenance

## Danger Danger Danger Danger Danger



- The equipment must be inspected every day.
- If the equipment is not inspected and maintained, errors and malfunctions may not be discovered which could lead to accidents.

Before inspection, perform the following steps.

- - 1) Shut off all input power to the inverter.
  - 2Wait for at least 15 minutes and check that the charge lamp is no longer lit.
  - 3Use a tester that can measure DC voltages (800V DC or more), and check that the voltage to the DC main circuits (across PA-PC) does not exceed 45V.

Performing an inspection without carrying out these steps first could lead to electric shock. Be sure to inspect the inverter regularly and periodically to prevent it from breaking down because of the environment of use, such as temperature, humidity, dust and vibration, or deterioration of its components with aging.

#### 14.1 Regular inspection

Since electronic parts are susceptible to heat, install the inverter in a cool, well-ventilated and dustfree place. This is essential for increasing the service life.

The purpose of regular inspections is to maintain the correct environment of use and to find any

sign of failure or malfunction by comparing current operation data with past operation records. Inspection procedure

inspection	Inspection item	Inspection cycle	Inspection method	Criteria for judgment
	Dust, temperature and gas	Occasionally	Visual check, check by means of a thermometer, smell check	Improve the environment if it is found to be unfavorable.
Indoor environment	<ol><li>Drops of water or other liquid</li></ol>	Occasionally	2) Visual check	<ol><li>Check for any trace of water condensation.</li></ol>
	Room temperature	Occasionally	Check by means of a thermometer	<ol> <li>Max. temperature: 40°C (50°C inside the cabinet)</li> </ol>
Units and components	Vibration and noise	Occasionally	Tactile check of the cabinet	If something unusual is found, open the door and check the transformer, reactors, contactors, relays, cooling fan, etc., inside. If necessary, stop the operation.
Operation data (output side)	1) Load current 2) Voltage (*) 3) Temperature	Occasionally Occasionally Occasionally	Moving-iron type AC ammeter Rectifier type AC voltmeter Thermometer	To be within the rated current, voltage and temperature. No significant difference from data collected in a normal state.

<sup>\*)</sup> The voltage measured may slightly vary from voltmeter to voltmeter. When measuring the voltage, always take readings from the same circuit tester or voltmeter.

#### ■Check points

- Something unusual in the installation environment
- 2. Something unusual in the cooling system
- 3. Unusual vibration or noise
- 4. Overheating or discoloration
- Unusual odor
- 6. Unusual motor vibration, noise or overheating

#### 14.2 Periodical inspection

Make a periodical inspection at intervals of 3 or 6 months depending on the operating conditions.

## Danger

Mandatory


- · Before inspection, perform the following steps
  - 1)Shut off all input power to the inverter.
  - ②Wait for at least 15 minutes and check that the charge lamp is no longer lit.
  - ③Use a tester that can measure DC voltages (800V DC or more), and check that the voltage to the DC main circuits (across PA-PC) does not exceed 45V.
- Performing an inspection without carrying out these steps first could lead to electric shock.
   Never replace any part.



This could be a cause of electric shock, fire or bodily injury. To replace parts, call the local sales agency.

#### ■ Check items

- Check to see if all screwed terminals are tightened firmly. If any screw is found loose, tighten it again with a screwdriver.
- Check to see if all crimped terminals are fixed properly. Check them visually to see that there is no trace of overheating around any of them.
- Check visually all cables and wires for damage.
- With a vacuum cleaner, remove dirt and dust, especially from the vents and the printed circuit boards. Always keep them clean to prevent an accident due to dirt or dust.
- 5. When leaving the inverter unused for a long time, check it for functioning once every 2 years or so by supplying it with electricity for at least 5 hours with the motor disconnected. It is advisable not to supply the commercial power directly to the inverter but to gradually increase the power supply voltage with a transformer.
- 6. If the need arises, conduct an insulation test on the main circuit terminal board only, using a 500V insulation tester. Never conduct an insulation test on control terminals other than terminals on the printed circuit board or on control terminals. When testing the motor for insulation performance, separate it from the inverter in advance by disconnecting the cables from the inverter output terminals U, V and W. When conducting an insulation test on peripheral circuits other than the motor circuit, disconnect all cables from the inverter so that no voltage is applied to the inverter during the test.
  - (Note) Before an insulation test, always disconnect all cables from the main circuit terminal board and test the inverter separately from other equipment.



- 7. Never test the inverter for pressure. A pressure test may cause damage to its components.
- 8. Voltage and temperature check

Recommended voltmeter:

Input side — Moving-iron type voltmeter (♠)
Output side — Rectifier type voltmeter (♠)

It will be very helpful for detecting a defect if you always measure and record the ambient temperature before, during and after the operation.

#### ■ Replacement of expendable parts

The inverter is composed of a large number of electronic parts including semiconductor devices. The following parts deteriorate with the passage of time because of their composition or physical properties. The use of aged or deteriorated parts leads to degradation in the performance or a breakdown of the inverter. To avoid such trouble, the inverter should be checked periodically. No parts of the inverter except the cooling fan can be replaced individually, and the whole inverter needs to be replaced if a sionificant defect is found in it.

Note) Generally, the life of a part depends on the ambient temperature and the conditions of use.

The life spans listed below are applicable to parts when used under normal environmental conditions.

#### 1) Cooling fan

The fan, which cools down heat-generating parts, has a service life of about 30,000 hours (about 2 or 3 years of continuous operation). The fan also needs to be replaced if it makes a noise or vibrates abnormally.

#### 2) Smoothing capacitor

The smoothing aluminum electrolytic capacitor in the main circuit DC section degrades in performance because of ripple currents, etc. It becomes necessary to replace the capacitor after it is used for about 5 years under normal conditions.

- after it is used for about 5 years
  Criteria for appearance check>
- Absence of liquid leak
- Safety valve in the depressed position.
- Measurement of electrostatic capacitance and insulation resistance

Note: For the replacement of consumable parts, ask your nearest Toshiba branch or office.

The operation time is helpful for roughly determining the time of replacement. For the replacement of parts, contact the service network or Toshiba branch office printed on the back cover of this instruction manual.

#### ■ Standard replacement cycles of principal parts

The table below provides a listing of the replacement cycles of parts when used under normal conditions (average ambient temperature: 30°C, load factor: not more than 80%, operation time: 12 hours per day). The replacement cycle of each part does not mean its service life but the number of years over which its failure rate does not increase significantly.

Part name	Standard replacement cycle	Replacement mode and others
Cooling fan	2 to 3 years	Replacement with a new one
Smoothing capacitor	5 years	Replace with a new one (depending on the check results)
Contactors and relays	-	Whether to replace or not depends on the check results
Timer	-	Whether to replace or not depends on the operation time
Fuse	10 years	Replacement with a new one
Aluminum capacitor on printed circuit board	5 years	Replace with a new circuit board (depending on the check results)

(Extract from "Guide to periodical inspections of general-purpose inverters" issued by the Japan Electrical Manufacturers' Association.)

Note) The life of a part greatly varies depending on the environment of use.

#### 14.3 Making a call for servicing

For the Toshiba service network, refer to the back cover of this instruction manual. If defective conditions are encountered, please contact the Toshiba service section in charge via your Toshiba relater

When making a call for servicing, please inform us of the contents of the rating label on the right panel of the inverter, the presence or absence of optional devices, etc., in addition to the details of the failure.

#### 14.4 Keeping the inverter in storage

Take the following precautions when keeping the inverter in storage temporarily or for a long period of time.

- 1. Store the inverter in a well-ventilated place away from heat, damp, dust and metal powder.
- If the printed circuit board in your inverter has an anti-static cover (black cover), do not leave it detached from the circuit board during storage, though the cover must be detached before turning on the inverter.
- If no power is supplied to the inverter for a long time, the performance of its large-capacity electrolytic capacitor declines.

When leaving the inverter unused for a long time, supply it with electricity once every two years, for 5 hours or more each, to recover the performance of the large-capacity electrolytic capacitor and also to check the function of the inverter. It is advisable not to supply the commercial power directly to the inverter but to gradually increase the power supply voltage with a transformer, etc.

## 15

## 15. Warranty

Any part of the inverter that proves defective will be repaired and adjusted free of charge under the following conditions:

- 1. This warranty applies only to the inverter main unit.
- Any part of the inverter which fails or is damaged under normal use within twelve months from the date of delivery shall be repaired free of charge.
- For the following kinds of failure or damage, the repair cost shall be borne by the customer even within the warranty period.
  - Failure or damage caused by improper or incorrect use or handling, or unauthorized repair or modification of the inverter
  - Failure or damage caused by the inverter falling or an accident during transportation after the purchase
  - Failure or damage caused by fire, salty water or wind, corrosive gas, earthquake, storm or flood, lightning, abnormal voltage supply, or other natural disasters
  - Failure or damage caused by the use of the inverter for any purpose or application other than the intended one
- All expenses incurred by Toshiba for on-site services shall be charged to the customer, unless a service contract is signed beforehand between the customer and Toshiba, in which case the service contract has priority over this warranty.

## 16. Disposal of the inverter

## $\Lambda$

## Warning



- If you throw away the inverter, have it done by a specialist in industry waste disposal\*. If you throw away the inverter by yourself, this can result in explosion of capacitor or produce noxious gases, resulting in injury.
- (\*) Persons who specialize in the processing of waste and known as "industrial waste product collectors and transporters" or "industrial waste disposal persons."
  - If the collection, transport and disposal of industrial waste is done by someone who is not licensed for that job, it is a punishable violation of the law. (Law on Waste Disposal and Cleanino)

For safety's sake, do not dispose of the disused inverter yourself but ask an industrial waste disposal agent.

Disposing of the inverter improperly could cause its capacitor to explode and emit toxic gas, causing injury to persons.

# TOSHIBA

# TOSHIBA CORPORATION INDUSTRIAL AND POWER SYSTEM & SERVICES COMPANY

OVERSEAS SALES & MARKETING DEPT. ELECTRICAL APPARATUS & MEASUREMENT DIV.

1-1, Shibaura 1-chome, Minato-Ku, Tokyo 105-8001, Japan TEL: +81-(0)3-3457-4911 FAX: +8-(0)3-5444-9268

#### TOSHIBA INTERNATIONAL CORPORATION

13131 West Little York RD., Houston, TX 77041, U.S.A

TEL: +1-713-466-0277 FAX: +1-713-896-5226

### TOSHIBA ASIA PACIFIC PTE.. LTD

152 Beach Rd., #16-00 Gateway East, Singapore 189721 TEL: +65-6297-0900

FAX: +65-6297-5510

#### TOSHIBA CHINA CO., LTD

23rd Floor, HSBC Tower, 101 Yin Cheng East Road, Pudong New Area, Shanghai 200120, The People's Repubulic of China

TEL: +86-(0)21-6841-5666 FAX: +86-(0)21-6841-1161

## TOSHIBA INTERNATIONAL CORPORATION PTY., LTD

2 Morton Street Parramatta, NSW2150, Australia TEL: +61-(0)2-9768-6600

FAX: +61-(0)2-9890-7542

## TOSHIBA INFORMATION, INDUSTRIAL AND POWER SYSTEMS TAIWAN CORP.

6F, No66, Sec1 Shin Sheng N.RD, Taipei,

Taiwan

TEL: +886-(0)2-2581-3639 FAX: +886-(0)2-2581-3631

- For further information, please contact your nearest Toshiba Liaison Representative or International Operations - Producer Goods.
- The data given in this manual are subject to change without notice.

2004-10