Rooftop Solar PV System – Kampala Marriott Hotel
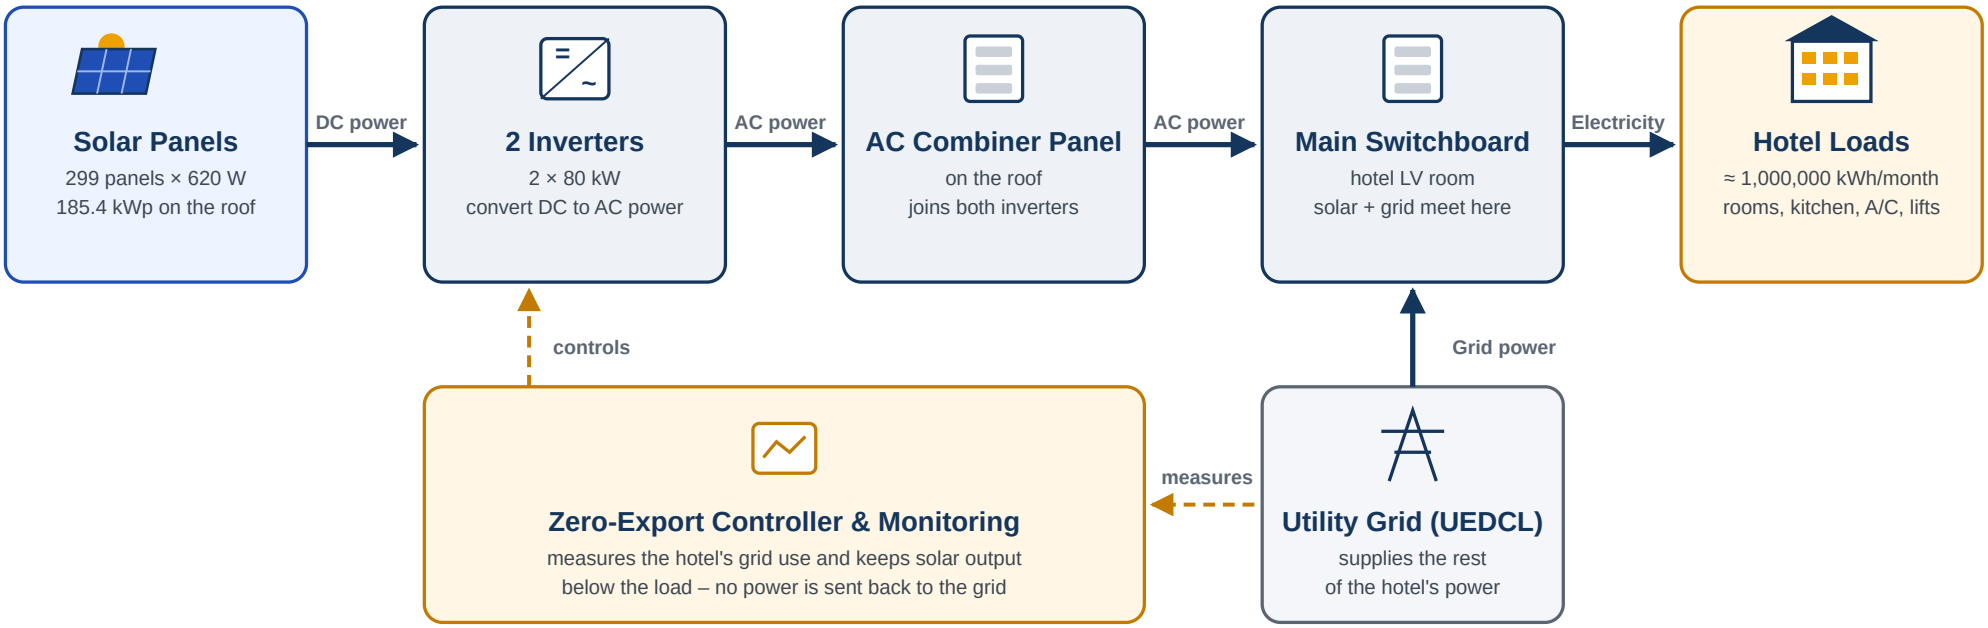
185.4 kWp grid-tied system · all solar energy used by the hotel · no battery