
SINGLE-LINE DIAGRAM – 185.4 kWp ROOFTOP SOLAR PV SYSTEM (GRID-TIED, ZERO EXPORT, NO BATTERY)

Kampala Marriott Hotel – mezzanine roof · 299 × 620 Wp modules · 2 × 80 kW string inverters

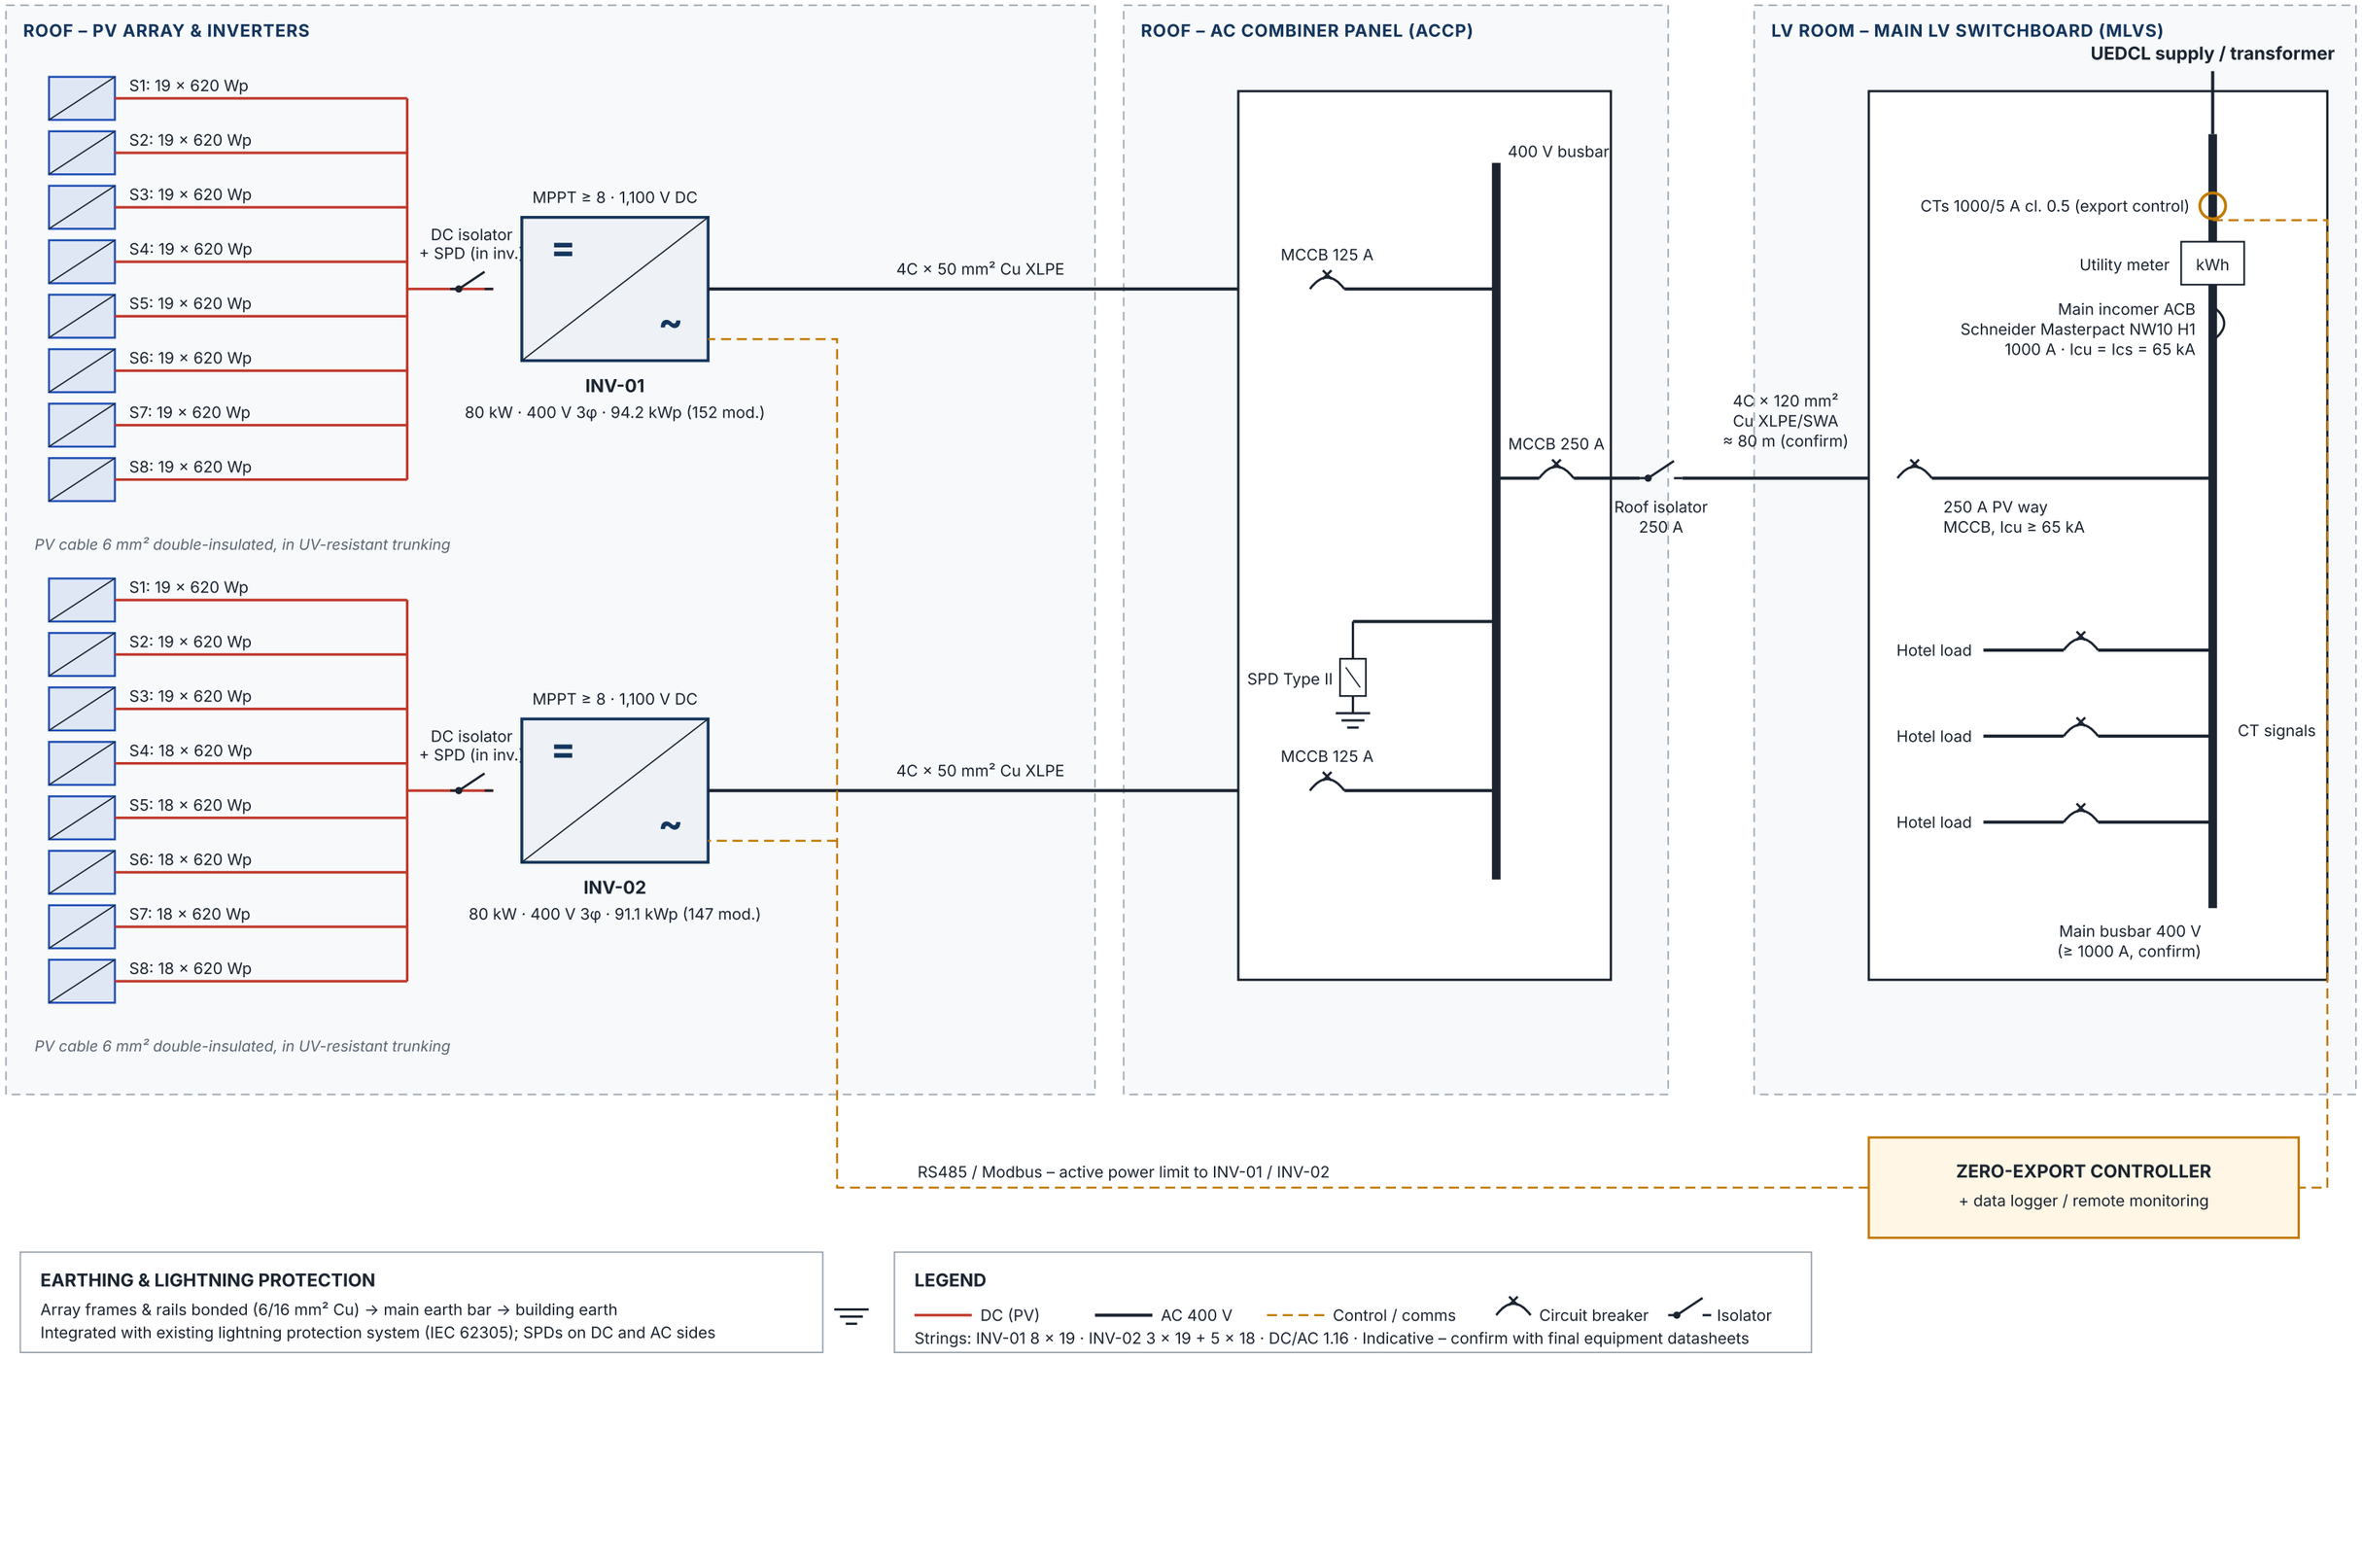

EARTHING & LIGHTNING PROTECTION

Array frames & rails bonded (6/16 mm² Cu) → main earth bar → building earth
Integrated with existing lightning protection system (IEC 62305); SPDs on DC and AC sides

LEGEND

DC (PV) · AC 400 V · Control / comms · Circuit breaker · Isolator

Strings: INV-01 8 × 19 · INV-02 3 × 19 + 5 × 18 · DC/AC 1.16 · Indicative – confirm with final equipment datasheets