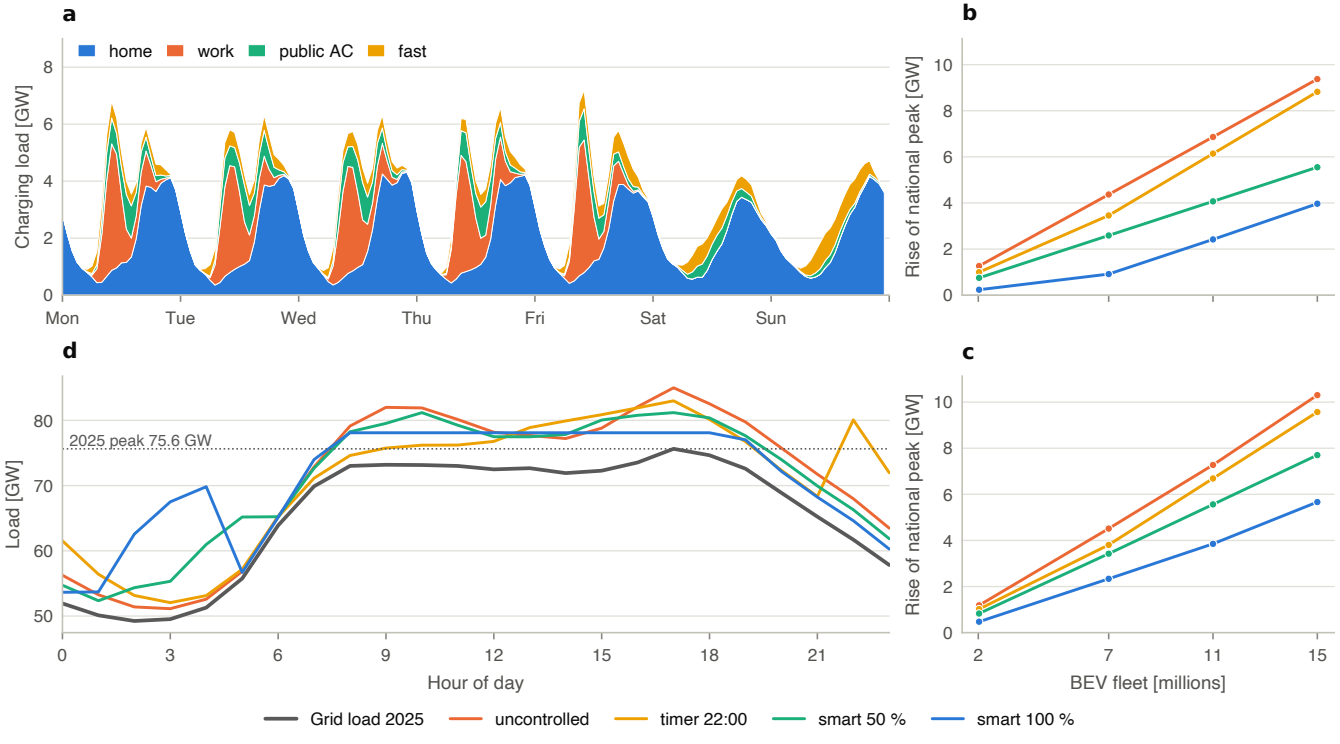
a
home
work
public AC
fast
Charging load [GW]
0
2
4
6
8
Mon
Tue
Wed
Thu
Fri
Sat
Sun
b
Rise of national peak [GW]
0
2
4
6
8
10
d
2025 peak 75.6 GW
Load [GW]
50
60
70
80
0
3
6
9
12
15
18
21
Hour of day
c
Rise of national peak [GW]
0
2
4
6
8
10
2
7
11
15
BEV fleet [millions]
Grid load 2025
uncontrolled
timer 22:00
smart 50 %
smart 100 %