

Water Separators


1,700 - 15,120 scfm



Installation Manual

TECHNICAL SPECIFICATION

1. Maximum Working Pressure
150 psi g (10 bar g)
2. Maximum Operating Temperature
200°F (93°C)
3. WSA800 - WSA7200
Inlet/Outlet connections: ANSI
B16.5 cl 150 RFSO flanges

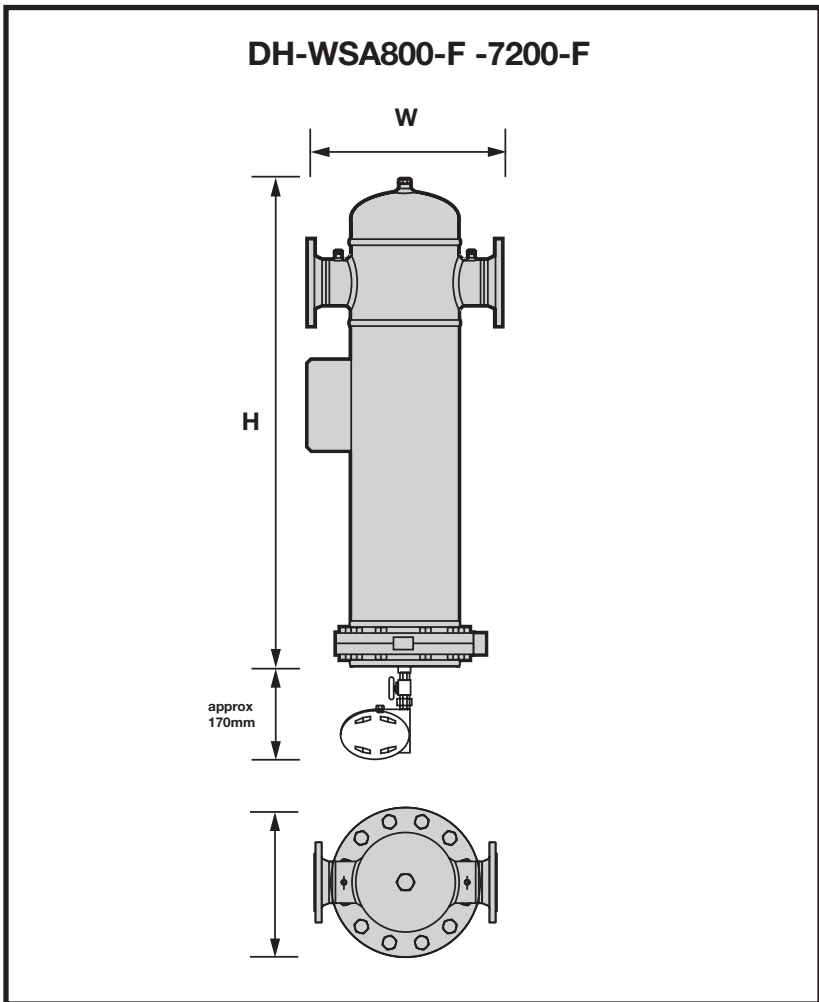

Model	Pipe Size	cfm	m ³ /min	m ³ /hr	L/S	Height (H)		Width (W)		Depth (D)		Weight	
						ins	mm	ins	mm	ins	mm	lbs	kg
DH-WSA800-F	3" Flg	1700	48.1	2888	802	44	1118	14	356	CF	CF	112	50.8
DH-WSA1000-F	4" Flg	2100	59.5	3568	991	48	1219	19	483	CF	CF	180	81.6
DH-WSA1800-F	6" Flg	3780	107	6422	1784	53	1346	22	559	CF	CF	257	116.6
DH-WSA3000-F	8" Flg	6300	178.4	10704	2973	54	1372	29	737	CF	CF	554	251.3
DH-WSA4800-F	10" Flg	10080	285.4	17126	4757	55	1397	29	737	CF	CF	711	322.5
DH-WSA7200-F	12" Flg	15120	428.2	25689	7136	61	1549	39	991	CF	CF	913	414.1

INSTALLATION, OPERATION & MAINTENANCE


ATTENTION:

Within the piping system, the filters should always be used where the air- or gas temperature is lowest. The piping system must be cleaned before the filters are assembled. The filters must always be installed vertically. Sufficient free space allocated (clearance) should be left at the bottom for the changing of filter elements.

Drains

A suitable drain must be fitted to the bottom of filter downstream of an isolation valve.

Automatic drain models should be inspected regularly to ensure correct drain operation.

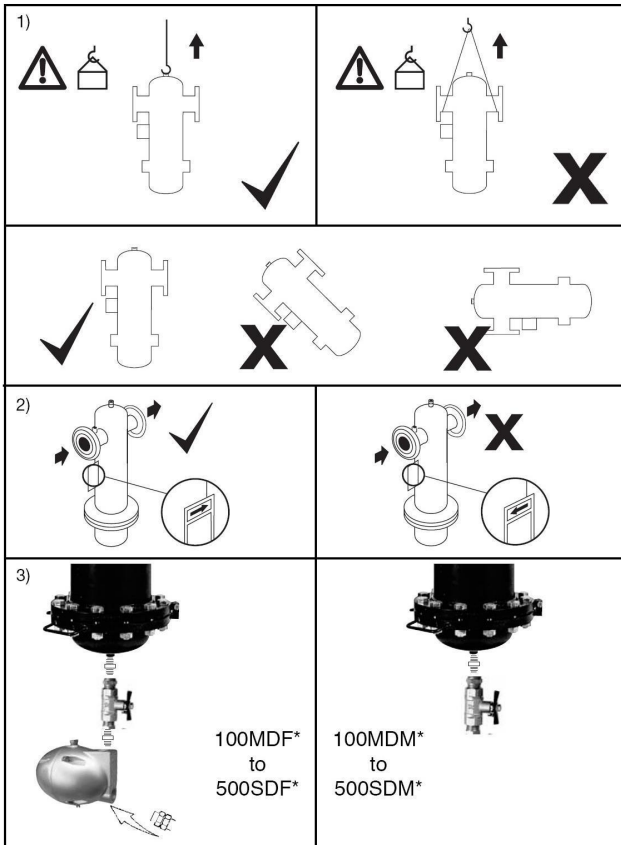

AUTOMATIC DRAINS

1. Isolate air (gas) supply by closing valve.
2. Depressurize drain by opening vent valve.
3. Drain can now be removed.
4. Dismantle drain by removing clamp ring - this is achieved by pressing tab on ring while turning.
5. When replacing drain DO NOT pressurize unit unless drain is properly fitted

MAINTENANCE & EXAMINATION RECORD

OWNERSHIP DATA

MODEL NO:

COMMISSIONED BY:
(please print)

SERIAL NO:

COMPANY NAME:

INSTALLATION DATE:

TELEPHONE NO:

COMMISSIONING DATE:

SERVICE PLAN:

INSPECTION/EXAMINATION		REPAIR/MAINTENANCE (IF ANY)	
Name	Signature	Date	Summary Remarks

Worldwide Filtration Manufacturing Locations

North America

Compressed Air Treatment Filtration & Separation/Balston

Haverhill, MA
978 858 0505
www.parker.com/balston

Finite Airtek Filtration Airtek/donnick hunter/Zander

Lancaster, NY
716 686 6400
www.parker.com/faf

Finite Airtek Filtration/Finite

Oxford, MI
248 628 6400
www.parker.com/finitefilter

Engine Filtration & Water Purification Racor

Modesto, CA
209 521 7860
www.parker.com/racor

Holly Springs, MS
662 252 2656
www.parker.com/racor

Beaufort, SC
843 846 3200
www.parker.com/racor

Village Marine, Sea Recovery, Horizon Reverse Osmosis

Carson, CA
310 637 3400
www.parker.com/watermakers

Hydraulic Filtration Hydraulic Filter

Metamora, OH
419 644 4311
www.parker.com/hydraulicfilter

Laval, QC Canada
450 629 9594
www.parkerfarr.com

Process Filtration donnick hunter Process Filtration

Oxnard, CA
805 604 3400
www.parker.com/processfiltration

Madison, WI
608 824 0500
www.scilog.com

Phoenixville, PA
610 933 1600
www.parker.com/processfiltration

Aerospace Filtration

Velcon Filtration
Colorado Springs, CO
719 531 5855
www.velcon.com

Europe

Compressed Air Treatment donnick hunter Filtration & Separation

Gateshead, England
+44 (0) 191 402 9000
www.parker.com/dhfn

Parker Gas Separations

Etten-Leur, Netherlands
+31 76 508 5300
www.parker.com/dhfn

Hiross Zander

Padova Business Unit
Padova, Italy
+39 049 9712 111
www.parker.com/hzd

Hiross Zander

Essen Business Unit
Essen, Germany
+49 2054 9340
www.parker.com/hzd

Engine Filtration & Water Purification Racor

Dewsbury, England
+44 (0) 1924 487 000
www.parker.com/rfde

Racor Research & Development

Stuttgart, Germany
+49 (0)711 7071 290-10
www.parker.com/rfde

Hydraulic Filtration

Hydraulic Filter
Arnhem, Holland
+31 26 3760376
www.parker.com/hfde

Urjala Operation

Urjala, Finland
+358 20 753 2500
www.parker.com/hfde

Condition Monitoring Centre

Norfolk, England
+44 (0) 1842 763 299
www.parker.com/hfde

Parker Kittiwake

West Sussex, England
+44 (0) 1903 731 470
www.kittiwake.com

Parker Procal

Peterborough, England
+44 (0) 1733 232 495
www.kittiwake.com

Process Filtration

donnick hunter Process Filtration
Birtley, England
+44 (0) 191 410 5121
www.parker.com/processfiltration

Parker Twin Filter BV

Zaandam, Netherlands
+31(0)75 655 50 00
www.twinfilter.com

Asia Pacific

Australia

Castle Hill, Australia
+61 2 9634 7777
www.parker.com/australia

China

Shanghai, China
+86 21 5031 2525
www.parker.com/china

India

Navi Mumbai, India
+91 22 651 370 8185
www.parker.com/india

Parker Fowler

Bangalore, India
+91 80 2783 6794
www.johnfowlerindia.com

Japan

Tokyo, Japan
+81 45 870 1522
www.parker.com/japan

Parker Techno

Osaka, Japan
+81 66 340 1600
www.techno.taiyo-ltd.co.jp

Korea

Hwaseon-City
+82 31 359 0852
www.parker.com/korea

Singapore

Jurong Town, Singapore
+65 6887 6300
www.parker.com/singapore

Thailand

Bangkok, Thailand
+66 2186 7000
www.parker.com/thailand

Latin America

Parker Comercio Ltda. Filtration Division

Sao Paulo, Brazil
+55 12 4009 3500
www.parker.com/br

Pan American Division

Miami, FL
305 470 8800
www.parker.com/panam

Africa

Aeroporto Kempton Park, South Africa
+27 11 9610700
www.parker.com/africa

Parker Hannifin Corporation
Finite Airtek Filtration Division
4087 Walden Avenue
Lancaster, NY 14086
phone 716 686 6400
www.parker.com/faf

