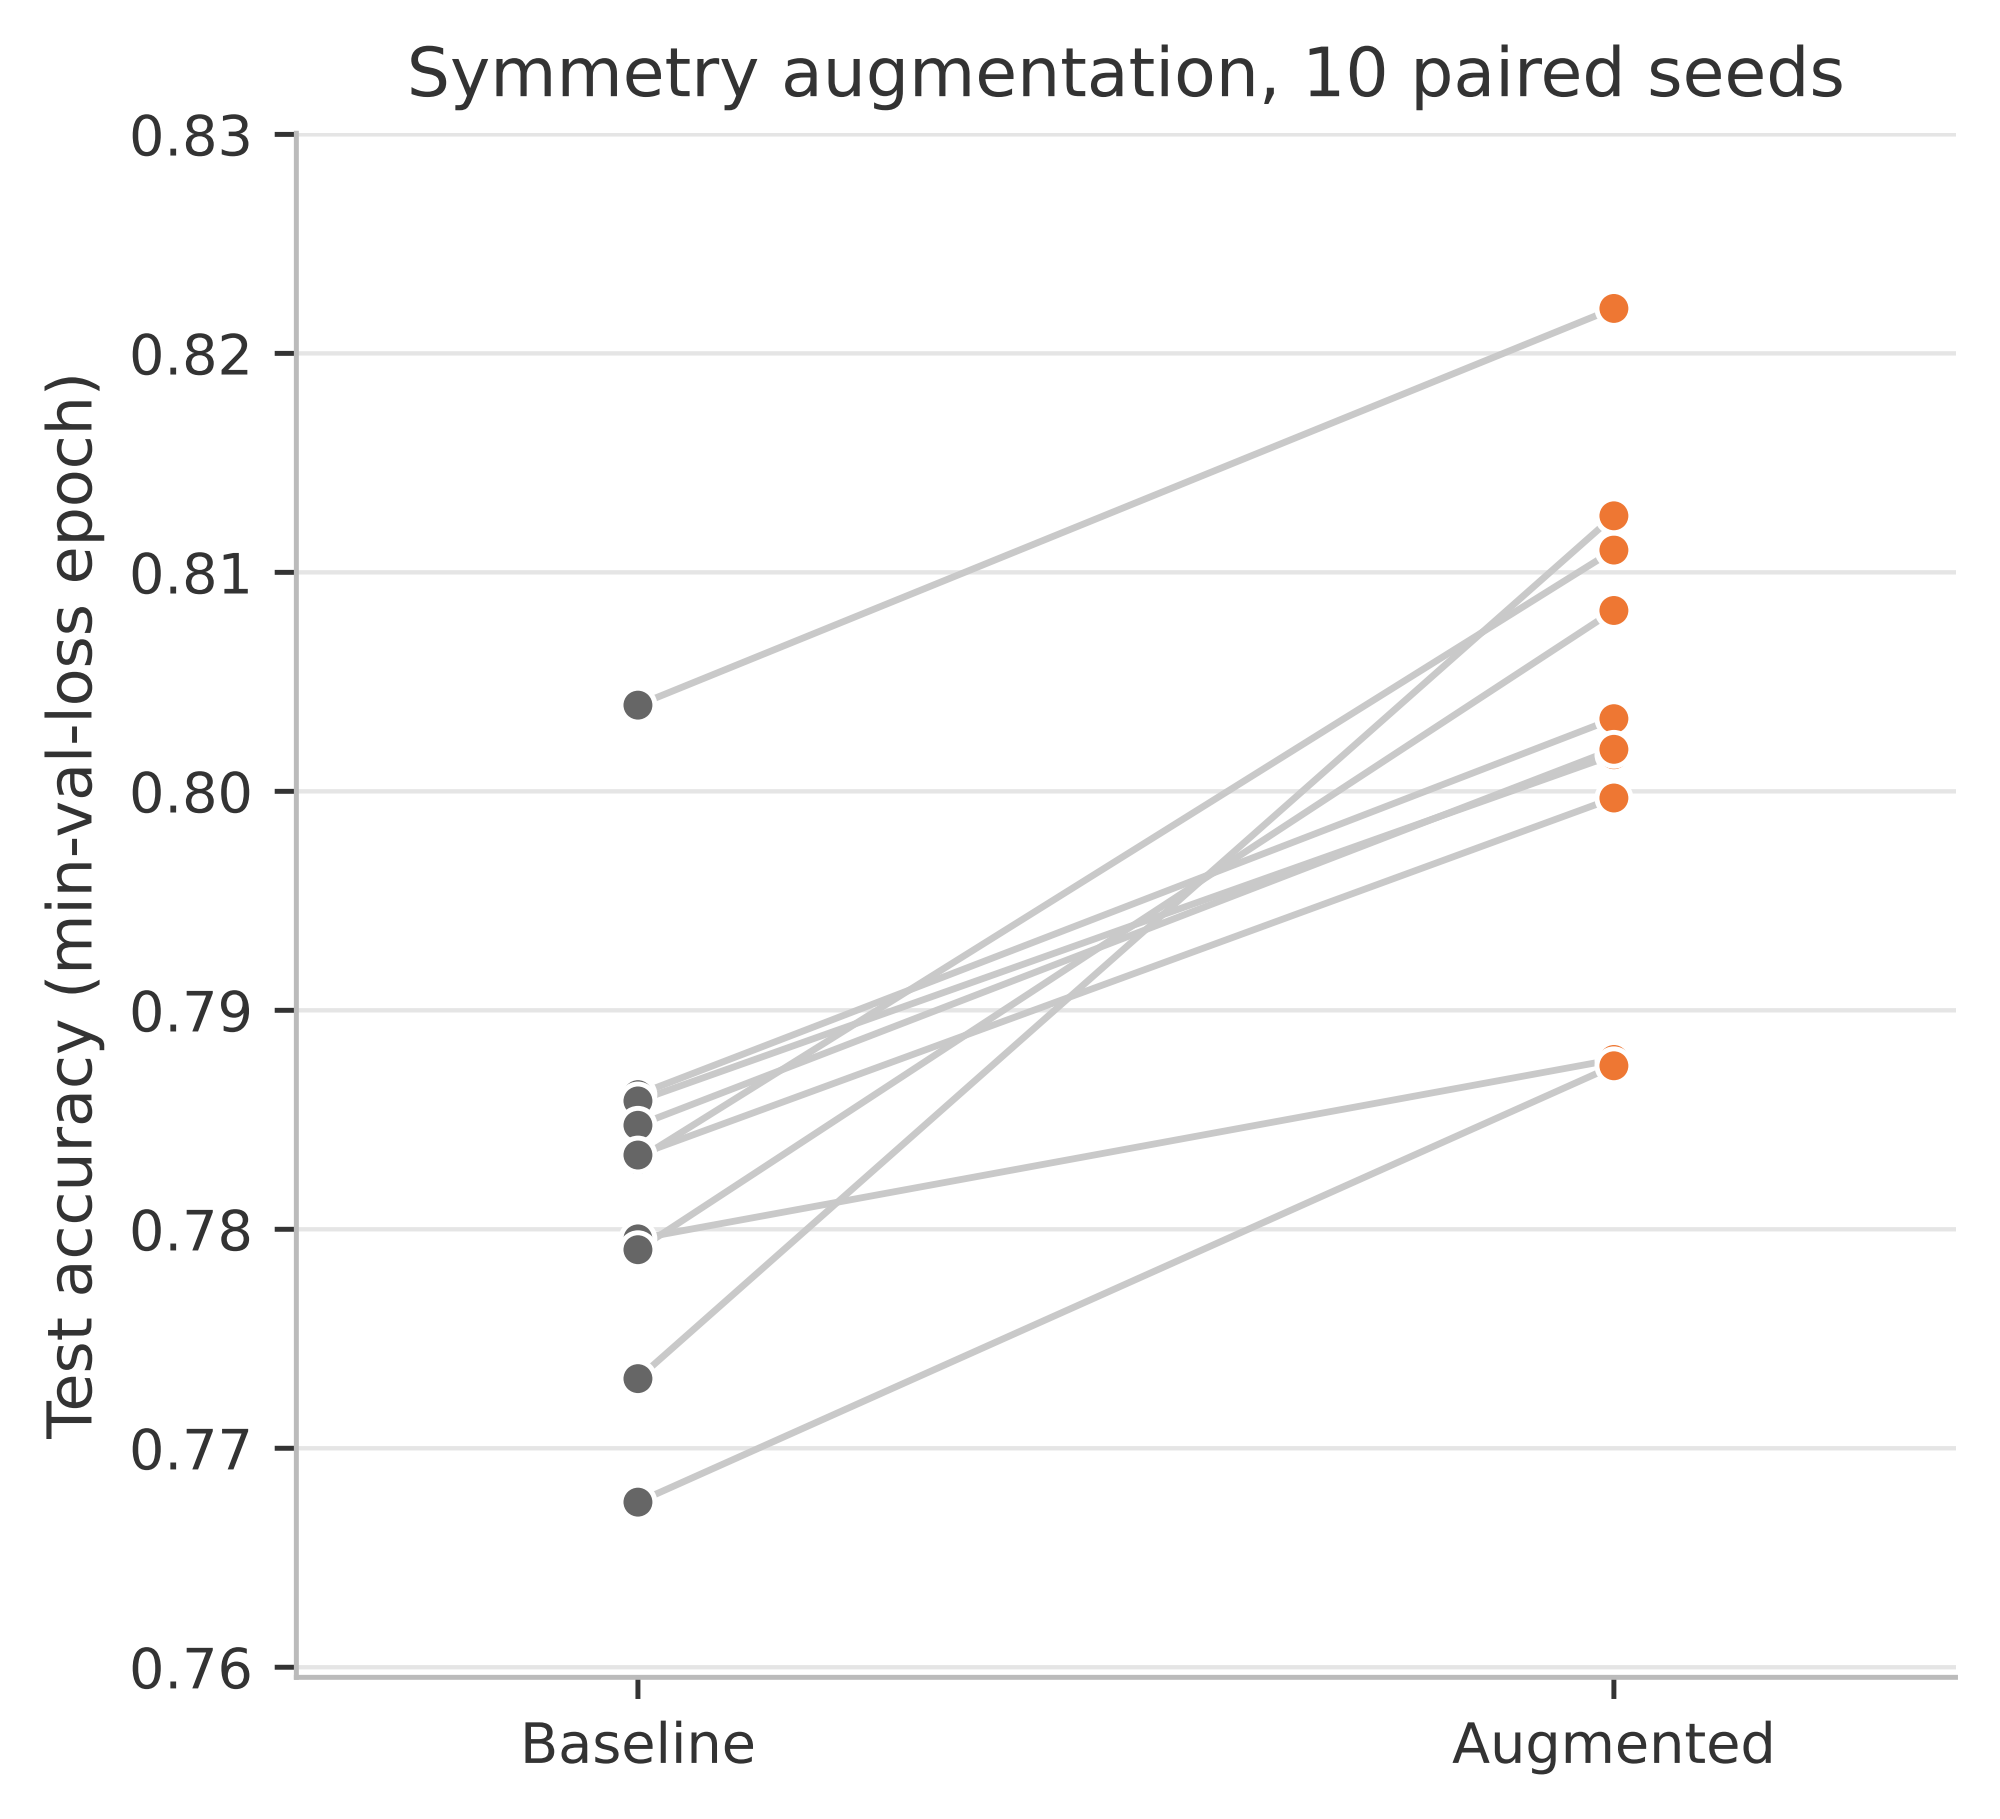
Symmetry augmentation, 10 paired seeds
Test accuracy (min-val-loss epoch)
0.83
0.82
0.81
0.80
0.79
0.78
0.77
0.76
Baseline
Augmented