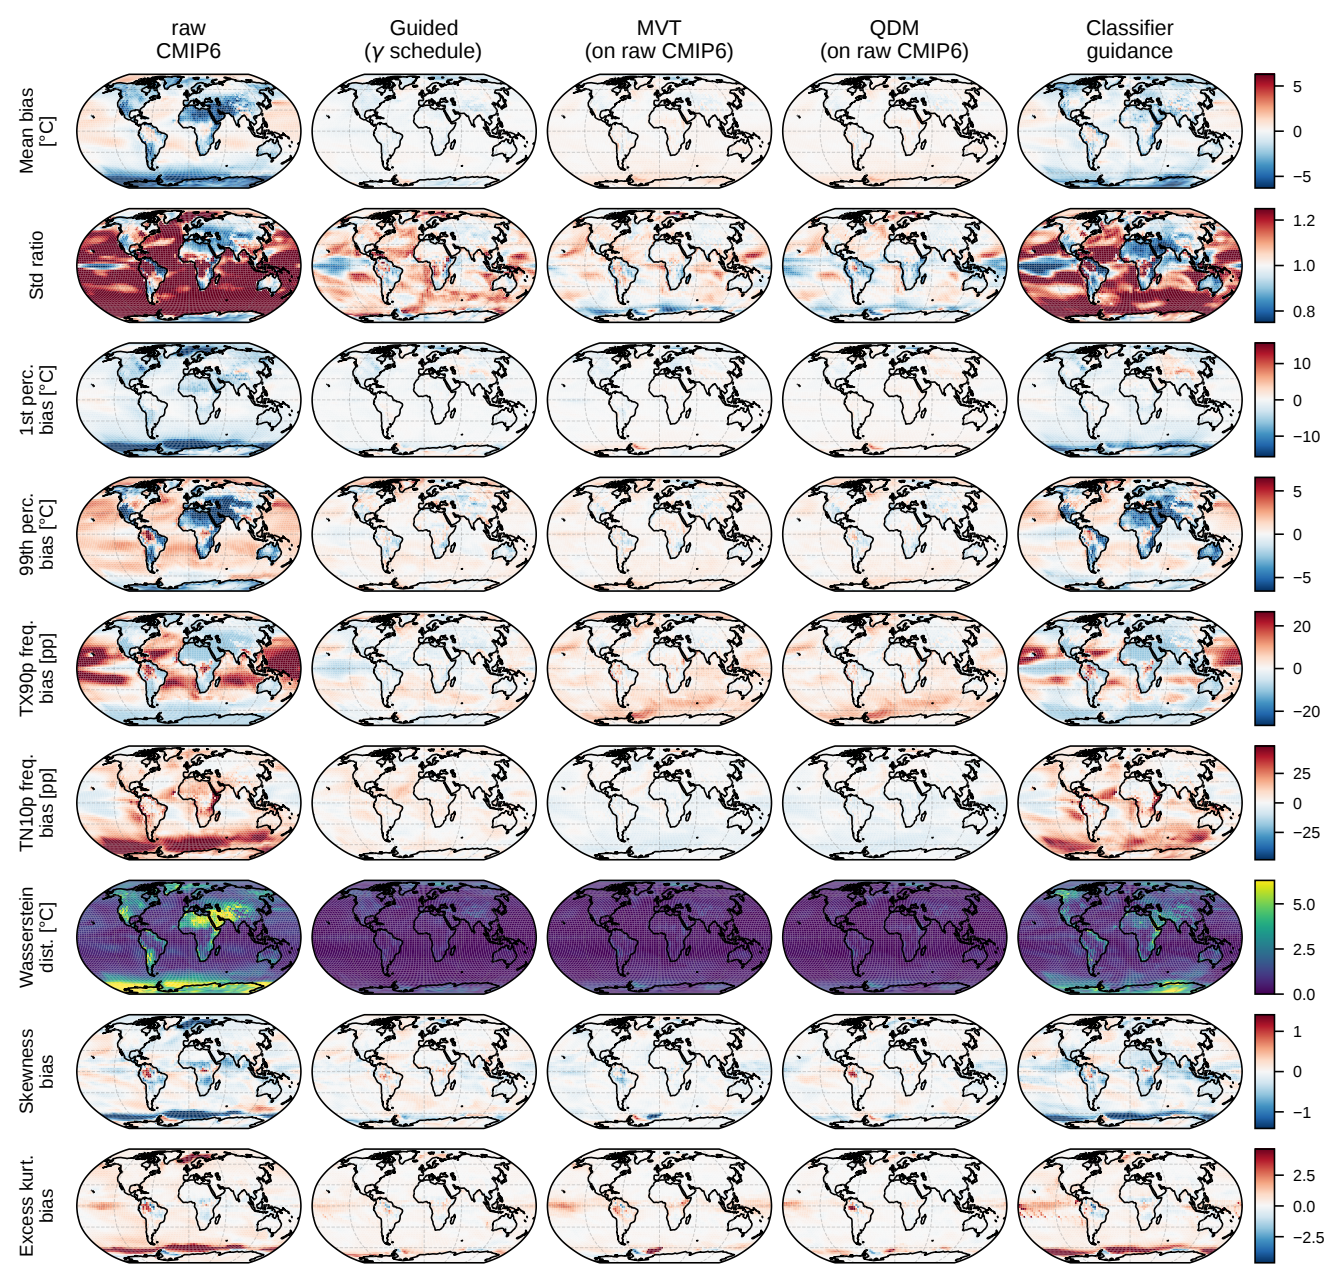

raw CMIP6
Guided (γ schedule)
MVT (on raw CMIP6)
QDM (on raw CMIP6)
Classifier guidance
Mean bias [°C]
5
0
−5
Std ratio
1.2
1.0
0.8
1st perc. bias [°C]
10
0
−10
99th perc. bias [°C]
5
0
−5
TX90p freq. bias [pp]
20
0
−20
TN10p freq. bias [pp]
25
0
−25
Wasserstein dist. [°C]
5.0
2.5
0.0
Skewness bias
1
0
−1
Excess kurt. bias
2.5
0.0
−2.5