


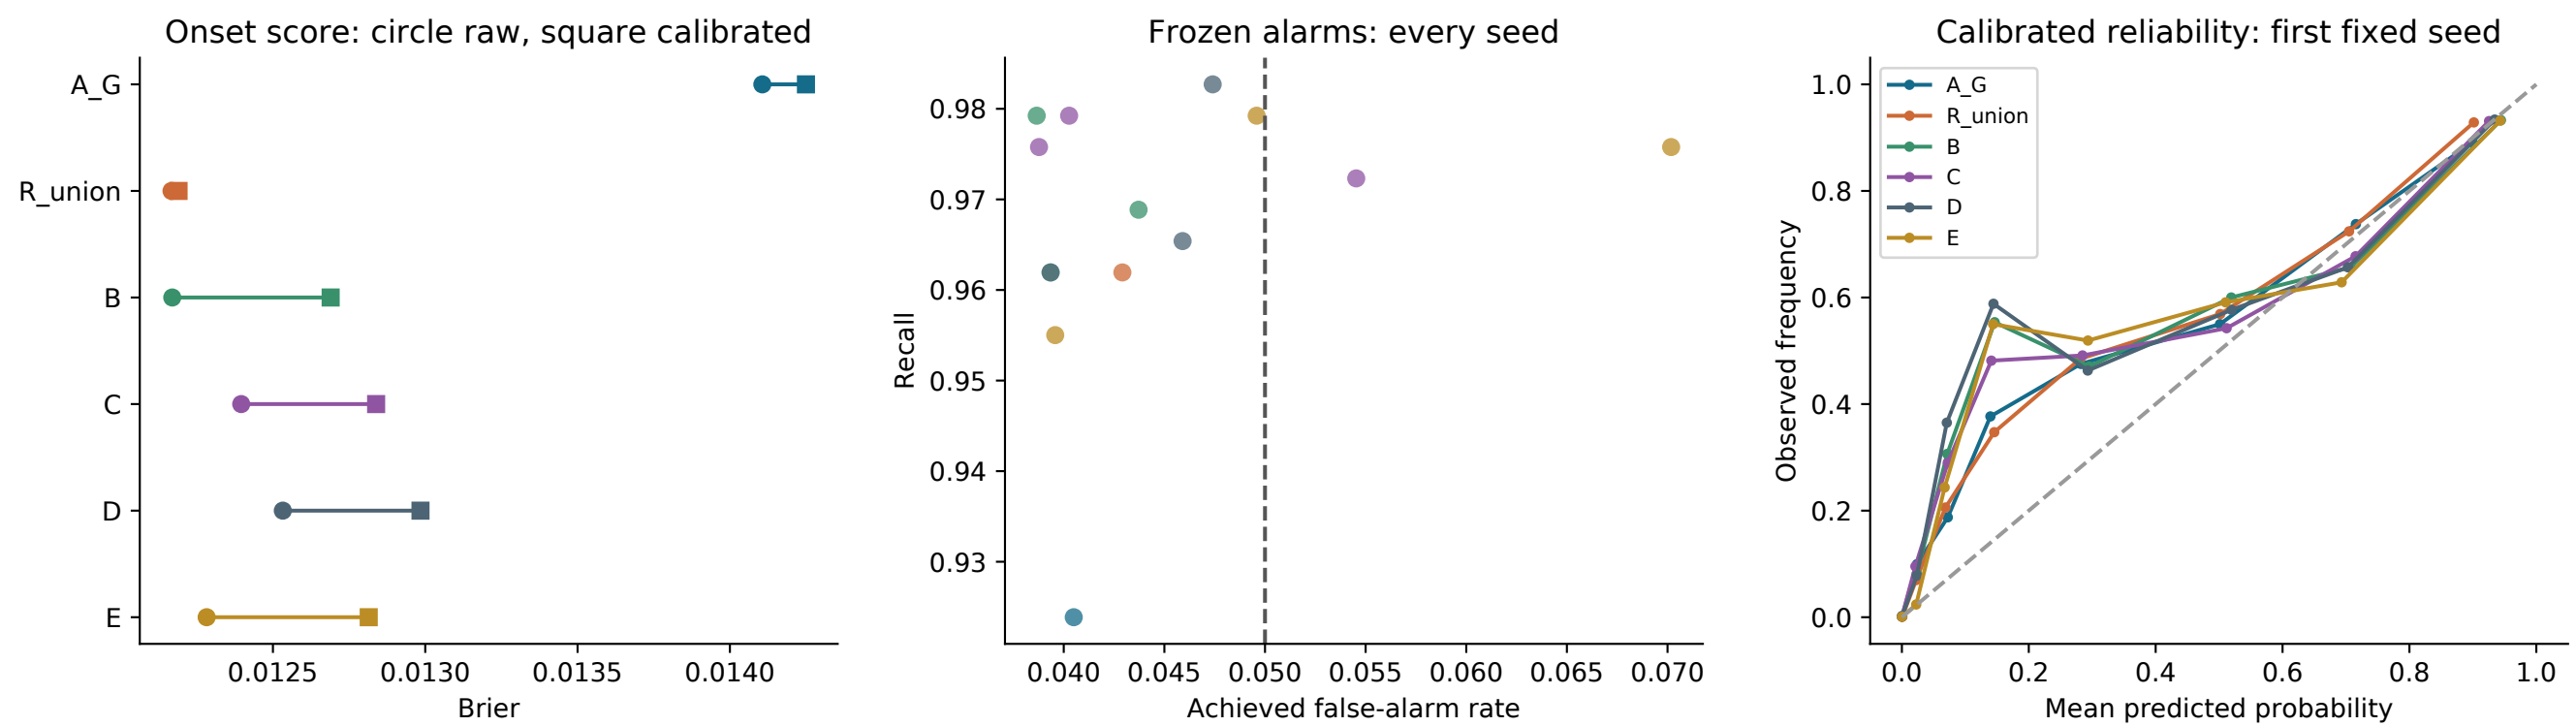

Calibration fit on Apr 2-9 training data (30 onset positives in five groups); alarms exclude cutoff ties. Reliability bins have unequal support.