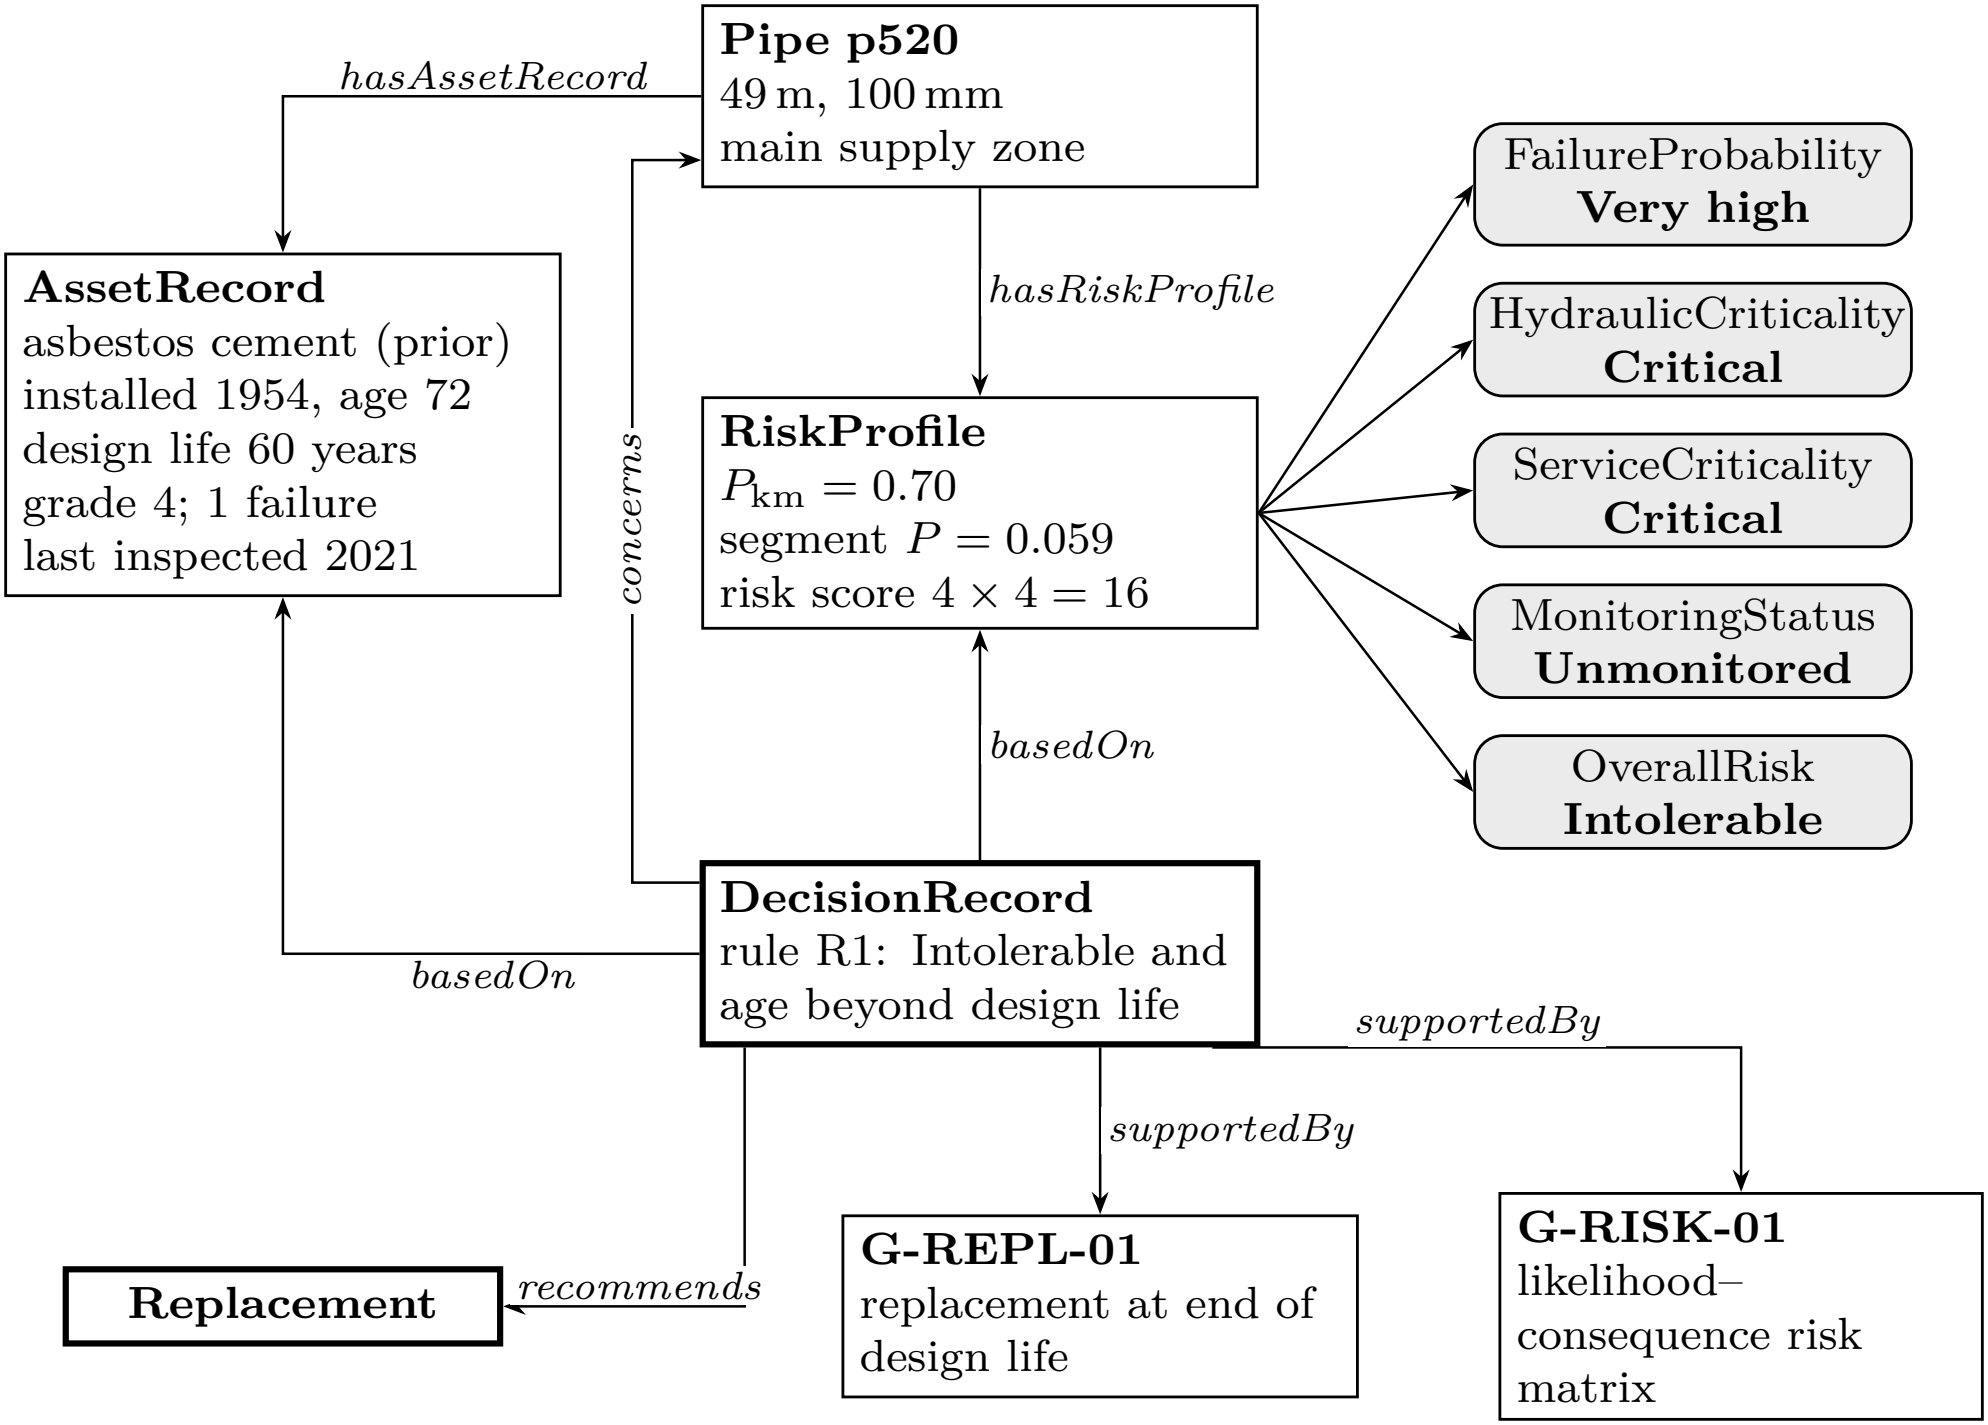

Pipe p520
49 m, 100 mm
main supply zone
hasAssetRecord
AssetRecord
asbestos cement (prior)
installed 1954, age 72
design life 60 years
grade 4; 1 failure
last inspected 2021
hasRiskProfile
RiskProfile
$P_{\mathrm{km}} = 0.70$
segment $P = 0.059$
risk score $4 \times 4 = 16$
FailureProbability
Very high
HydraulicCriticality
Critical
ServiceCriticality
Critical
MonitoringStatus
Unmonitored
OverallRisk
Intolerable
concerns
basedOn
DecisionRecord
rule R1: Intolerable and
age beyond design life
basedOn
supportedBy
supportedBy
recommends
Replacement
G-REPL-01
replacement at end of
design life
G-RISK-01
likelihood–
consequence risk
matrix