



# Water Station Pump


Total Water Distributed

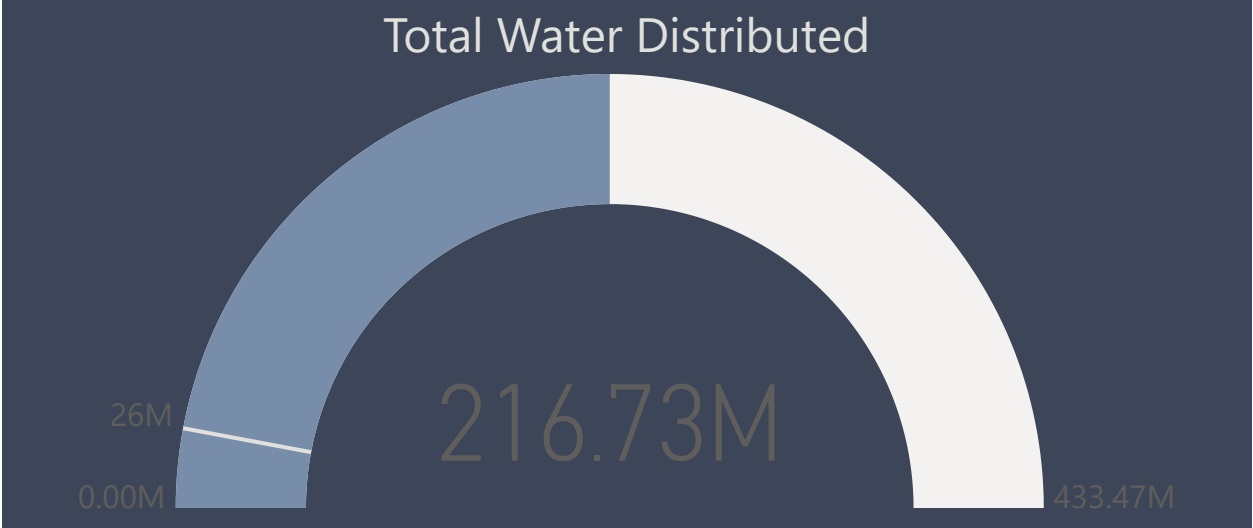


Physical Loss

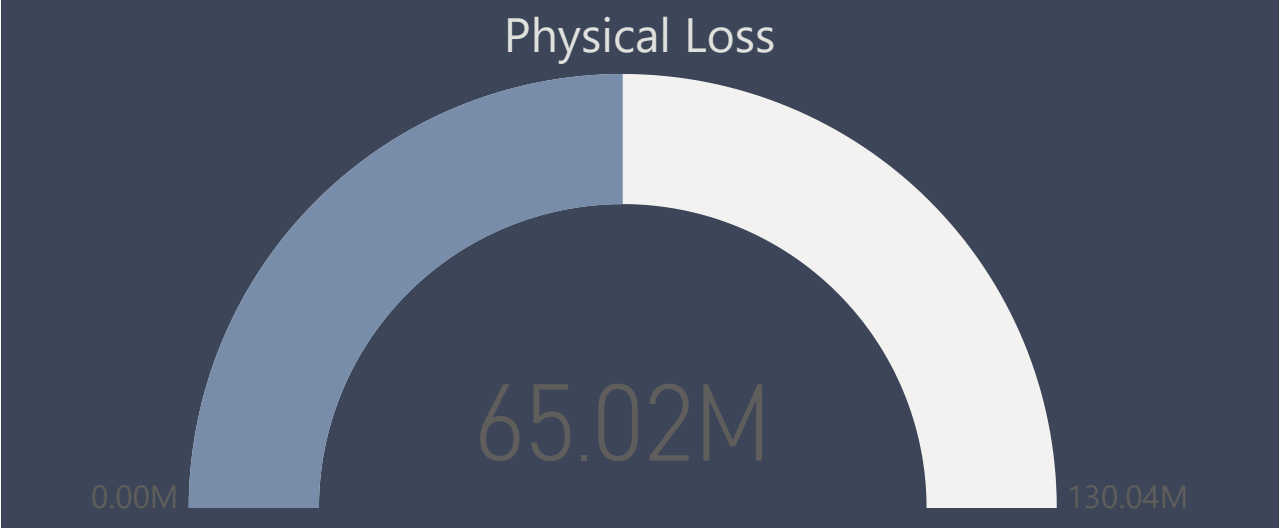

Unmetered Consumption

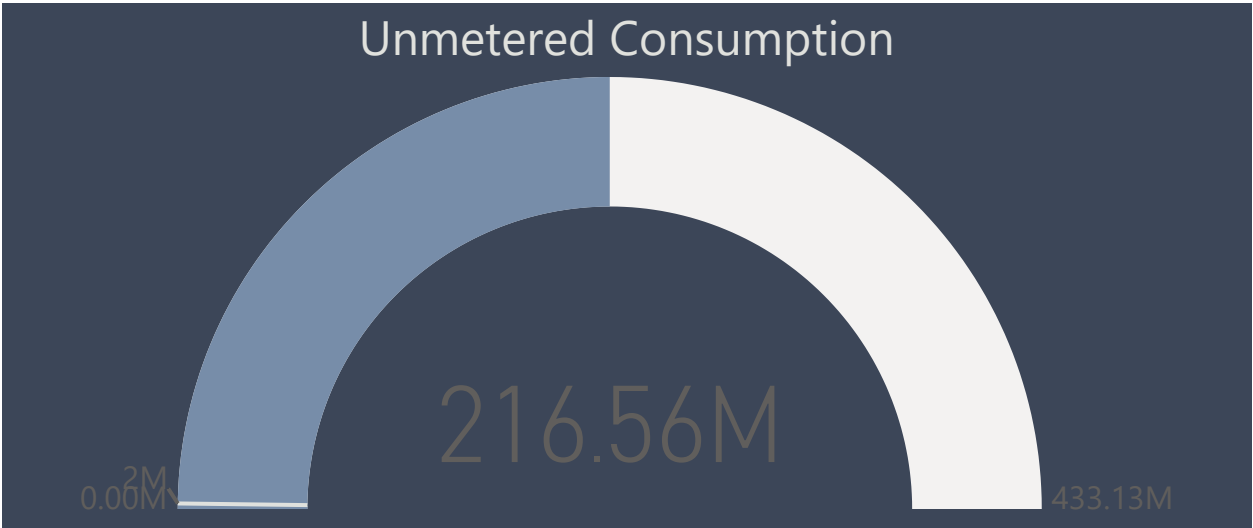

Metered Consumption

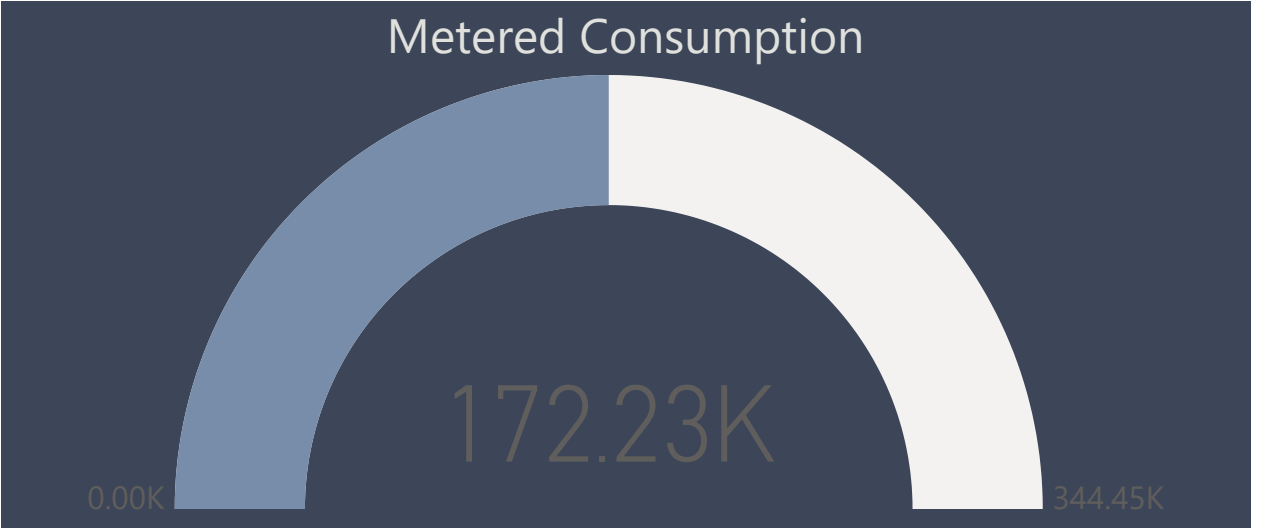

# Water Station Pump

Revenue water

244.26bn

0.00bn

488.52bn

Water Leakage

13.00M

0.00M

26.01M

Non Revenue Water

22.43M

0.00M

44.86M

Meter Insensitive Water Volume


21.66M

0.00M


43.31M

# Commercial Loss by Year

Statistic	Value
Maximum	6286720.0750
Mean	4736232.3812
Minimum	86105.7250
Sigma of Individuals	3100084.4547
Estimated Sigma	1832332.8457
Skewness	-0.7500

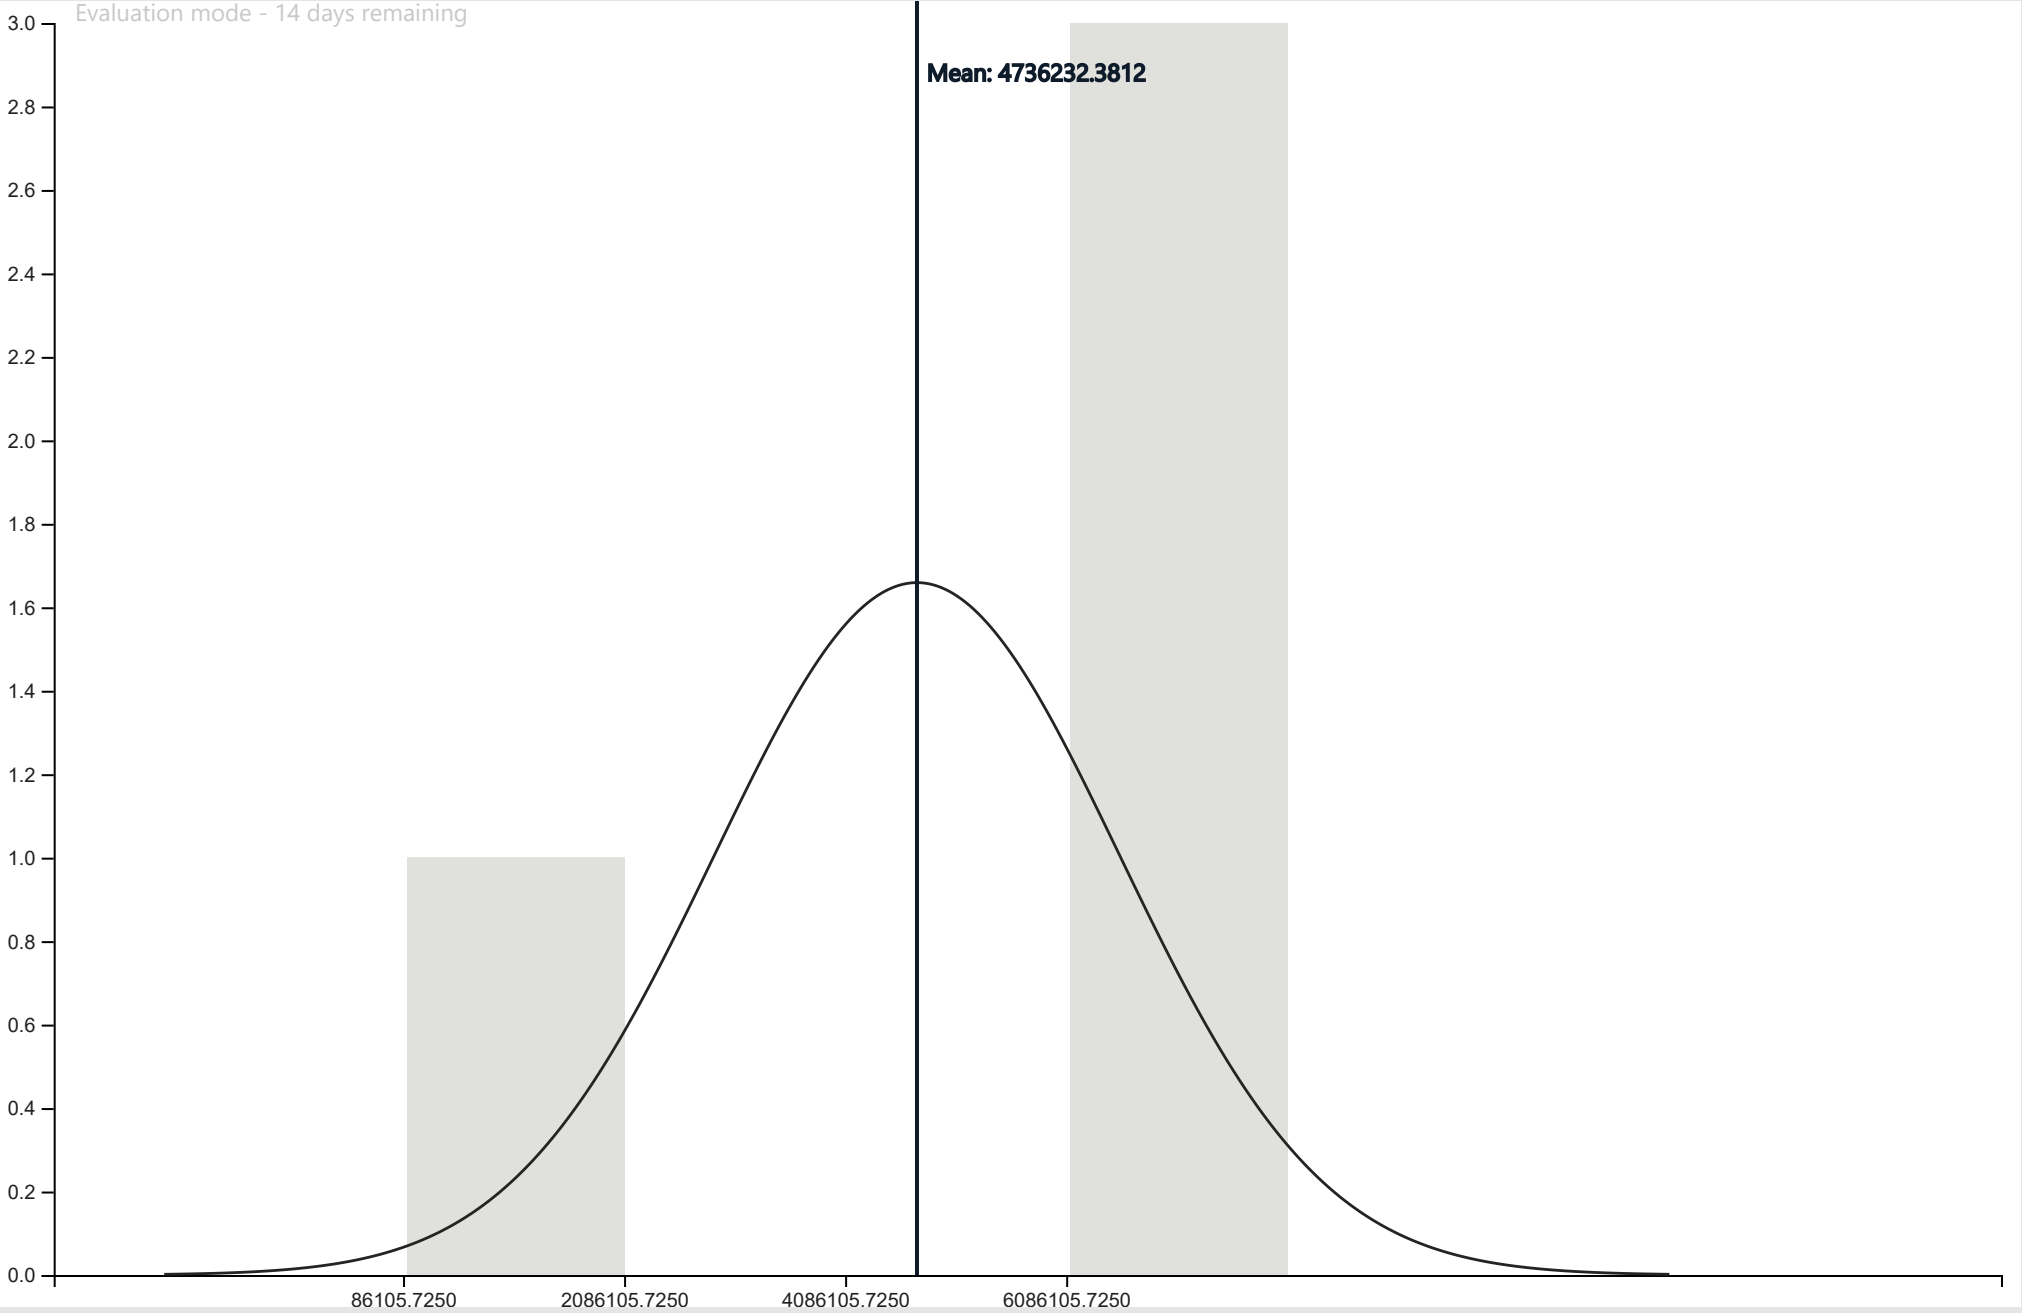

revenue water by Year

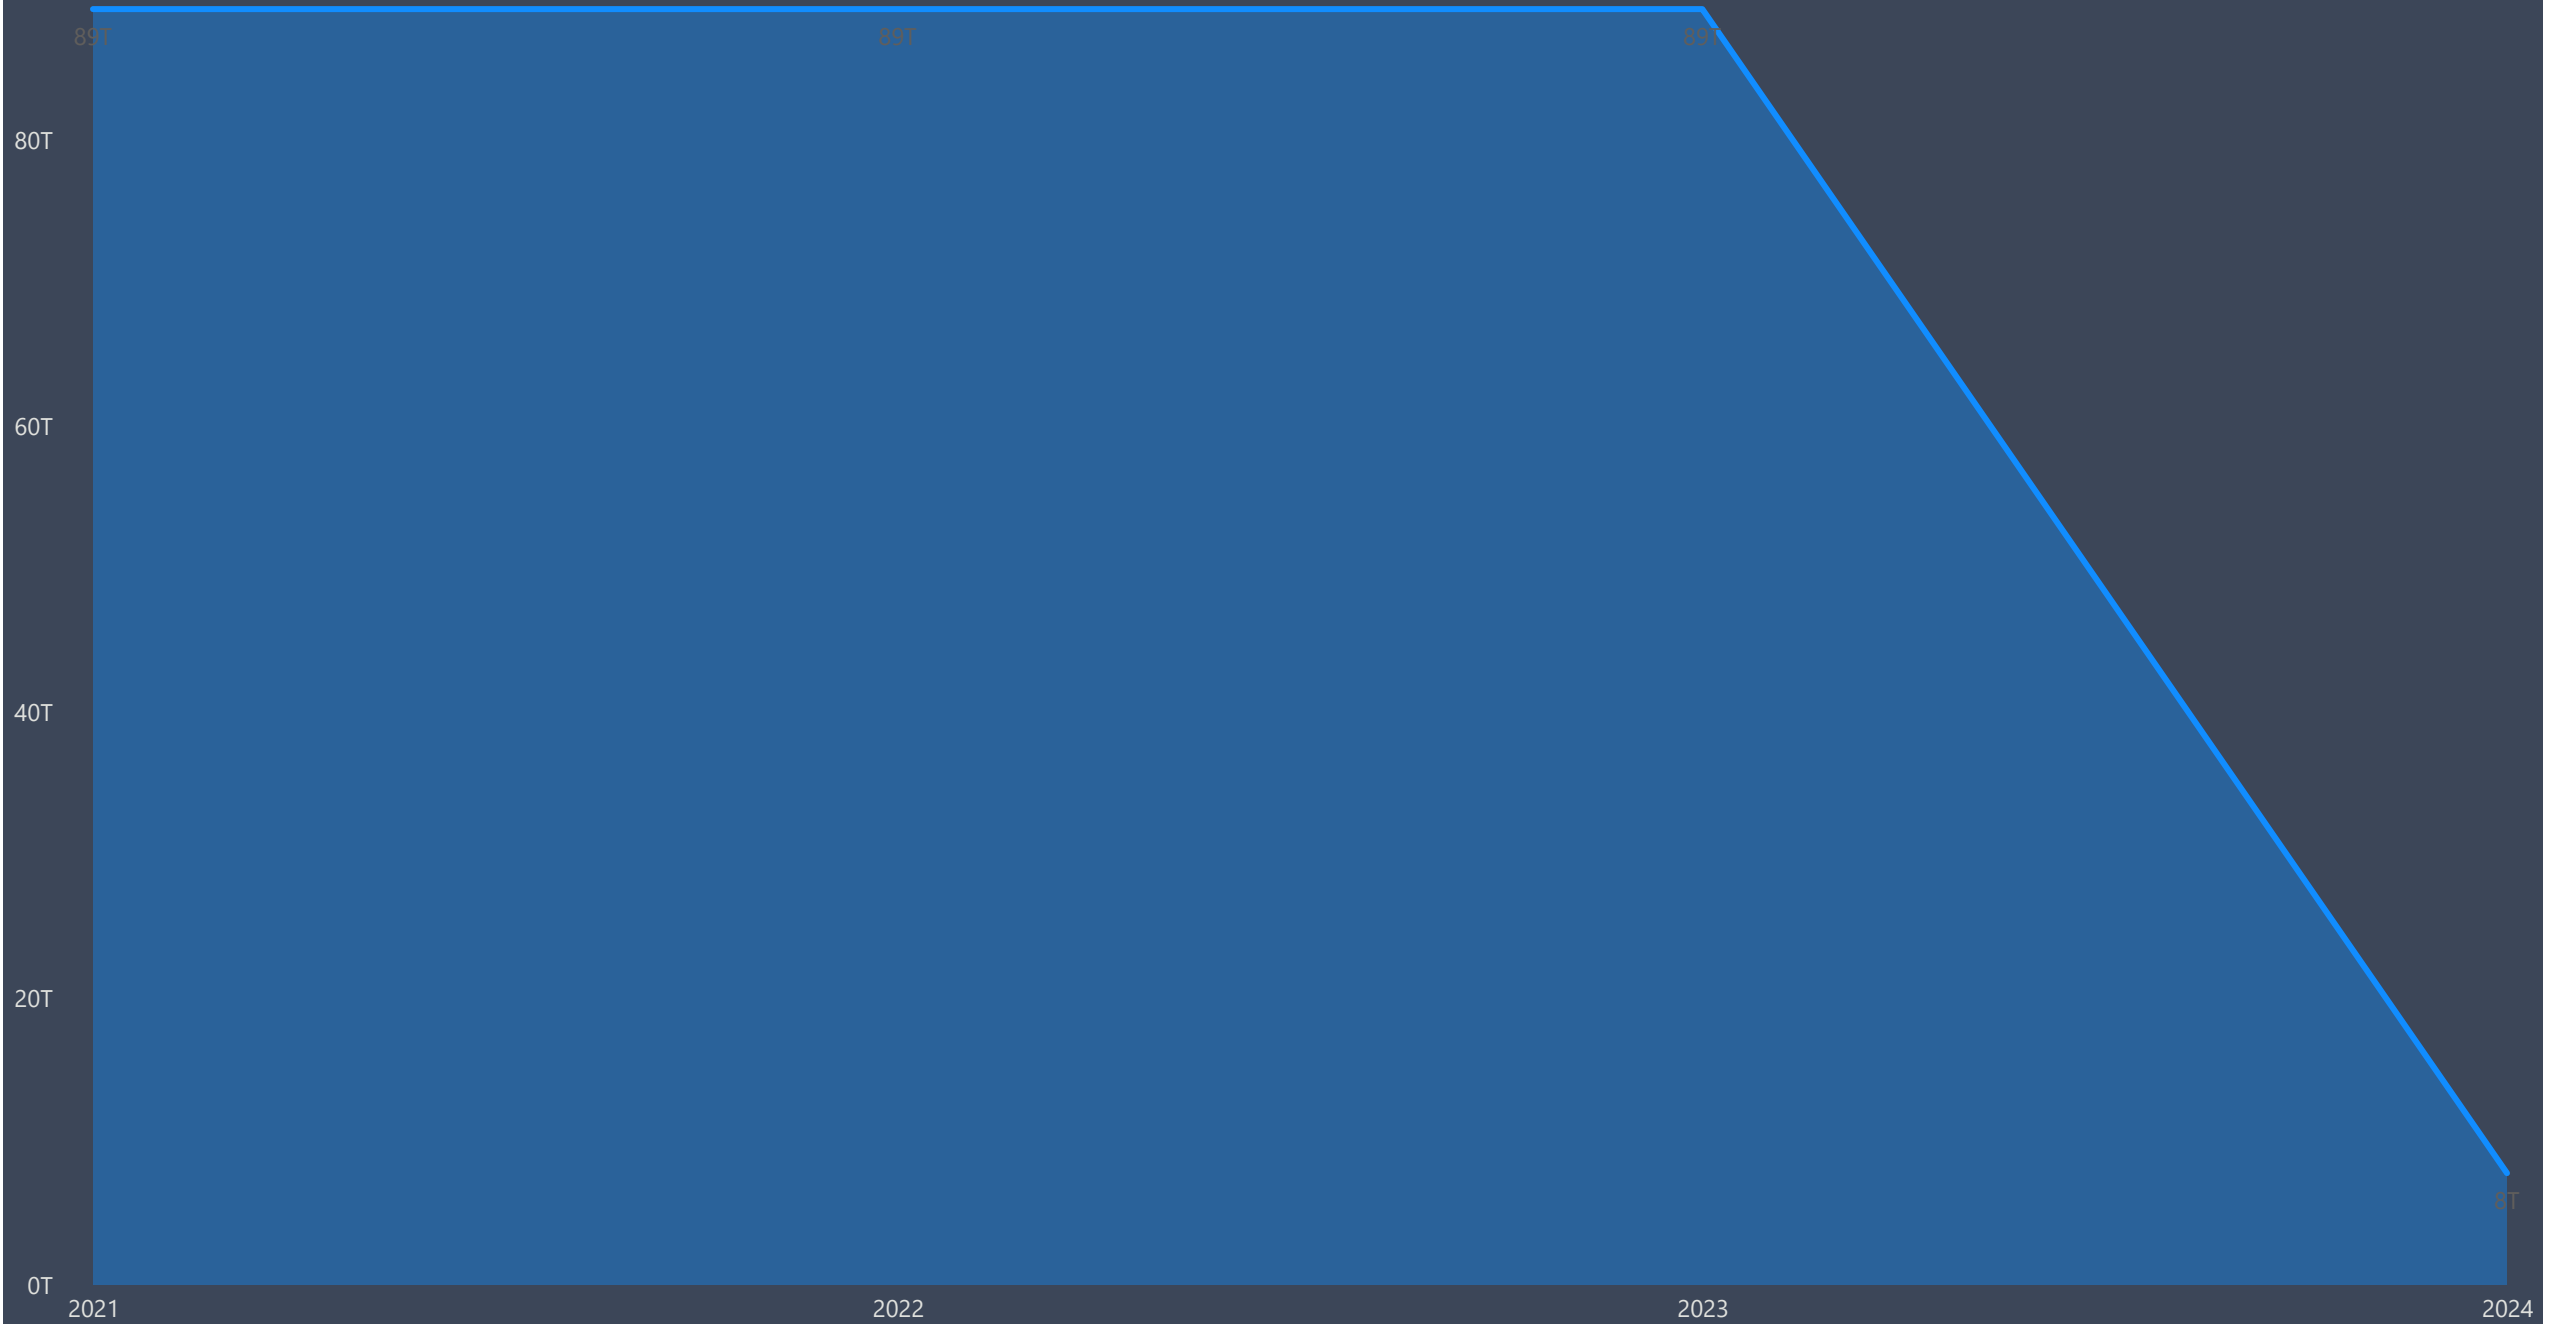

Total Water Distributed,Metered Consumption, Unmetered Consumption Physical Loss

