
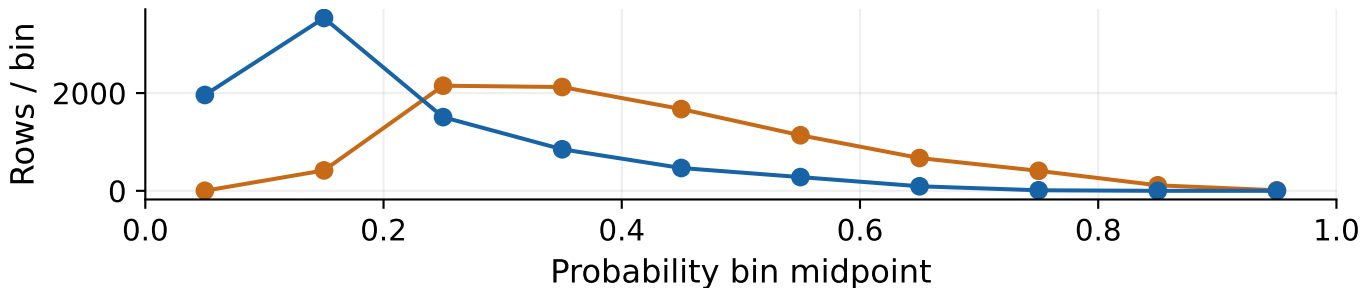


Reliability · nested group-aware training CV

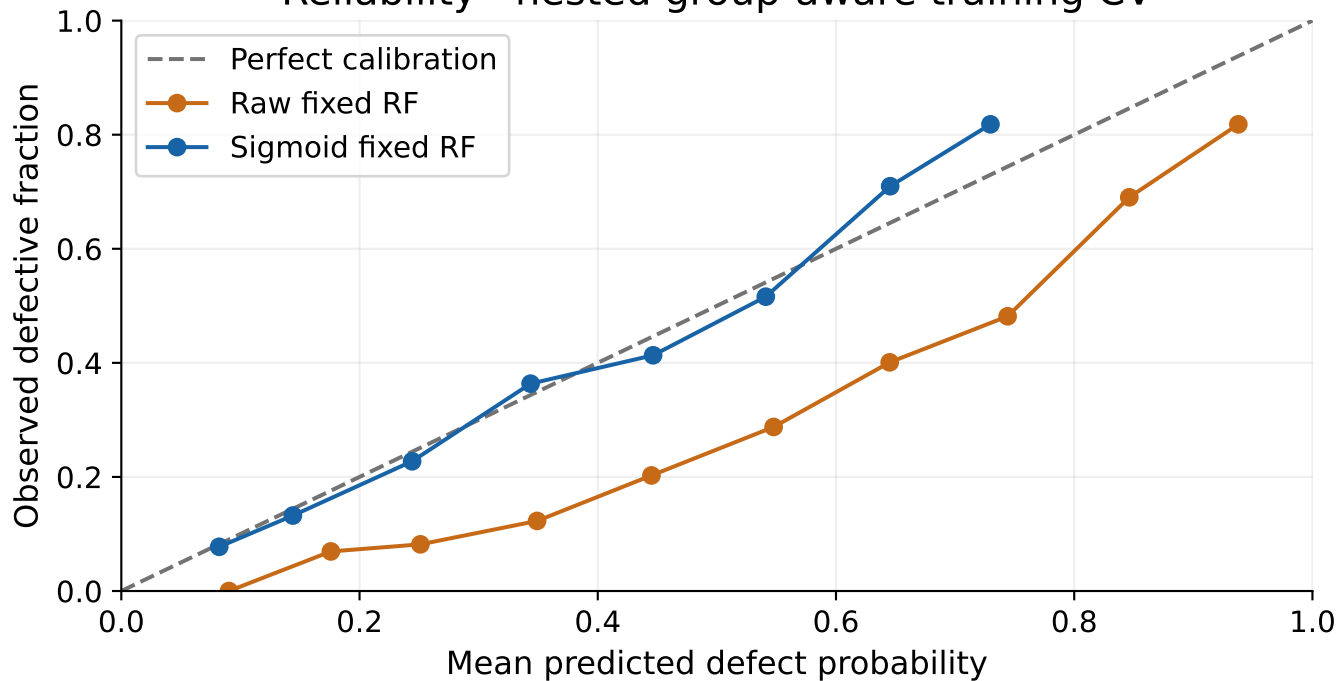

Brier: raw 0.18692 → sigmoid 0.13863. Calibration is evaluated on outer held-out rows.
Ten equal-width bins; sparse tails are not confidence guarantees. Historical test excluded.