



Original (pseudo-gradient) vs corrected (exact-gradient hybrid) AVC
identical closed loop, 120 nm @ 47 Hz vibration, only the state-update differs


(a) Cancellation: 47 Hz residual amplitude

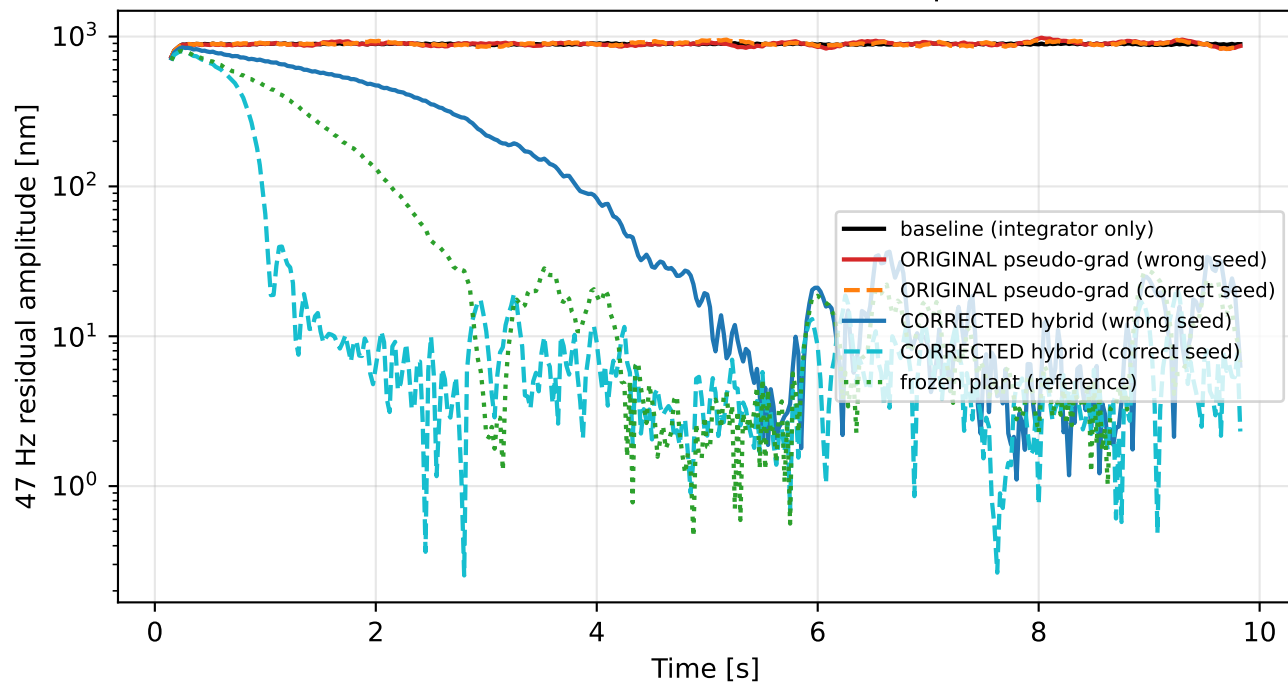


(b) Plant estimate MAGNITUDE

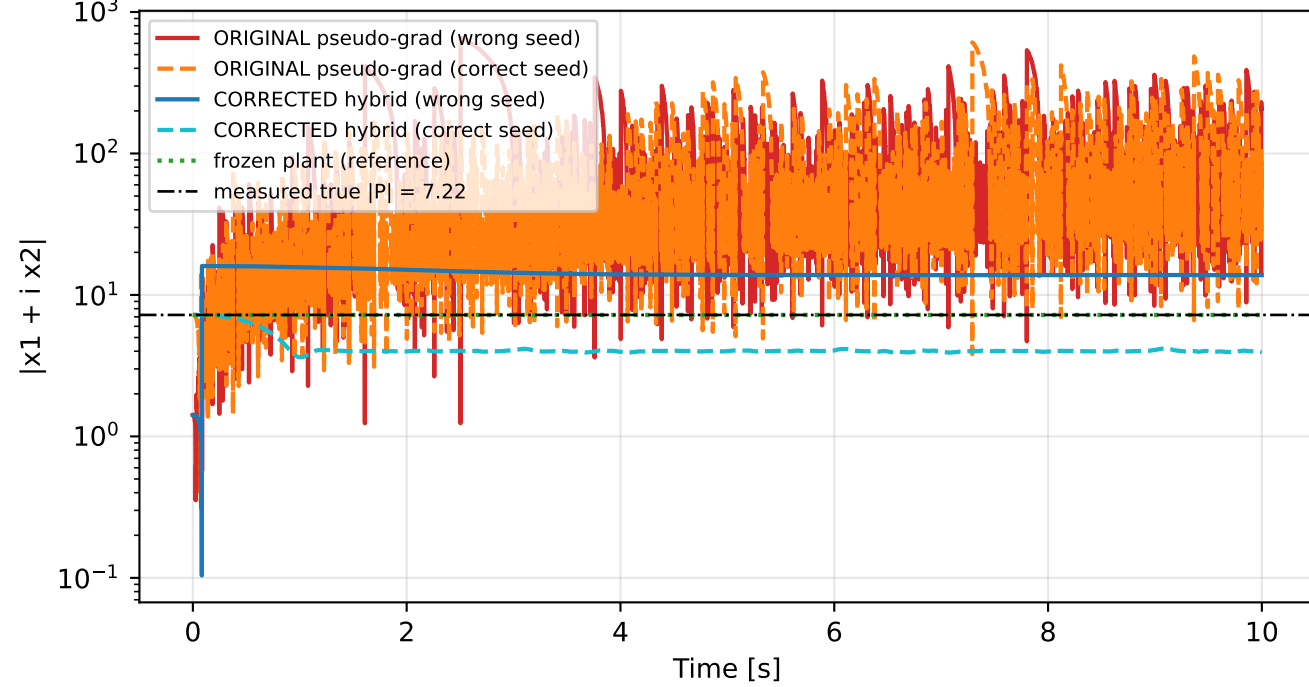


(c) Plant estimate PHASE (hybrid: frozen at seed; original: wanders)

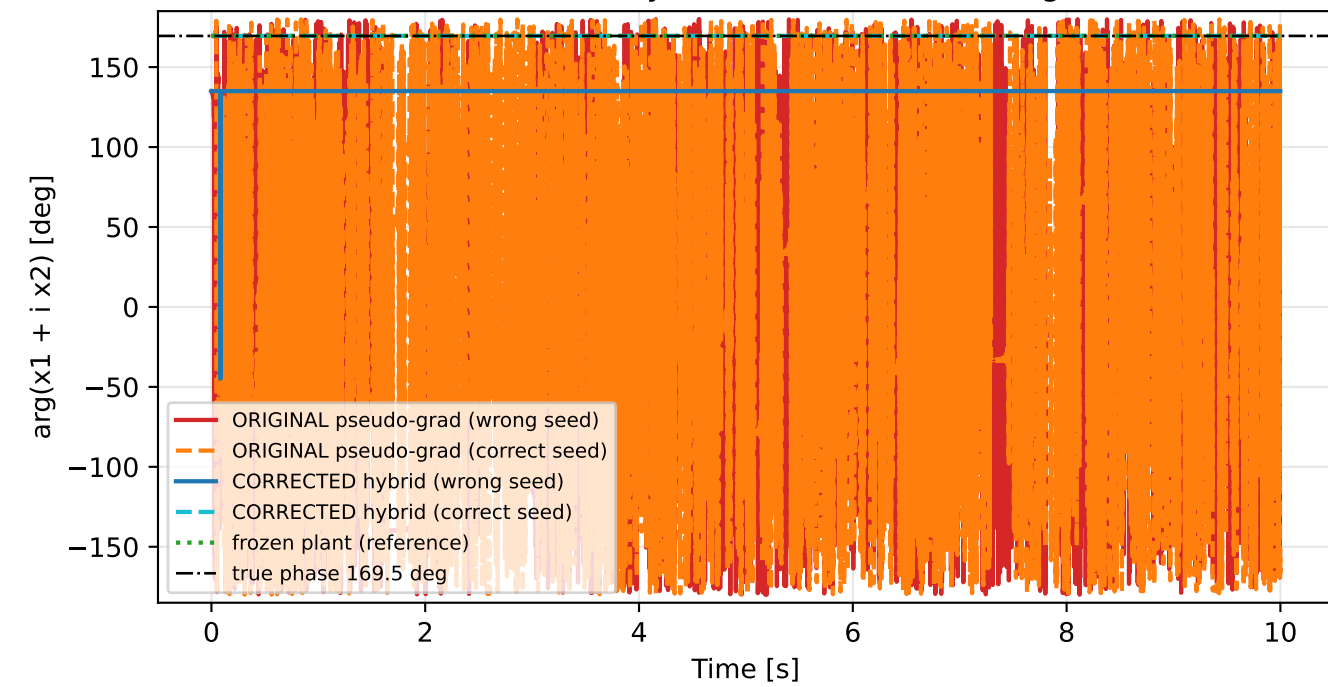

(d) Disturbance estimate (original: unbounded growth)

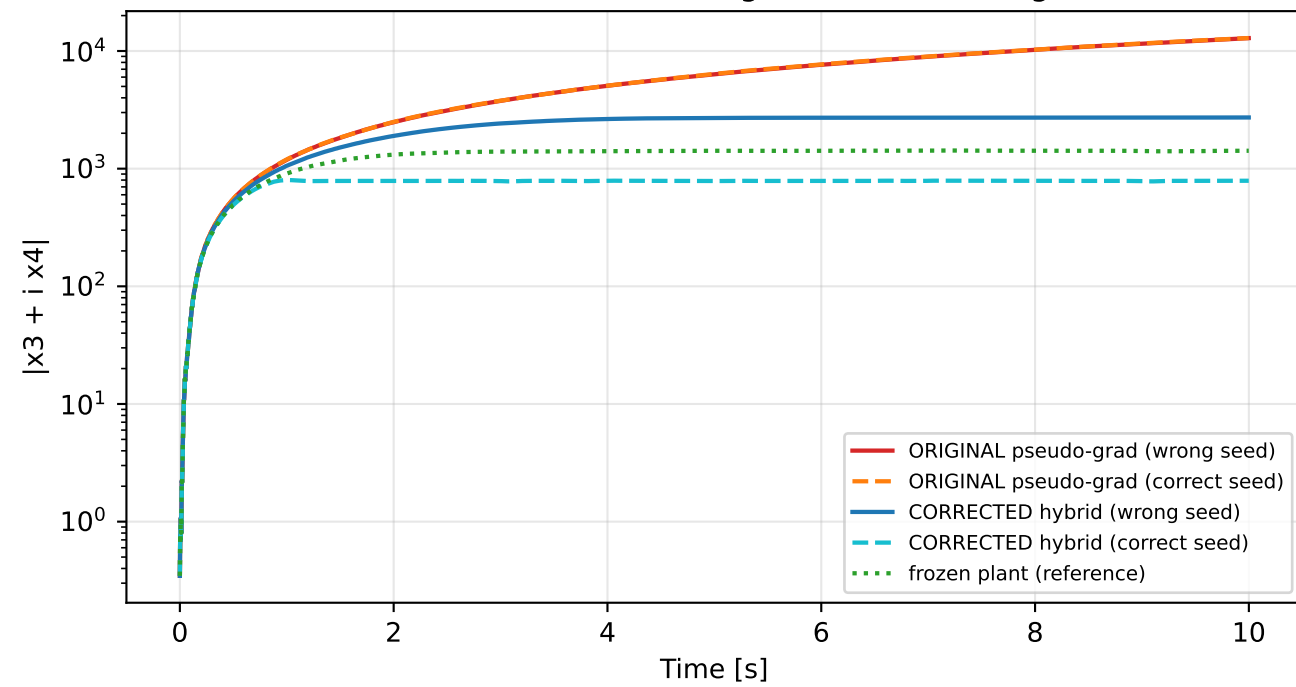

(e) Mode-0 residual PSD (steady state, $t > 5$ s)

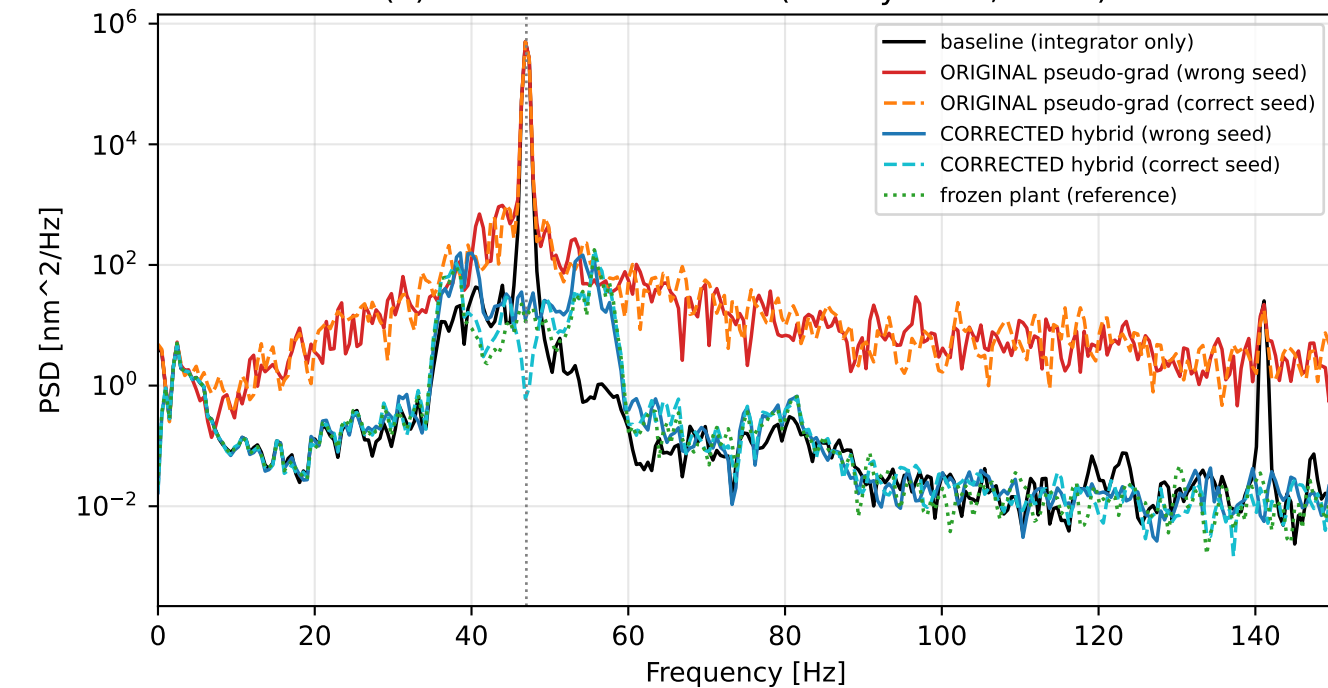

(f) Mode-0 residual (200 ms moving RMS)

