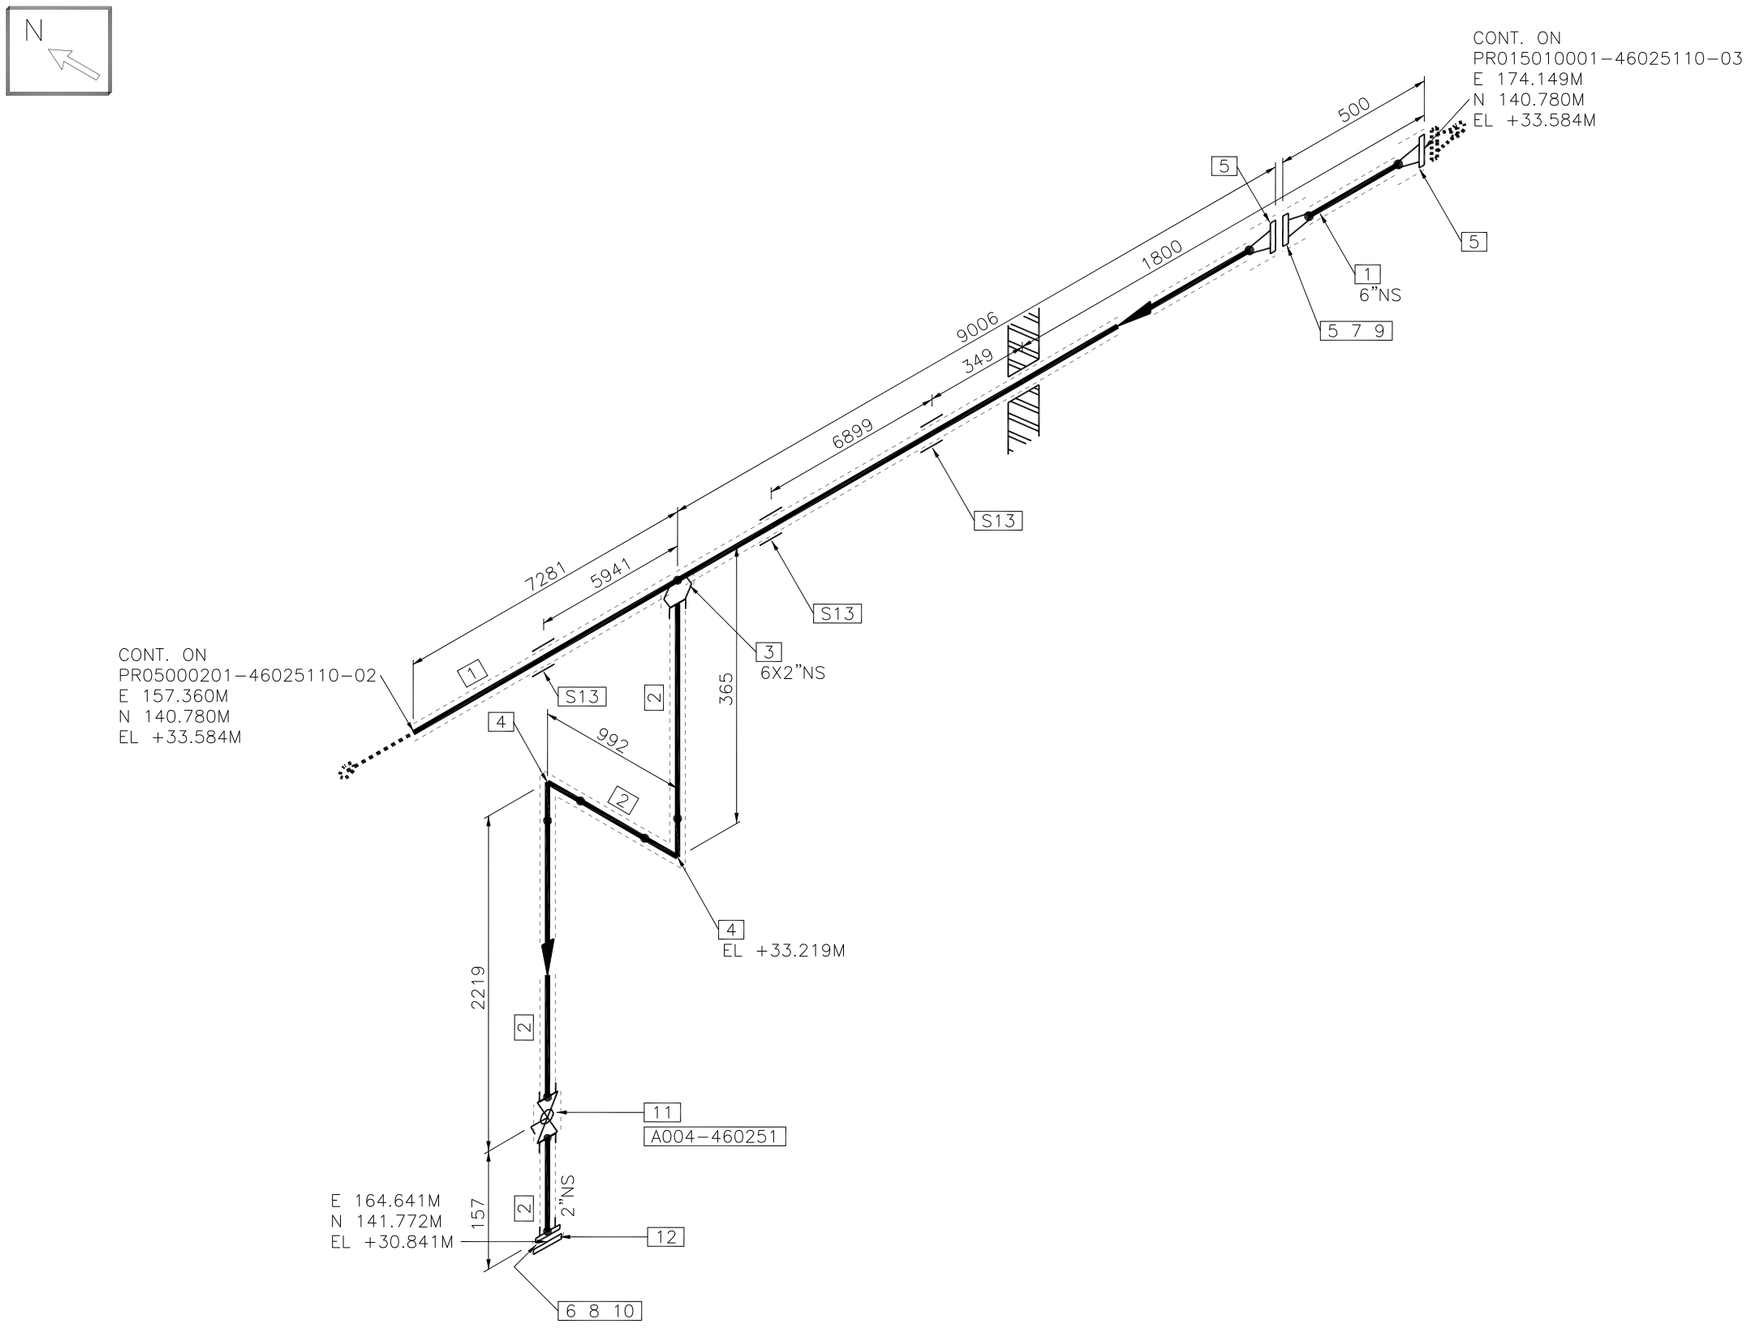


FOR ISOMETRIC NOTES PLEASE REFER TO PM DOCUMENT IE0312206-43-LI-0003

| | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|
| CONTRACT: | MEP2 | ISSUE | | | | | | | |
| ISO CATEGORY: | CATEGORY 1 | ISSUE | | | | | | | |
| SYSTEM NO. | | ISSUE | | | | | | | |
| STRESS ANALYSIS | TYPE 1 EXEMPT PIPING | ISSUE | | | | | | | |
| PED CAT. | SEE PROCESS LINE LIST | ISSUE | | 0 | ISSUE FOR CONSTRUCTION | WM | DB | PS | 27 NOV 2018 |
| P + ID | SEE PROCESS LINE LIST | ISSUE | | ISSUE | DESCRIPTION | ORIG | CHK'D | PM APP | DATE |

MATERIALS TAKE OFF

| No. | QTY. | SIZE | DESCRIPTION | SPEC |
|---|---|---|---|---|
| 1 | 16.6 M | 6 | PIPE CS, SMLS OR WELDED, SCH 40, ASTM A53 | SP-8C |
| 2 | 3.3 M | 2 | PIPE CS, SMLS, SCH 80, ASTM A53 | SP-8C |
| 3 | 1 | 6X2 | SOCKOLET, CS, SCH 80, ASTM A53 | SP-8C |
| 4 | 2 | 2 | 90 ELL. BW, WROUGHT CS, SMLS OR WELDED, SCH 40, ASTM A234 | SP-8C |
| 5 | 3 | 6 | FLG WN, 150LB FF, FORGED CS, ASTM A105 | SP-8C |
| 6 | 1 | 2 | FLG SW, 150LB RF, FORGED CS, ASTM A105 | SP-8C |
| 7 | 1 | 6 | GASKET, 150LB, 1/8" THK, PTFE WITH BARIUM SULFATE FILLER, GARLOCK | SP-8C |
| | | | GYLON STYLE 3510 | |
| 8 | 1 | 2 | GASKET, 150LB, 1/8" THK, PTFE WITH BARIUM SULFATE FILLER, GARLOCK | SP-8C |
| | | | GYLON STYLE 3510 | |
| 9 | 1 | 3/4 | (8) MACHINE BOLTS, CS HEAVY HEX W/ A563 GR. A HEAVY HEX NUTS | SP-8C |
| | | | NUTS, 101.6 LG | |
| 10 | 1 | 5/8 | (4) MACHINE BOLTS, CS HEAVY HEX W/ A563 GR. A HEAVY HEX NUTS | SP-8C |
| | | | NUTS, 82.6 LG | |
| 11 | 1 | 2 | BALL VALVE, SW, B-1505SE, CS | SP-8C |
| 12 | 1 | 2 | FLG BLIND, 150LB RF, FORGED CS, ASTM A105 | SP-8C |
| 13 | 3 | 6 | PIPE SUPPORT, SX-06 | SP-8C |

PM GROUP

MSD Animal Health

| | |
|---|---|
| CLIENT | MSD BOXMEER |
| PROJECT | STERILE FILLING FREEZE DRYING & CUB |
| LINE No. | 6-WCVA-PE010-46025110-SP8C-N-HC |
| PROJECT No. IE0312206 | DRAWING No. PR05000201-46025110-01 |
| CLIENT REF. PE005.001 | REV 0 |