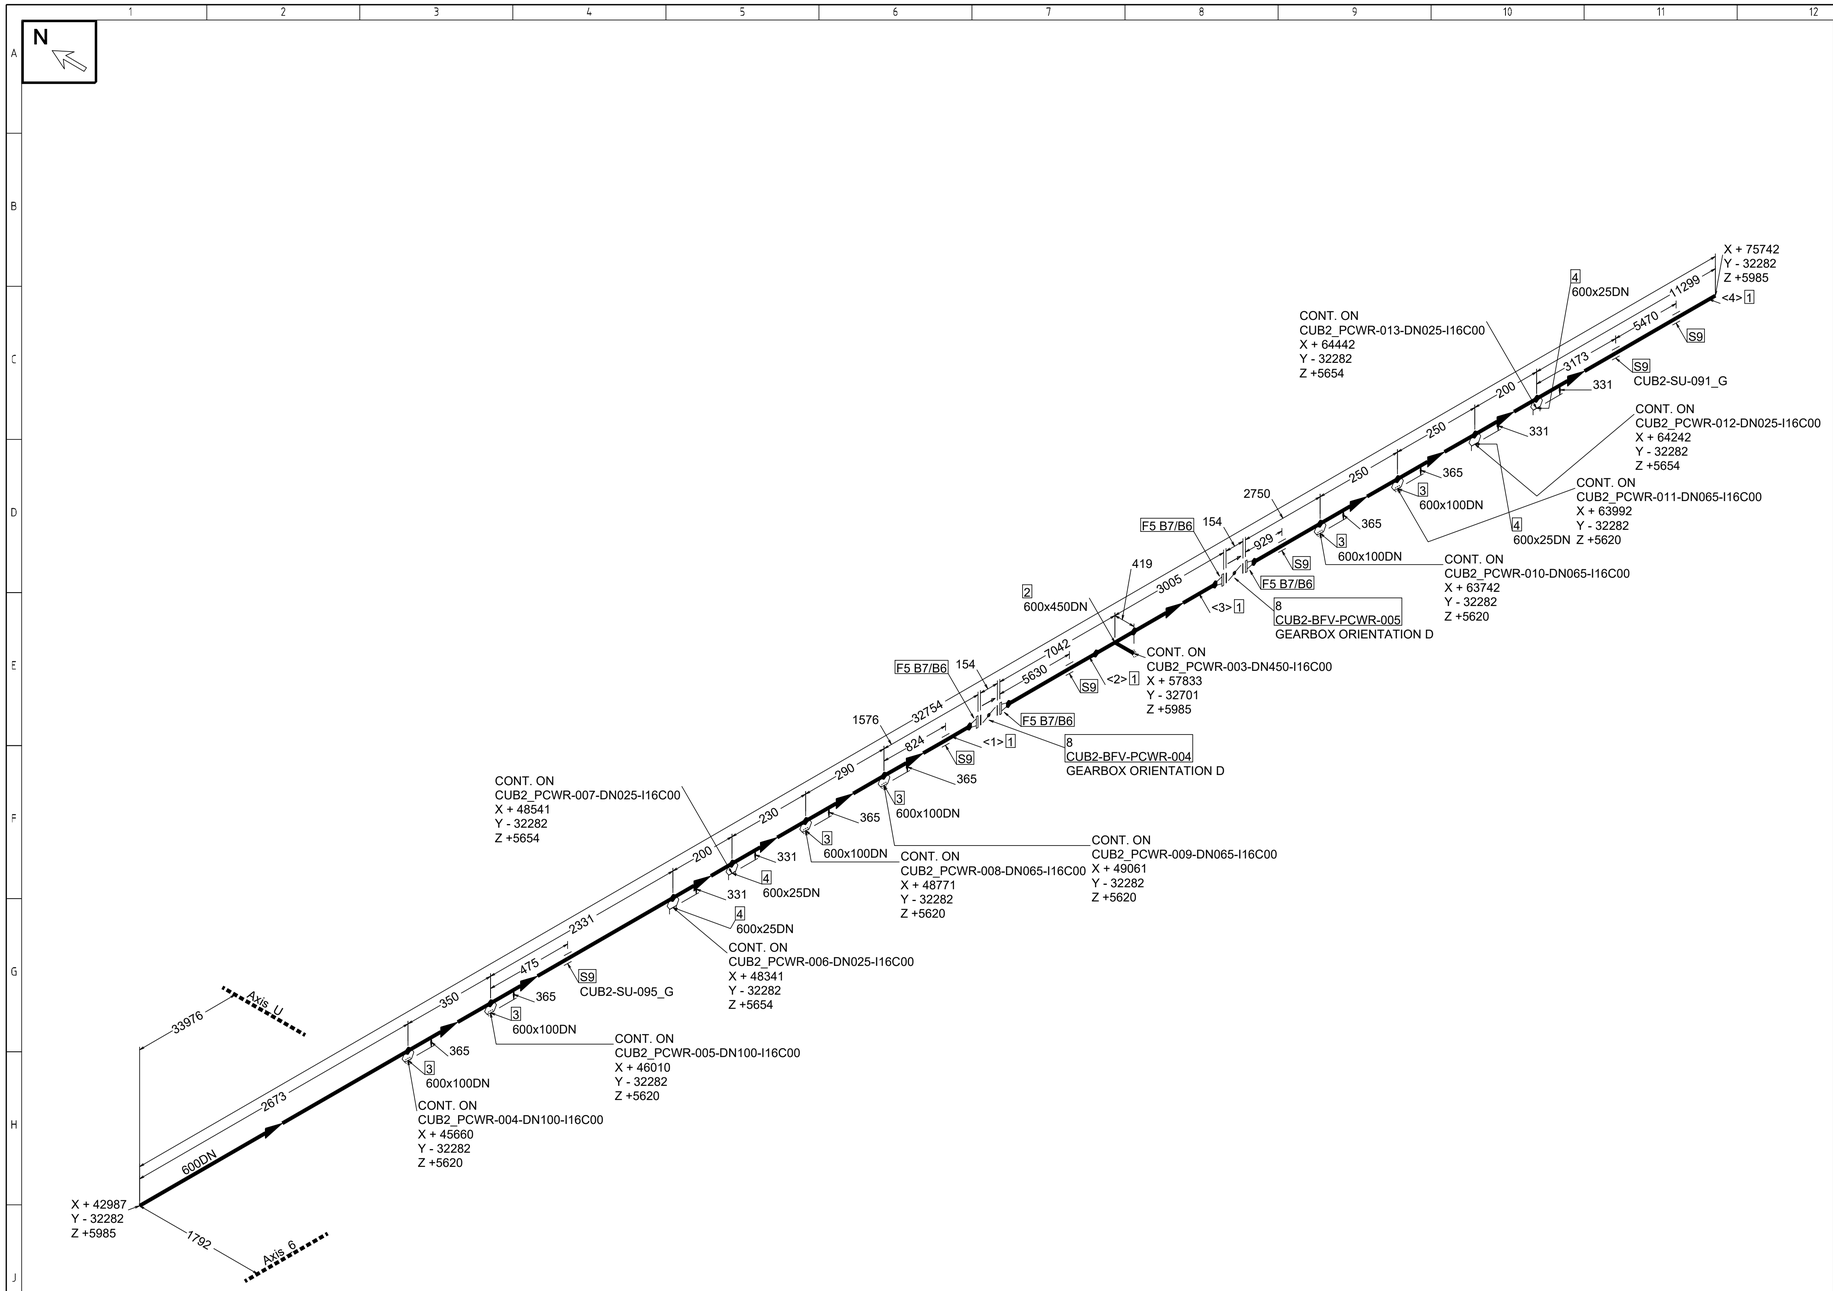

MATERIAL

Pos No.	Description	Material	DN (MM)	Qty.
	PIPE			
1	welded steel pipe - EN 10217-1 - 610x6.3 P235GH	P235GH	600	31230MM
	FITTINGS			
2	Welded branch - 610x6.3/457x6.3 P235GH	P235GH	600 x 450	1
3	Nozzle 90deg, DN600/100, Drwg. Nr.:LPP5A-K007-ALL-ALL-ALL-P-DW-500 P235GH	P235GH	600 x 100	6
4	Threadolet Fig. 2701 - DN25 P235GH	P235GH	600 x 25	4
	FLANGES			
5	Welding Neck Flange, EN1092-1/11/B1, PN16, DN600 P245GH	P245GH	600	4

MATERIAL

Pos No.	Description	Material	DN (MM)	Qty.
	BOLTS			
6	Hexagon Screw BS4190 - M33 x 110 - 8.8		33	80
7	Washer BS4190 - M33 - Steel zinced		33	80
	VALVES / IN-LINE ITEMS			
8	Butterfly valve - Flowcon - fully lugged - Handwheel - PN16 - DN600		600	2
	SUPPORTS			
9	SLIDING SUPPORT LD-HV090-DN600; ARTICLE NO. 110101		600	6

CUT PIPE LENGTH

PIECE NO	CUT LENGTH	DN (MM)	REMARKS	PIECE NO	CUT LENGTH	DN (MM)	REMARKS
<1>	7562	600		<2>	6522	600	
<3>	2485	600		<4>	14661	600	

Insulation Specification:

Pipe Number: CUB2_PCWR-002-DN600-I16C00

Specification: I16C00

Medium:

Pipe data, Inspection Instruction see Pipelist:

X ... Part-No.	X ... Support No.
SPLx ... Spool-No.	... Field weld (FW)
X ... Joint No.	... Shop weld (SW)

Fabricationtolerances acc. EN-ISO-13920

Limits for		
Longitudinal dimensions	Angular dimensions	Straightness-, Flatness- and Parallelismtolerances
Toleranceclass A	Toleranceclass A	Toleranceclass E

+Z Up, +Y North, +X East, -X West, -Y South, -Z Down

CUB building

Zero Point for calculation and Isometric

North Y, X East

PROTECTION MARK DIN ISO 16016

Rev.	date	drawn	checked	approved	description
1	2020-01-23	Kopacka	Wagner		drawing update

ZAUNER ANLAGENTECHNIK

Zauner Anlagentechnik GmbH
A-4702 Wallern
Mauer 20 / Gewerbepark

FLUOR®

Fluor Consultants B.V,
sivuliike Suomessa
FI-00181 Helsinki
Porkkalankatu 24

project : LPP 5A - K007 - Mechanical & Piping

drawing title : Piping Isometric

CUB2_PCWR-002-DN600-I16C00

Sheet no. 1/1

Revision 1

CAD-NR :

(ERS F-)

(ERS D-)

A1

cad system PDMS / E3D