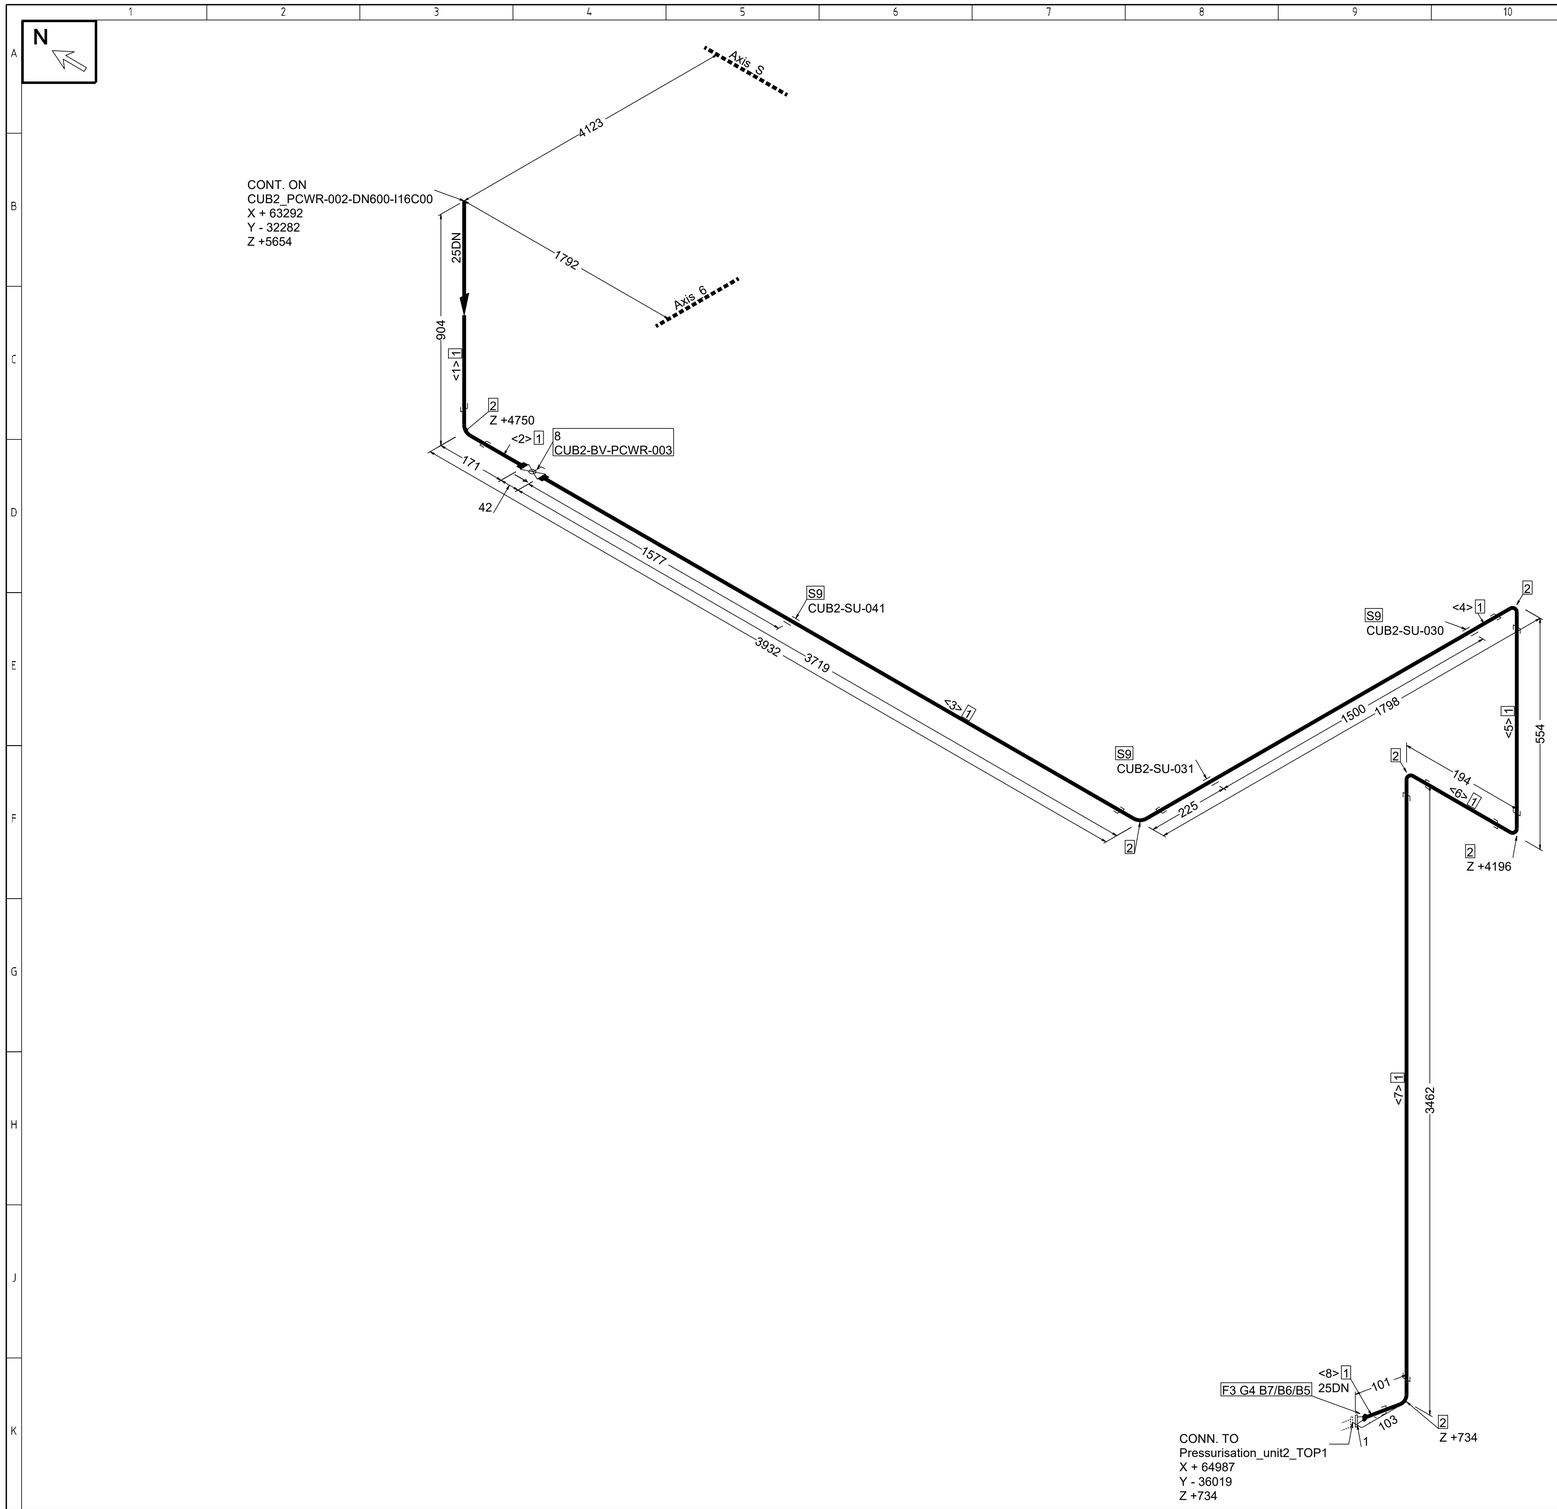

MATERIAL

Pos No.	Description	Material	DN (MM)	Qty.
	PIPE			
1	black steel pipe - EN 10255 - 33.7x3.2 S195T	S195T	25	10611MM
	FITTINGS			
2	Elbow - BS143&BS1256-A1-DN25-Fe varnished finished	varnished finished	25	6
	FLANGES			
3	Welding Neck Flange, EN1092-1/11/B1, PN16, DN25 P245GH	P245GH	25	1

MATERIAL

Pos No.	Description	Material	DN (MM)	Qty.
	GASKETS			
4	Flat sealing EN1514-1, Form IBC, PN16, 2mm - DN25 Klingersil C-4400	Klingersil C-4400	25	1
	BOLTS			
5	Hexagon Screw BS4190 - M12 x 55 - 8.8		12	4
6	Hexagon Nut BS4190 - M12 - 8		12	4
7	Washer BS4190 - M12 - Steel zinced		12	8
	VALVES / IN-LINE ITEMS			
8	Ball valve - ISIS art. 2411 - screwed - hand lever - DN25		25	1
	SUPPORTS			
9	ASSEMBLY GROUP BG92-MS41-M10-25-0, DN25+0mm Insul.		25	3

CUT PIPE LENGTH

PIECE NO	CUT LENGTH	DN (MM)	REMARKS	PIECE NO	CUT LENGTH	DN (MM)	REMARKS
<1>	883	25		<2>	150	25	
<3>	3698	25		<4>	1756	25	
<5>	512	25		<6>	152	25	
<7>	3420	25		<8>	40	25	

Insulation Specification:

Pipe Number: CUB2_PCWR-012-DN025-I16C00

Specification: I16C00

Medium:

Pipe data, Inspection Instruction see Pipelist:

X ... Part-No.	X .. Support No.
SPLX .. Spool-No.	... Field weld (FW)
X ... Joint No.	... Shop weld (SW)

Fabricationtolerances acc. EN-ISO-13920

Limits for		
Longitudinal dimensions	Angular dimensions	Straightness-, Flatness- and Paralleismtolerances
Toleranceclass A	Toleranceclass A	Toleranceclass E

+Z Up, +Y North, +X East, -X West, -Y South, -Z Down

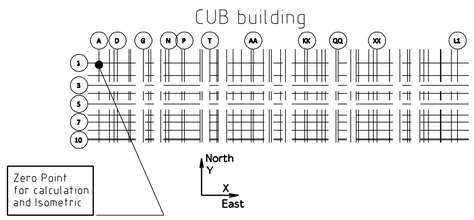

PROTECTION MARK DIN ISO 16016

Rev.	date	drawn	checked	approved	description
1	2020-03-23	Kopacka	Wagner		drawing update

ZAUNER ANLAGENTECHNIK

Zauner Anlagentechnik GmbH
A-4702 Wallern
Mauer 20 / Gewerbepark

FLUOR®

Fluor Consultants B.V,
sivuliike Suomessa
FI-00181 Helsinki
Porkkalankatu 24

project : LPP 5A - K007 - Mechanical & Piping

drawing title : Piping Isometric

CUB2_PCWR-012-DN025-I16C00

Sheet no. 1/1

Revision 1

CAD-NR :

(ERS F.:)

(ERS D.:)

A1

cad system PDMS / E3D