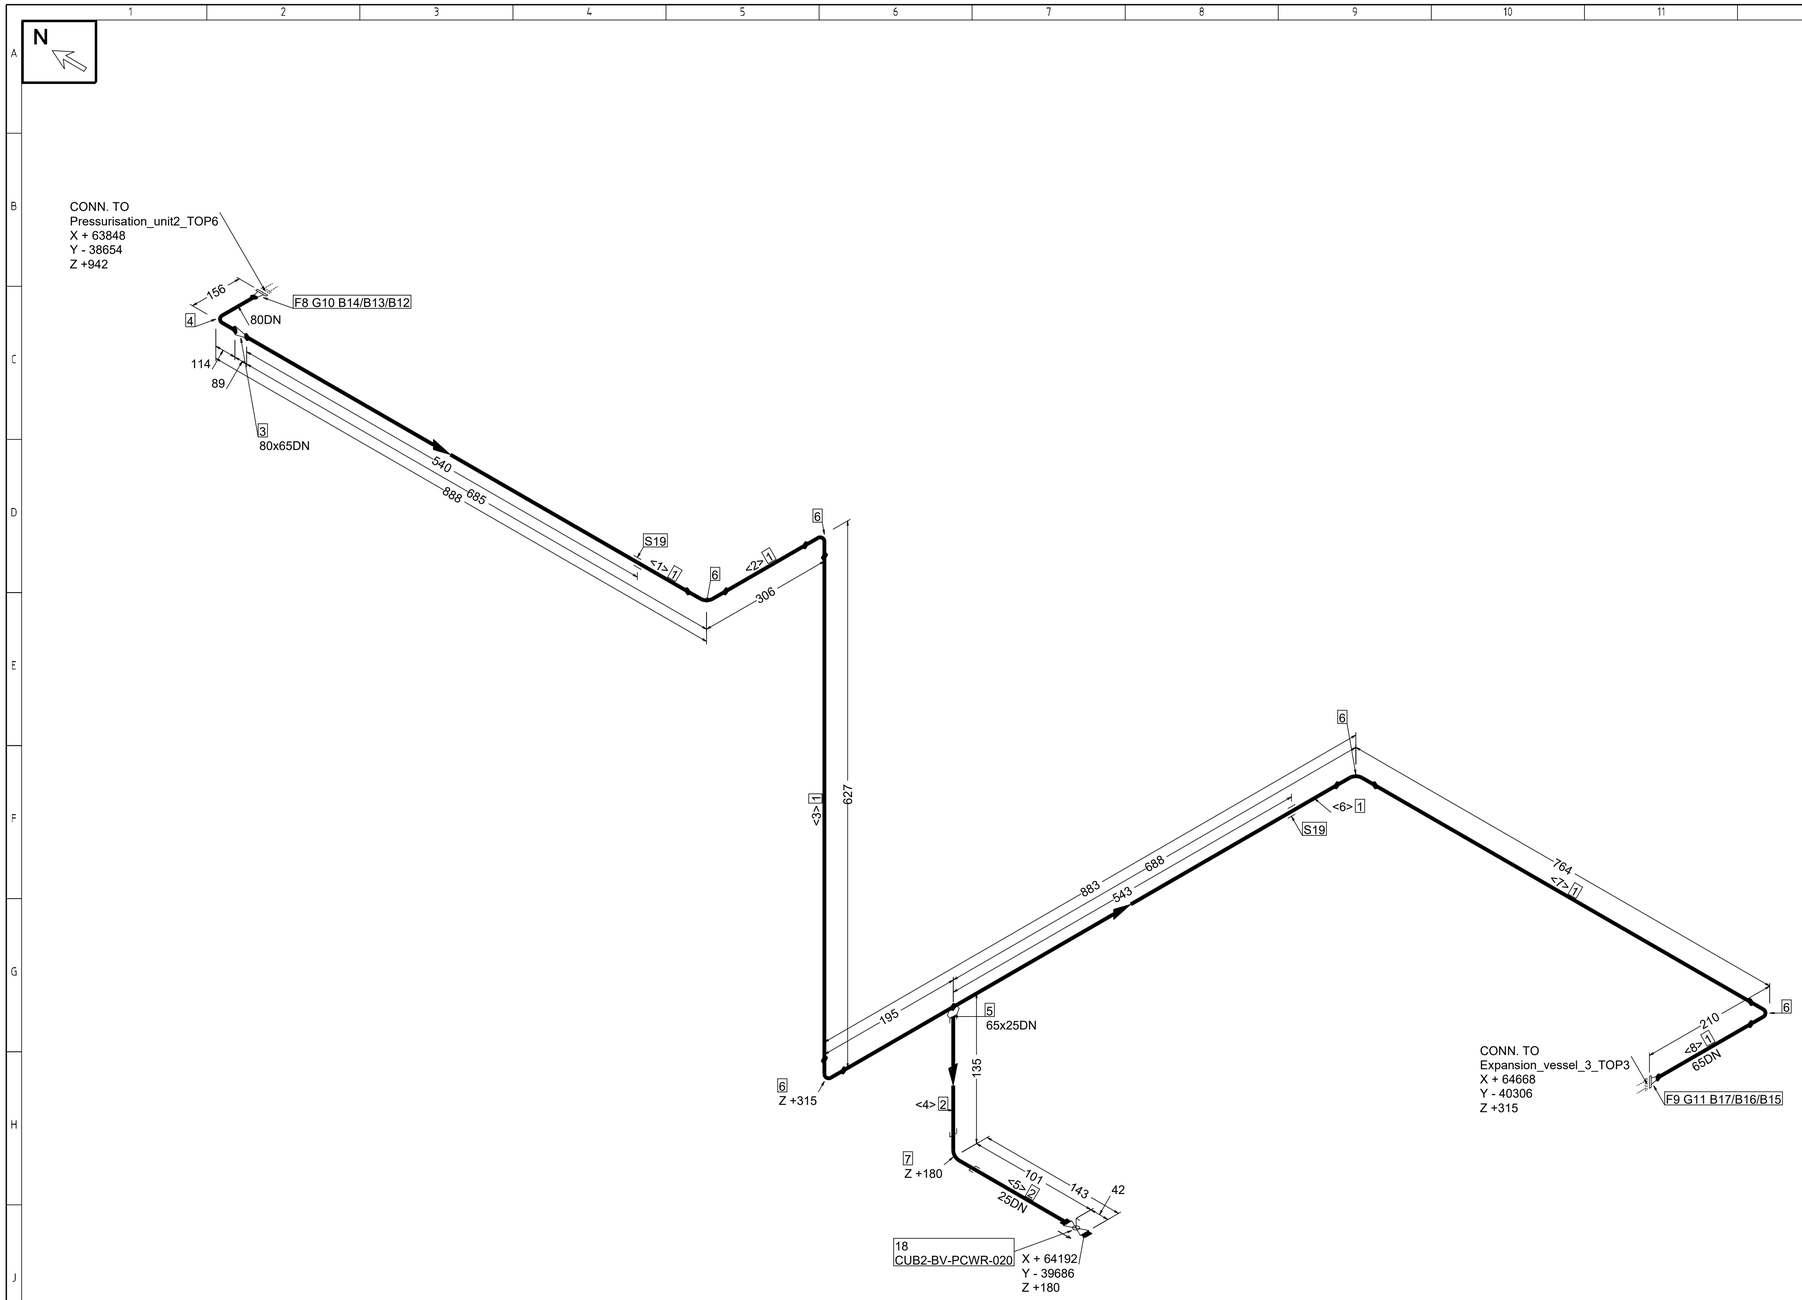

MATERIAL

Pos No.	Description	Material	DN (MM)	Qty.
	PIPE			
1	welded steel pipe - EN 10217-1 - 76.1x2.9 P235GH	P235GH	65	2487MM
2	black steel pipe - EN 10255 - 33.7x3.2 S195T	S195T	25	130MM
	FITTINGS			
3	Reducer concentric - EN 10253-1 - 88.9x3.2/76.1x2.9 P235GH	P235GH	80 x 65	1
4	Elbow - EN 10253-1 - Typ A - Model 3D - 90deg - 88.9x3.2 P235GH	P235GH	80	1
5	Threadolet Fig. 2701 - DN25 P235GH	P235GH	65 x 25	1
6	Elbow - EN 10253-1 - Typ A - Model 3D - 90deg - 76.1x2.9 P235GH	P235GH	65	5
7	Elbow - BS143&BS1256-A1-DN25-Fe varnished finished	varnished finished	25	1
	FLANGES			
8	Welding Neck Flange, EN1092-1/11/B1, PN6, DN80 P245GH	P245GH	80	1
9	Welding Neck Flange, EN1092-1/11/B1, PN6, DN65 P245GH	P245GH	65	1

MATERIAL

Pos No.	Description	Material	DN (MM)	Qty.
	GASKETS			
10	Flat sealing EN1514-1, Form IBC, PN6, 2mm - DN80 Klingersil C-4400	Klingersil C-4400	80	1
11	Flat sealing EN1514-1, Form IBC, PN6, 2mm - DN65 Klingersil C-4400	Klingersil C-4400	65	1
	BOLTS			
12	Hexagon Screw BS4190 - M16 x 60 - 8.8		16	4
13	Hexagon Nut BS4190 - M16 - 8		16	4
14	Washer BS4190 - M16 - Steel zinced		16	8
15	Hexagon Screw BS4190 - M12 x 50 - 8.8		12	4
16	Hexagon Nut BS4190 - M12 - 8		12	4
17	Washer BS4190 - M12 - Steel zinced		12	8
	VALVES / IN-LINE ITEMS			
18	Ball valve - ISIS art. 2411 - screwed - hand lever - DN25		25	1
	SUPPORTS			
19	ASSEMBLY GROUP BG90-F80-M10-65-0, DN65+0mm Insul.		65	2

CUT PIPE LENGTH

PIECE NO	CUT LENGTH	DN (MM)	REMARKS	PIECE NO	CUT LENGTH	DN (MM)	REMARKS
<1>	590	65		<2>	116	65	
<3>	437	65		<4>	50	25	
<5>	80	25		<6>	693	65	
<7>	574	65		<8>	77	65	

Insulation Specification:

Pipe Number: CUB2_PCWR-016-DN065-I16C00

Specification: I16C00

Medium:

Pipe data, Inspection Instruction see Pipelist:

X ... Part-No.	(X) .. Support No.
SPLx ... Spool-No.	... Field weld (FW)
(X) ... Joint No.	... Shop weld (SW)

Fabricationtolerances acc. EN-ISO-13920

Limits for

Longitudinal dimensions	Angular dimensions	Straightness-, Flatness- and Parallelismtolerances
Toleranceclass A	Toleranceclass A	Toleranceclass E

+Z Up, +Y North, +X East, -X West, -Y South, -Z Down

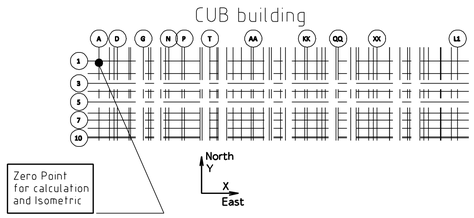

PROTECTION MARK DIN ISO 16016

Rev.	date	drawn	checked	approved	description
0	2020-04-30	Kopacka	Wagner		first issue

ZAUNER ANLAGENTECHNIK

Zauner Anlagentechnik GmbH
A-4702 Wallern
Mauer 20 / Gewerbepark

FLUOR®

Fluor Consultants B.V,
sivuliike Suomessa
FI-00181 Helsinki
Porkkalankatu 24

project : LPP 5A - K007 - Mechanical & Piping

drawing title : Piping Isometric

CUB2_PCWR-016-DN065-I16C00

Sheet no. 1/1

Revision 0

CAD-NR :

(ERS-F-)

(ERS-D-)

A1

cad system PDMS / E3D