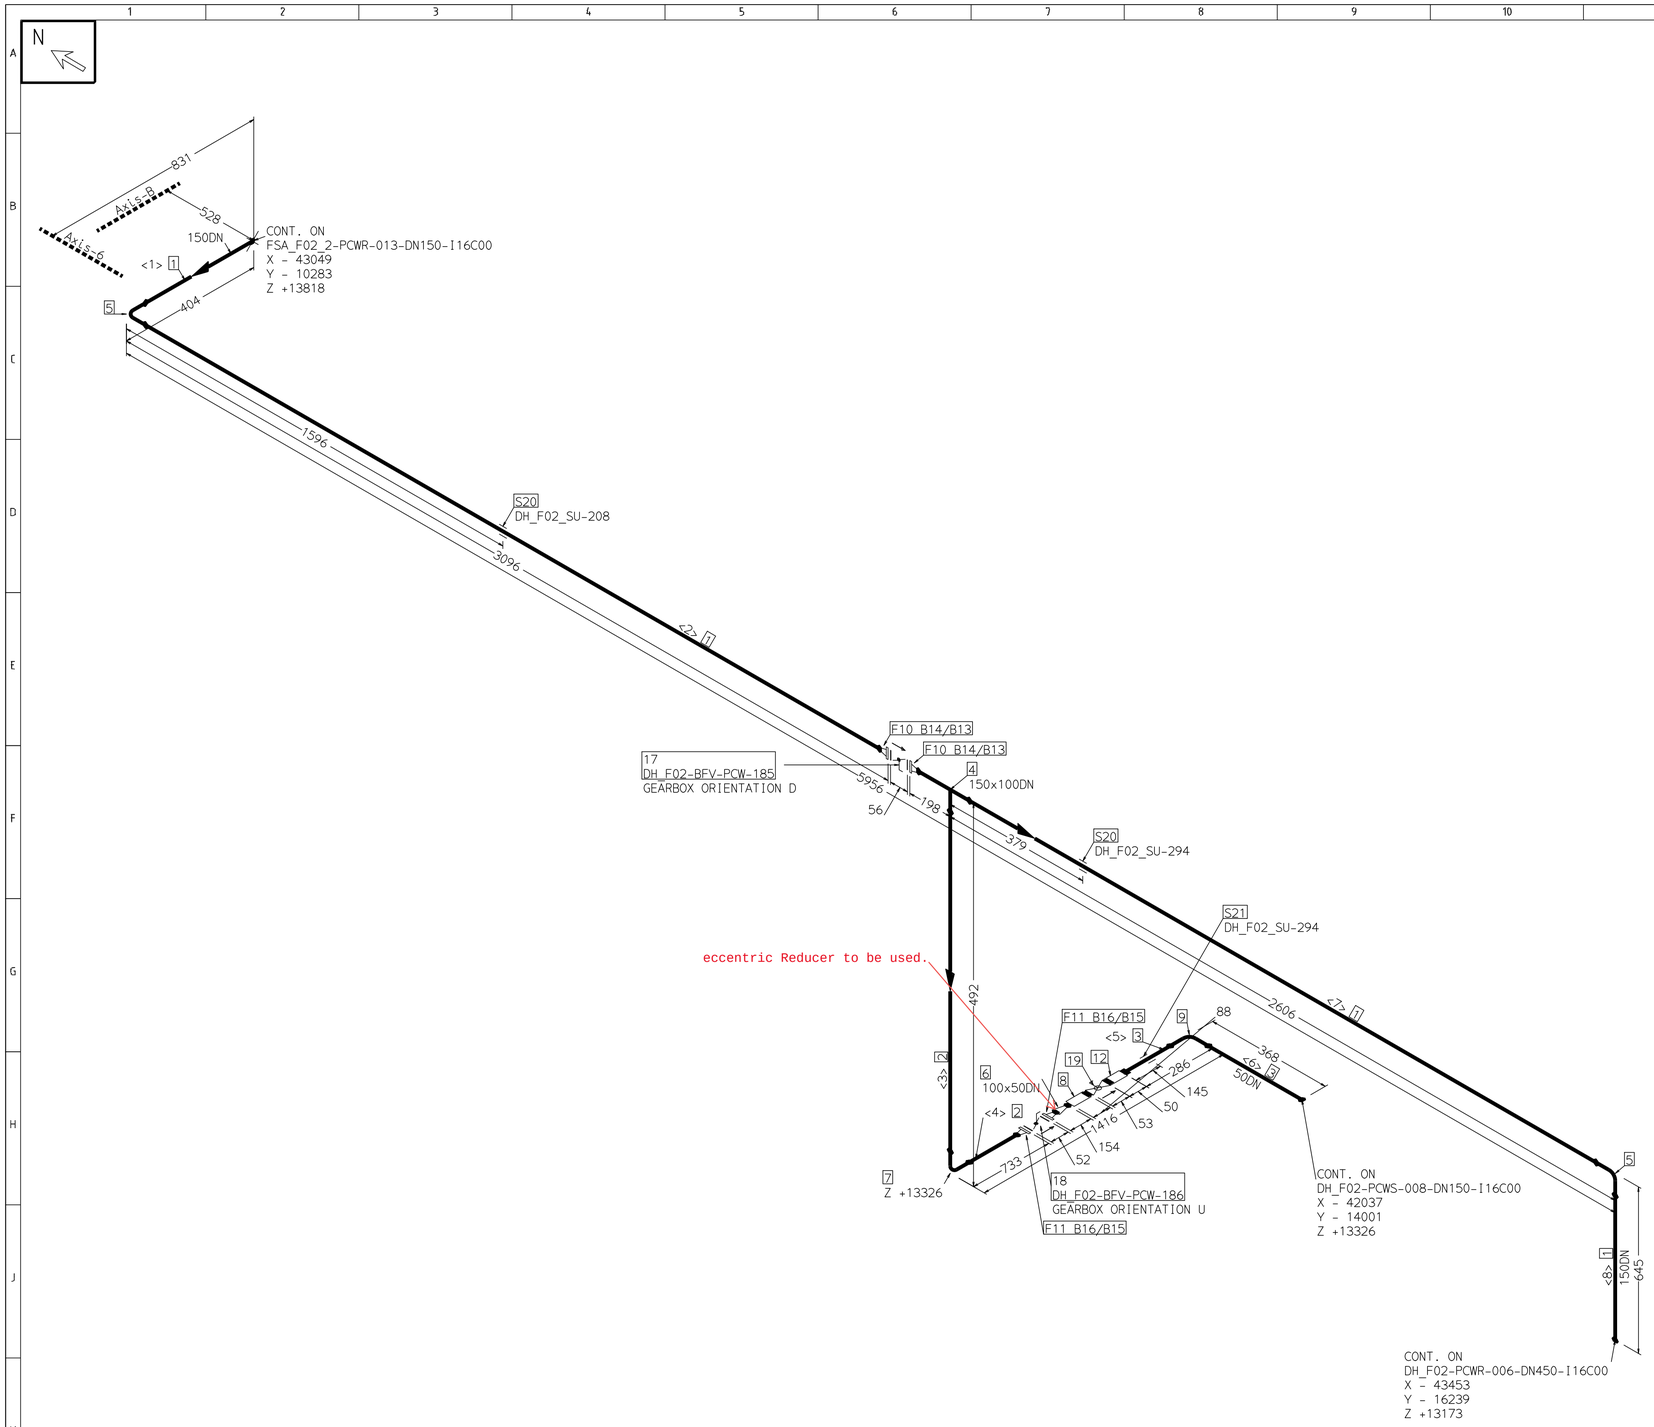


MATERIAL

| Pos No. | Description | Material | DN (MM) | Qty. |
|---|---|---|---|---|
| | PIPE | | | |
| 1 | Carbon steel pipe - EN10217-2 - 168.3x4.5 P235GH | P235GH | 150 | 5637MM |
| 2 | Carbon steel pipe - EN10217-2 - 114.3x3.6 P235GH | P235GH | 100 | 739MM |
| 3 | Carbon steel pipe - EN10217-2 - 60.3x2.9 P235GH | P235GH | 50 | 502MM |
| | FITTINGS | | | |
| 4 | Tee - EN10253-1 - Type A - 168.3x4.5/114.3x3.6 P235GH | P235GH | 150 x 100 | 1 |
| 5 | Elbow - EN10253-2 - Typ A - Model 3D - 90deg - 168.3x4.5 P235GH | P235GH | 150 | 2 |
| 6 | Reducer excentric - EN10253-2 - Type A - 114.3x3.6/60.3x2.9 P235GH | P235GH | 100 x 50 | 1 |
| 7 | Elbow - EN10253-2 - Typ A - Model 3D - 90deg - 114.3x3.6 P235GH | P235GH | 100 | 1 |
| 8 | Union - pipe coupler male welded - DN50 | | 50 | 1 |
| 9 | Elbow - EN10253-2 - Typ A - Model 3D - 90deg - 60.3x2.9 P235GH | P235GH | 50 | 1 |
| | FLANGES | | | |
| 10 | Welding Neck Flange, EN1092-1/11/B1, PN16, DN150 P250GH | P250GH | 150 | 2 |
| 11 | Welding Neck Flange, EN1092-1/11/B1, PN16, DN100 P250GH | P250GH | 100 | 2 |

MATERIAL

| Pos No. | Description | Material | DN (MM) | Qty. |
|---|---|---|---|---|
| | FITTINGS | | | |
| 12 | Welding nipple - EN10241 - DN50 - L=50mm P235GH | P235GH | 50 | 1 |
| | BOLTS | | | |
| 13 | Hexagon Screw BS4190 - M20 x 45 - 5.6 | | 20 | 16 |
| 14 | Washer BS4190 - M20 - Steel zinced | | 20 | 16 |
| 15 | Hexagon Screw BS4190 - M16 x 40 - 5.6 | | 16 | 16 |
| 16 | Washer BS4190 - M16 - Steel zinced | | 16 | 16 |
| | VALVES / IN-LINE ITEMS | | | |
| 17 | Butterfly valve - AICHHORN - fully lugged - handlever - PN16 - DN150 | | 150 | 1 |
| 18 | Butterfly valve - AICHHORN - fully lugged - handlever - PN16 - DN100 | | 100 | 1 |
| 19 | Ball valve - ISIS art. 2411 - screwed - hand lever - DN50 | | 50 | 1 |
| | SUPPORTS | | | |
| 20 | ASSEMBLY GROUP BG52-DN150; ARTICLE NO. 114666 | | 150 | 2 |
| 21 | ASSEMBLY GROUP BG90-F80-M10-50-0, DN50+0mm Insul. | | 50 | 1 |

CUT PIPE LENGTH

| PIECE NO | CUT LENGTH | DN (MM) | REMARKS | PIECE NO | CUT LENGTH | DN (MM) | REMARKS |
|---|---|---|---|---|---|---|---|
| <1> | 175 | 150 | | <2> | 2812 | 150 | |
| <3> | 210 | 100 | | <4> | 529 | 100 | |
| <5> | 210 | 50 | | <6> | 292 | 50 | |
| <7> | 2234 | 150 | | <8> | 416 | 150 | |

Insulation Specification:

Pipe Number: DH_F02-PCWR-013-DN150-I16C00

Specification: I16C00

Medium:

Pipe data, Inspection Instruction

see Pipelist:

| | | | |
|---|---|---|---|
| X... | Part-No. | X... | Support No. |
| SPLX... | Spool-No. | ... | Field weld (FW) |
| X... | Joint No. | ... | Shop weld (SW) |

Fabricationtolerances acc. EN-ISO-13920

| Limits for | | |
|---|---|---|
| Longitudinal dimensions | Angular dimensions | Straightness-, Flatness- and Parallelismtolerances |
| Toleranceclass A | Toleranceclass A | Toleranceclass E |

+Z Up, +Y North, +X East, -X West, -Y South, -Z Down

DC building




PROTECTION MARK DIN ISO 16016

| Rev. | date | drawn | checked | approved | description |
|---|---|---|---|---|---|
| 0 | 2024-10-18 | TBH-H | TBH-A | | first issue |

ZAUNER ANLAGENTECHNIK

Zauner Anlagentechnik GmbH
A-4702 Wallern
Mauer 20 / Gewerbepark

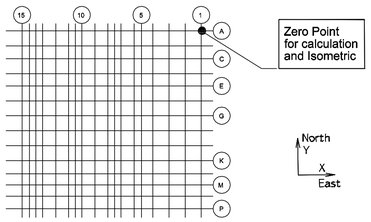exyte

Fluor Consultants B.V,
sivuliike Suomessa
FI-00181 Helsinki
Porkkalankatu 24

project : LPP 6A - K007 - Mechanical & Piping

drawing title : Piping Isometric

DH_F02-PCWR-013-DN150-I16C00

Sheet no. 1/1

Revision 0

CAD-NR.: (ERS.F.:) (ERS.D.:)

A1

cad system PDMS/ E3D