



SYSTEM TEST ON THE DISTRIBUTION SYSTEM OR THE USER SYSTEM

POLICY

05A - 2014

OBJECTIVE:

To ensure that the supply of electricity to a user system is continuous, system test shall be conducted by BENECO prior to energization of sole-use single-phase transformers or bank-connected transformers.

POLICY CONTENT:

It shall be the policy of the electric cooperative to identify the procedures to be followed by the distribution utility in conduct of its system tests pursuant to the provisions of the Electric Power Industry Reform Act of 2001 (EPIRA), as promulgated in the Philippine Distribution Code (PDC).

PROCEDURES:

The implementation of this policy shall be governed by following procedures:

1. BENECO shall ensure that the procedures in energizing transformers are strictly followed.
2. The nameplate ratings (capacity and voltage ratings) of distribution transformers shall be verified to ensure that it conforms to the requirement of the consumers.
3. Refer to the attached flow chart for implementation of procedures for the conduct of system tests, which may be revised by management, to be compliant to the new or amended provisions and requirements of the PDC.

RESPONSIBILITY:

The responsibility of implementing this policy rests on the General Manager.

EFFECTIVITY:

This policy shall take effect upon the approval by the Board of Directors.

APPROVAL:

Approved by the Board of Directors through Board Resolution No. 74-2014 passed during its 1st Regular Board Meeting held on July 1, 2014.

FERDY K. BAYASEN
Secretary

PETER B. BUSAING
President

Note: Approved per BOD Resolution No. 74-2014



SYSTEM TEST ON THE DISTRIBUTION SYSTEM OR THE USER SYSTEM

POLICY 05A - 2014

OBJECTIVE:

To ensure that the supply of electricity to a user system is continuous, system test shall be conducted by BENECO prior to energization of sole-use single-phase transformers or bank-connected transformers.

POLICY CONTENT:

It shall be the policy of the electric cooperative to identify the procedures to be followed by the distribution utility in conduct of its system tests pursuant to the provisions of the Electric Power Industry Reform Act of 2001 (EPIRA), as promulgated in the Philippine Distribution Code (PDC).

PROCEDURES:

The implementation of this policy shall be governed by following procedures:

1. BENECO shall ensure that the procedures in energizing transformers are strictly followed.
2. The nameplate ratings (capacity and voltage ratings) of distribution transformers shall be verified to ensure that it conforms to the requirement of the consumers.
3. Refer to the attached flow chart for implementation of procedures for the conduct of system tests, which may be revised by management, to be compliant to the new or amended provisions and requirements of the PDC.

RESPONSIBILITY:


The responsibility of implementing this policy rests on the General Manager.

EFFECTIVITY:

This policy shall take effect upon the approval by the Board of Directors.

APPROVAL:

Approved by the Board of Directors through Board Resolution No. 74-2014 passed during its 1st Regular Board Meeting held on July 1, 2014.

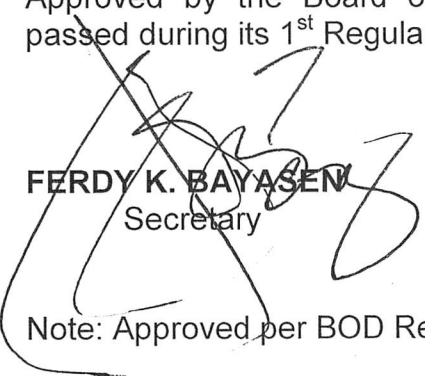
FERDY K. BAYASEN
Secretary


PETER B. BUSAING
President

Note: Approved per BOD Resolution No. 74-2014




BENGUET ELECTRIC COOPERATIVE, INC.

Office of the Board of Directors
ALAPANG, LA TRINIDAD, BENGUET

EXCERPTS FROM THE SECOND REGULAR MEETING
OF THE BENECO BOARD OF DIRECTORS
23 SEPTEMBER 2014, PUNCTUALITY HALL, OMD BLDG., DPS COMP.,
UTILITY ROAD, BAGUIO CITY

PRESENT:

PETER B. BUSAING, President
FERDY K. BAYASEN, Secretary
VIRGILIO D. ORCA, JR., Treasurer
JEFFRED S. ACOP, Member
BRUNO M. CANUTO, Member
JONATHAN OBAR, Member
ESTEBAN A. SOMNIGI, Member
JOSEPHINE B. TULING, Member
GERARDO P. VERZOSA, General Manager, Ex-Officio member

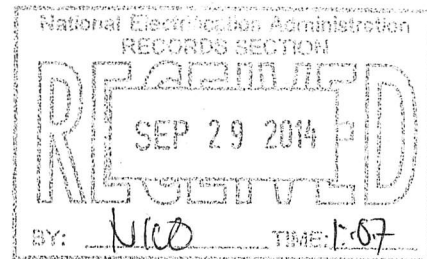

ABSENT:

NONE

RESOLUTION No. 107- 2014

APPROVING THE POLICY FOR EMPLOYEES' CONDUCT AND DISCIPLINE

Whereas, there is a need to provide guidelines for employees' conduct and mechanism to discipline employees who violated BENECO policies, rules and regulations.

Whereas, there is also a need to sustain instill discipline among employees relative to their employment in BENECO as a means to ensure productivity and efficiency of the operations of the electric cooperative.

Whereas, the electric cooperative shall adopt the following policies on the matter:

1. BENECO employees shall adhere to cooperative's policies, rules and regulations. Violations thereof shall constrain the management to implement disciplinary action and to impose corresponding penalty in relation thereto.
2. BENECO employees shall keep the best interest of the Cooperative over and above their own or those of minority groups therein.
3. A BENECO employee reported/complained of/accused of violating any of the cooperative policies, rules and regulations is entitled to due process.
4. All disciplinary actions shall apply to all employees of BENECO, regardless of employment status and rank, unless otherwise stated. Pursuant to RA 10531 and its implementing rules and regulations, any complaint against those listed in Section 6 of the Act shall be filed before the NEA.
5. Disciplinary actions will be, as far as possible, corrective rather than punitive.
6. The responsibility for maintaining discipline of employees shall be the primary concern of the immediate supervisor who shall have the authority to initiate any disciplinary action against his staff whenever an alleged violation is committed.

On motion of **Director Jeffred Acop**, duly seconded by all:

NOW, THEREFORE, BE IT RESOLVED AS IT IS HEREBY RESOLVED APPROVING THE POLICY FOR EMPLOYEES' CONDUCT AND DISCIPLINE.

BE IT FURTHER RESOLVED that copy of this resolution be submitted to the National Electrification Administration for their appropriate action.


UNANIMOUSLY APPROVED.

CERTIFIED TRUE AND CORRECT:

FERDY K. BAYASEN


ATTESTED

PETER B. BUSAING

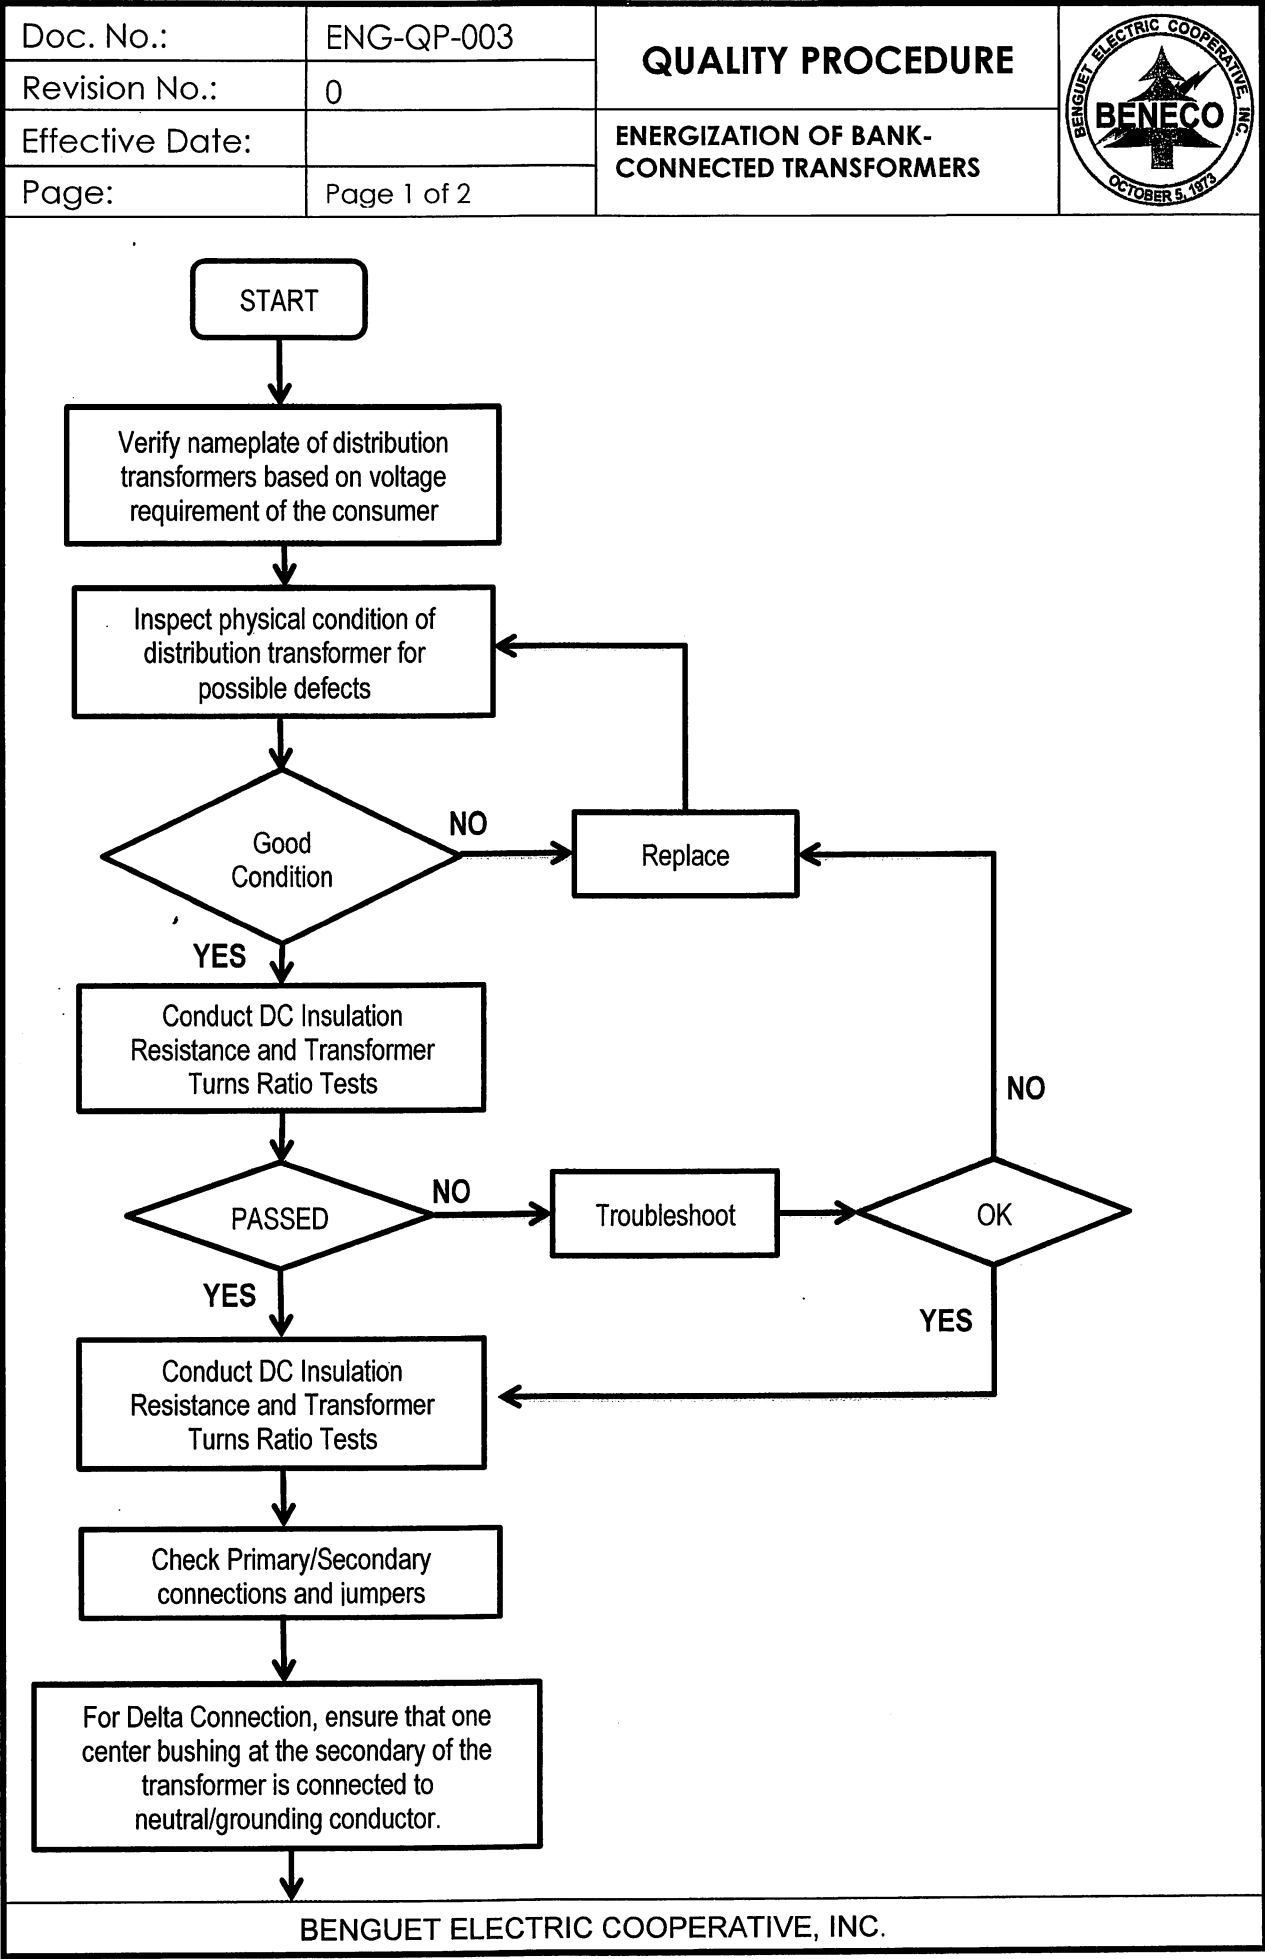

For Primary Wye Connection, check the following conditions for 13.2kV and 7.62kV distribution transformers:

- a. **Wye Connection** - One common primary bushing interconnected but floating.
- b. **Open Wye Connection** - One common primary bushing interconnected and connected to neutral/ grounding conductor.

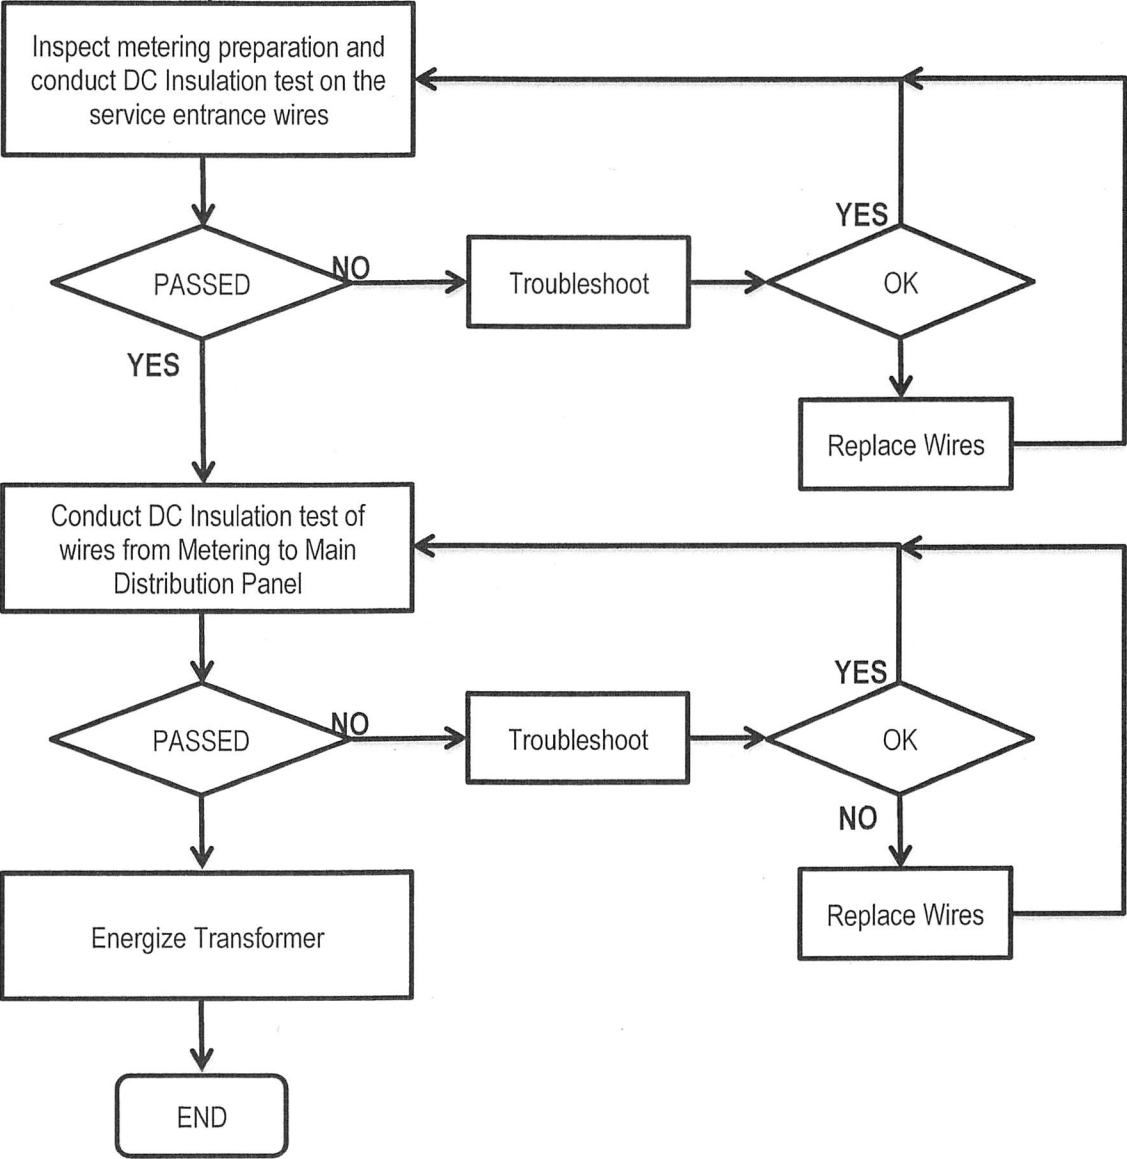

Doc. No.:	ENG-QP-002	QUALITY PROCEDURE	
Revision No.:	0		
Effective Date:		ENERGIZATION OF SINGLE PHASE SOLE-USE TRANSFORMERS	
Page:	Page 1 of 2		

