


Residual certificate versus ordinary norm



RH-61-calibrated slow/fast surrogate

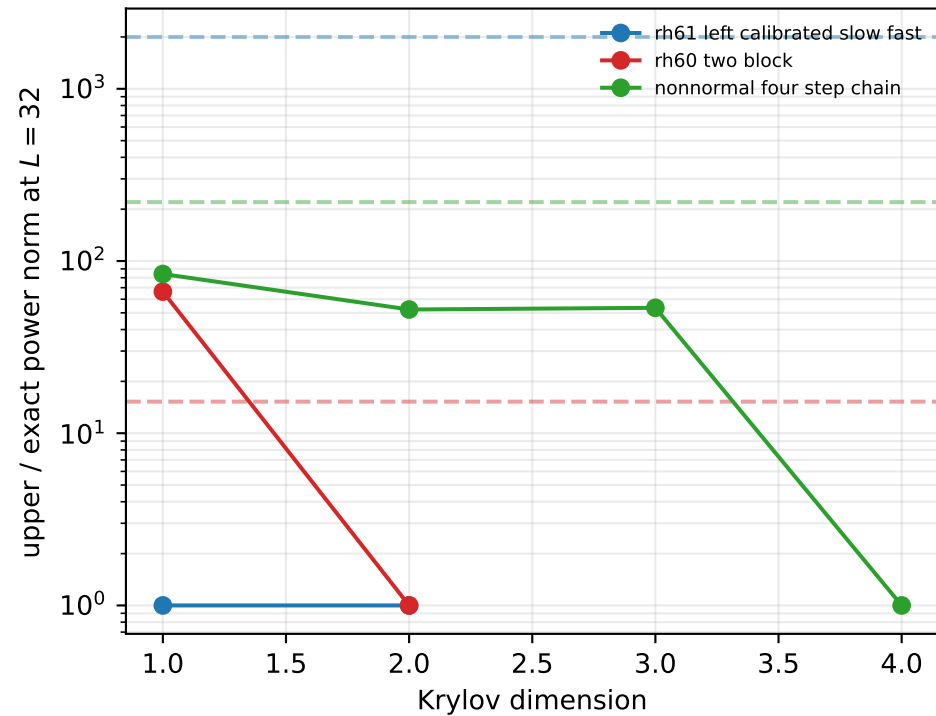