



Testing the Fe II 2600 order discrepancy


Fe II 2600: conditional offset profiles

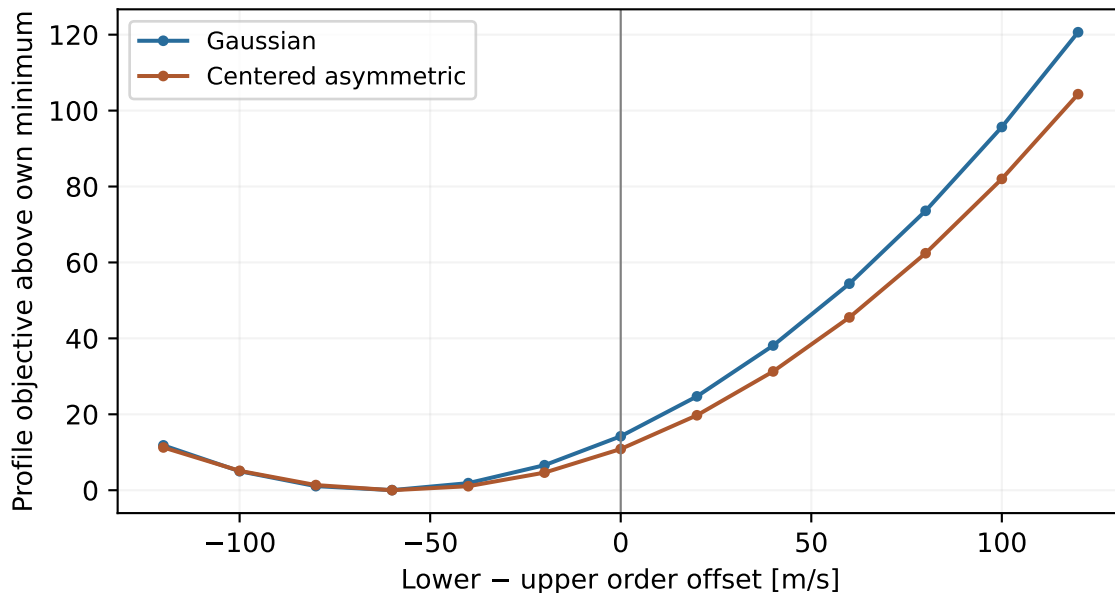


Assumed family fitted to Fe II 2600

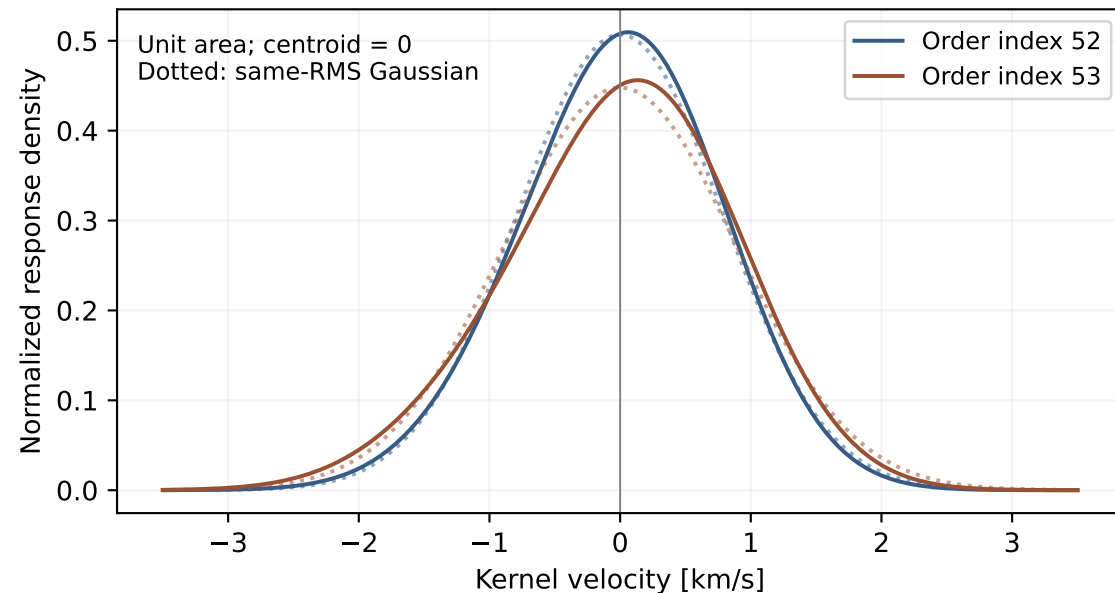

Fe II 2382: conditional offset profiles

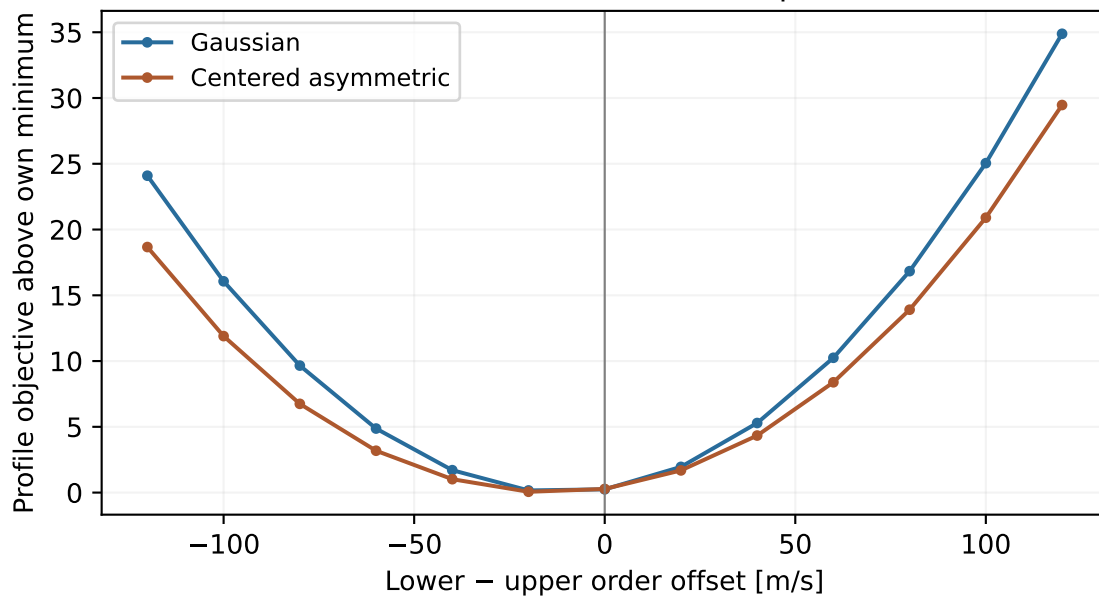

2018 response transferred to 2019-2020

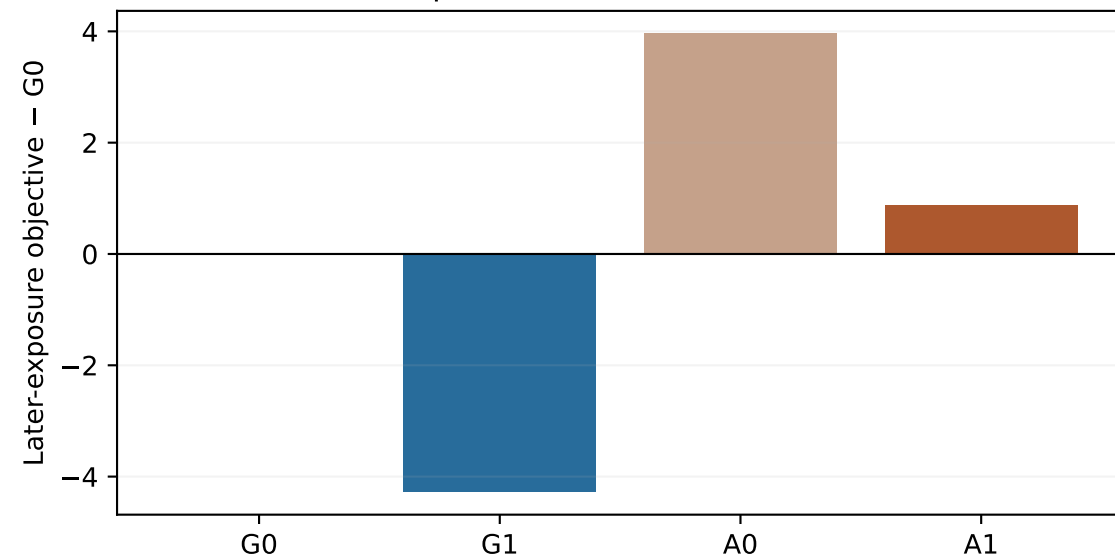

Gas template uses all exposures: conditional response transfer, not independent validation. Lower objective is better.