
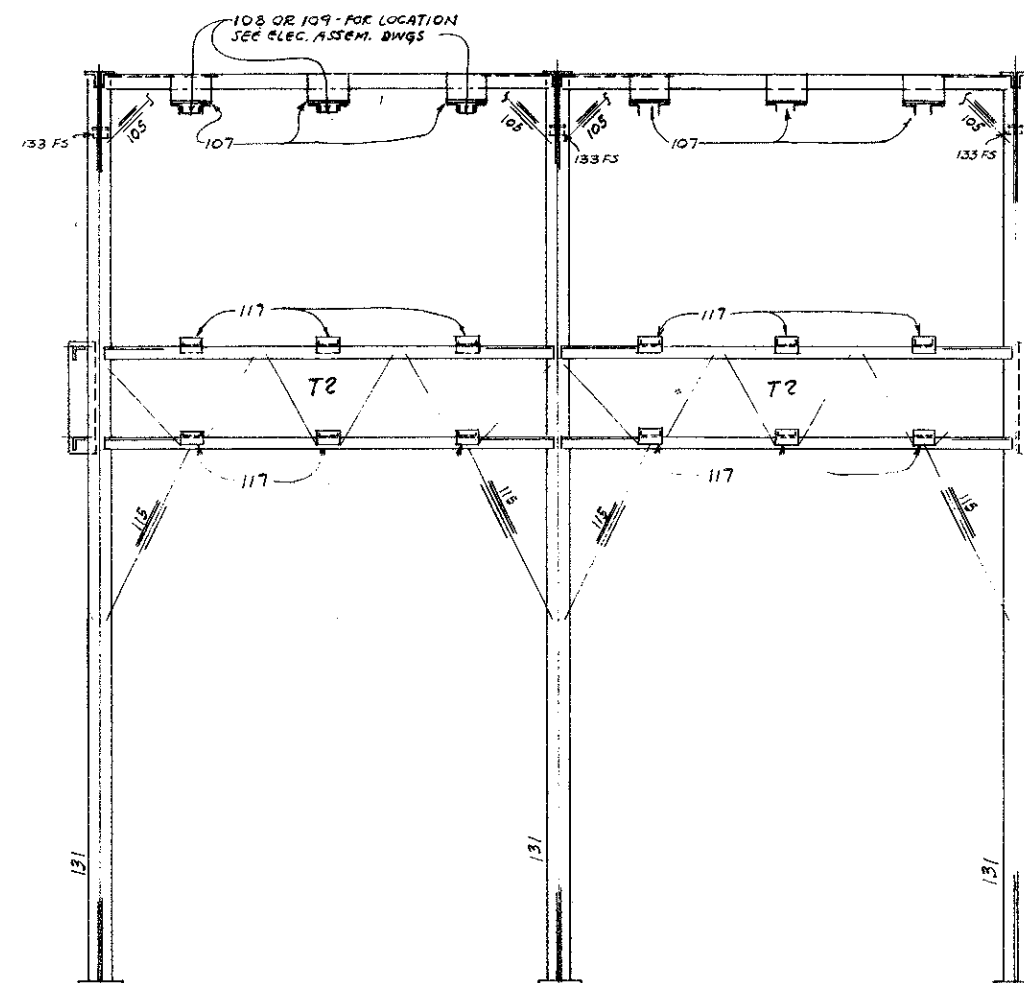
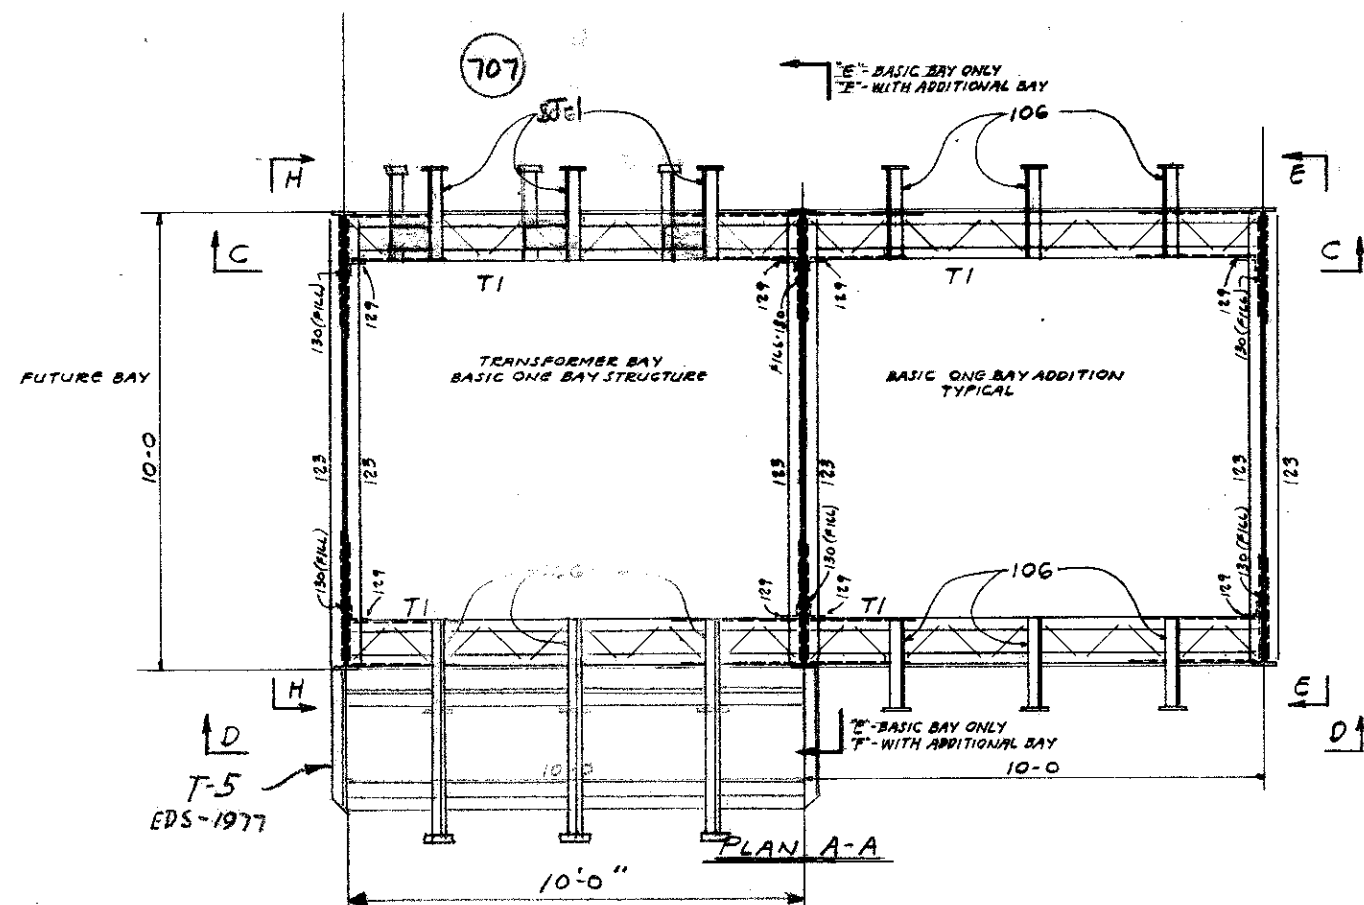


DR. No. EDS-70400/975



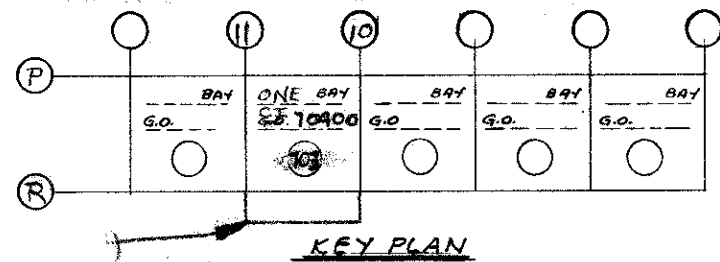


DESIGN PRACTICES:

- DWG # EDS-1975
1. NORTH ARROW TO BE SHOWN IN KEY PLAN.
 2. COLUMN DESIGNATIONS TO BE SHOWN IN KEY PLAN ONLY.
 3. BLANK SPACES TO BE FILLED IN KEY PLAN AS TO BAY DESIGNATION (WHETHER TRANSFORMER OR FOR BAY) G.O. NO. YEARS INSTALLED AND ITEM NUMBER.
- DWG # EDS-1976
4. IT IS NECESSARY ONLY TO FILL G.O. NO. AND TOTAL QUANTITIES REQUIRED IN THE BILL OF MATERIALS.

REFERENCE DRAWINGS:

1. FOR STEEL DETAILS: SEE DWG. EDS-70400-1976
2. FOR ELECTRICAL ASSEMBLY SEE DWG. EDS-70400-1051

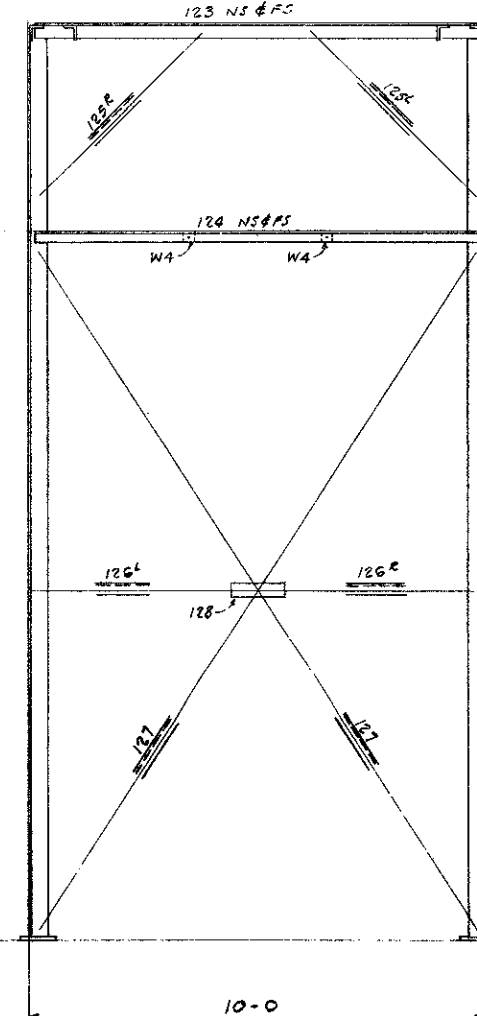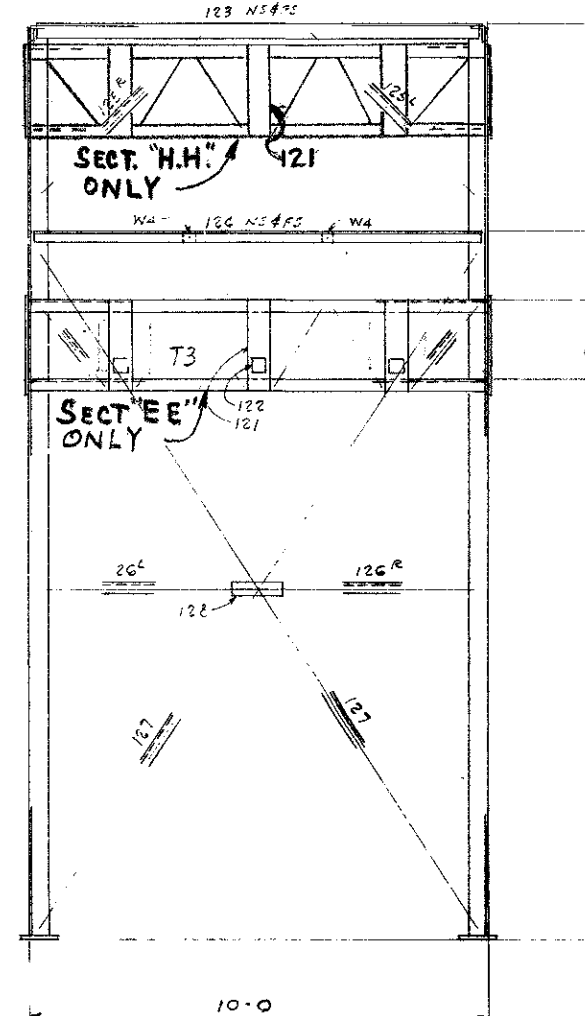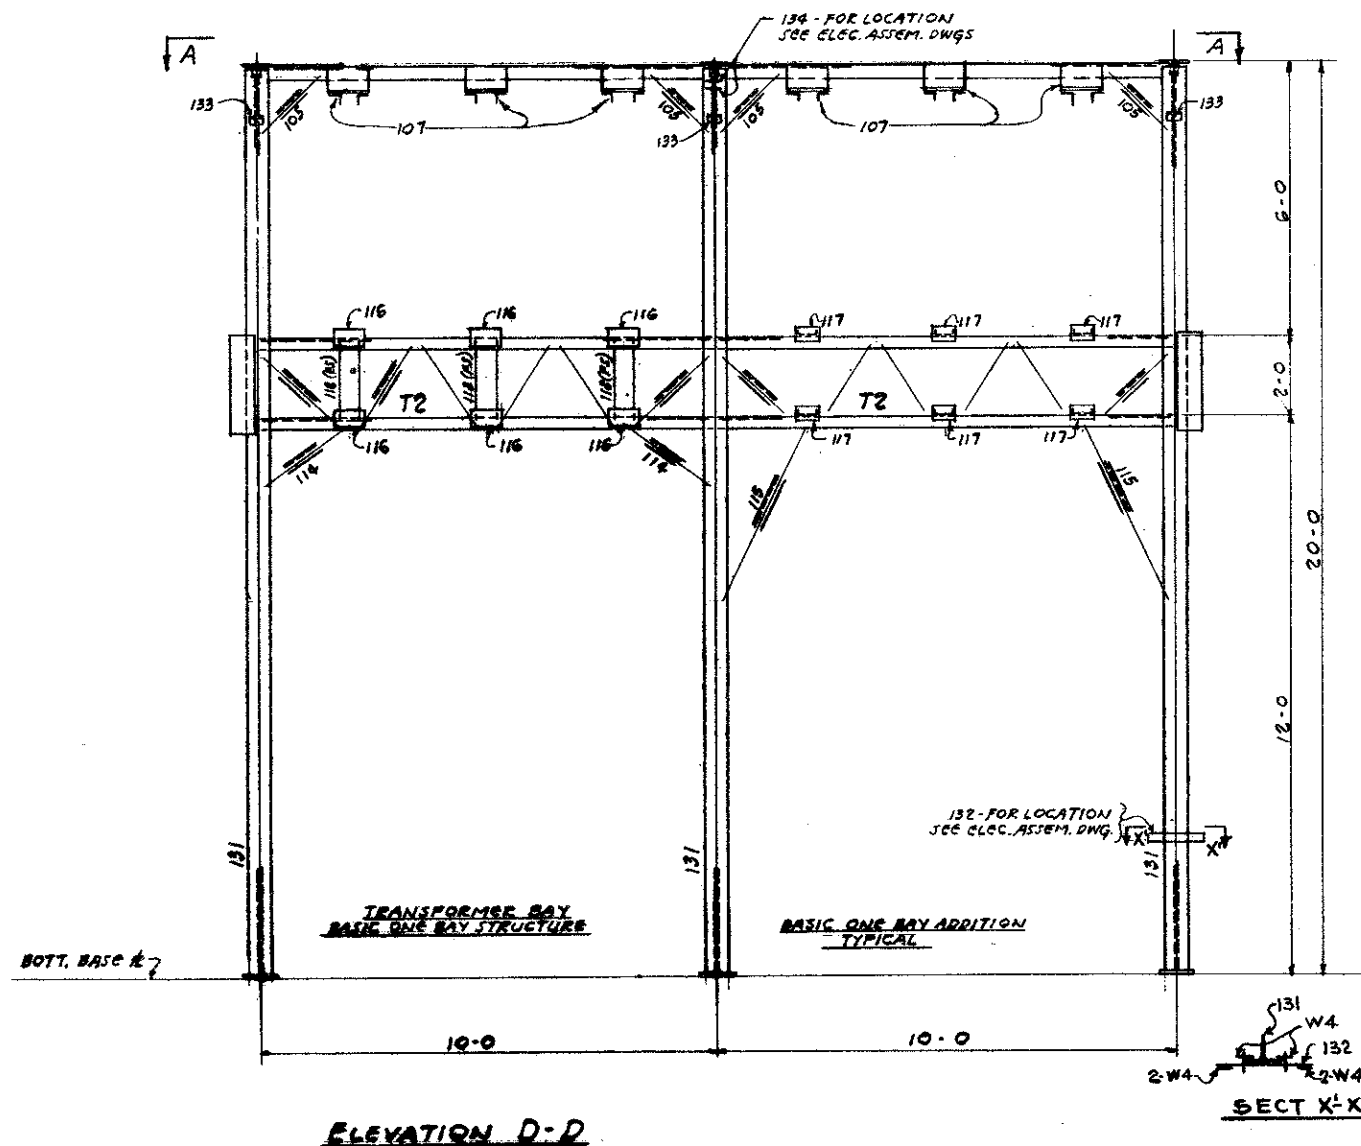

ALL LINE TENSIONS TO BE 1000# HL. ALL LINES PERPENDICULAR TO STRUCT.

- GENERAL NOTES:**
1. BOLTS 3/8", OPEN HOLE: 1/8" UNLESS NOTED
 2. ALL STEEL C.H. GR. A36
 3. ALL STEEL H.D. GALV.
 4. ALL BOLT HEADS OUTSIDE

B/M 0-6011-1081
ITEM NO. 10400 703

"THIS DRAWING IS THE PROPERTY OF THE POWER COMPANY AND IS LOANED UNDER CONDITION THAT IT IS NOT TO BE REPRODUCED OR COPIED, IN WHOLE OR IN PART, OR USED FOR FURNISHING INFORMATION TO OTHER THAN COMPANIES IN THE AMERICAN ELECTRIC POWER SYSTEM, OR FOR ANY PURPOSE EXTRINSICAL TO THE INTEREST OF THE POWER COMPANY AND IS TO BE RETURNED UPON REQUEST."

**4/12 KV STRUCTURE
ERECTION DIAGRAM**

OHIO POWER CO.
DIVISION SIX
MILLST. STATION
PORTSMOUTH OHIO
DR. No. EDS-70400/975

ARCH.	ELEC.	MECH.	STR.
SCALE:	ENGINEERING DIV.	DATE:	4/11/69
CH. 1/2	DESIGN DIV.	DATE:	4/11/69
NO. 1/2	AMERICAN ELECTRIC POWER SERVICE CORP.	2 BROADWAY	NEW YORK

11/26/69

SCANNED
NON-STD. SIZE
OCT 22 2001
(NOT TO SCALE)