


Filtered impulses versus reference
pass 160 / stop 200 Hz



Filtered truncation versus full bank

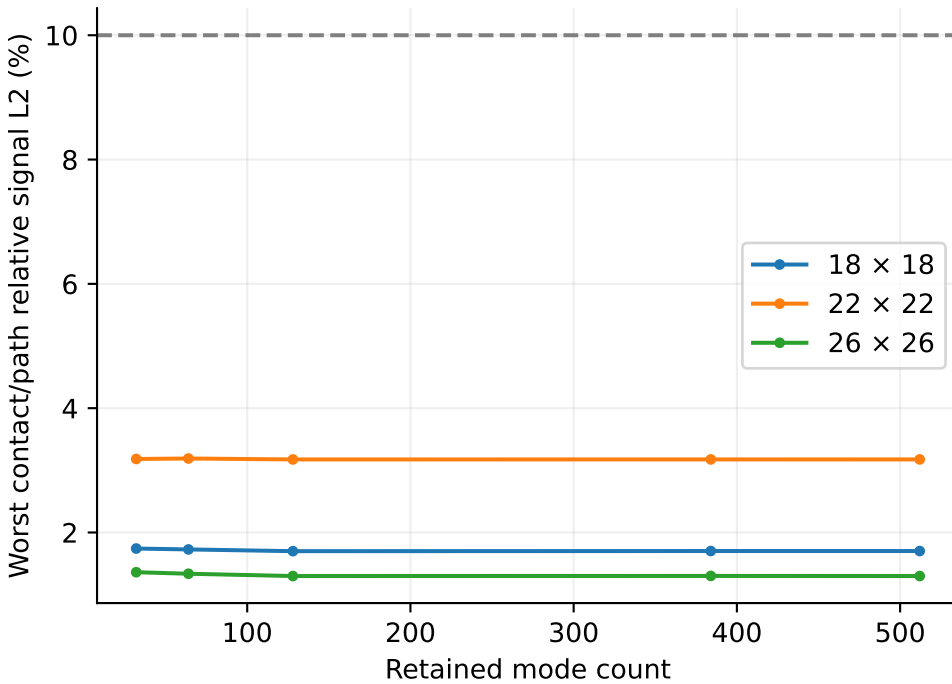