


How facility signals reach DUNE

Proposed paths for monitoring and detector protection.

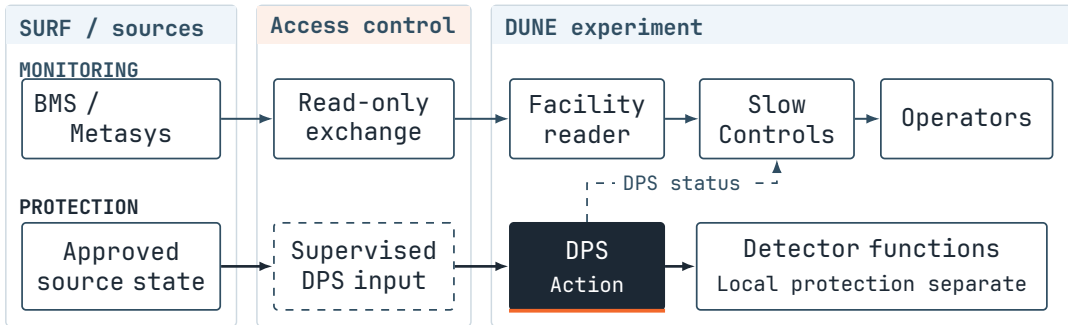

Functional view

Trip link to be defined.


Lost monitoring

Data gaps are flagged.

Recovery


Owner confirms restart.

Smoke is an input. The PDU is an actuator.

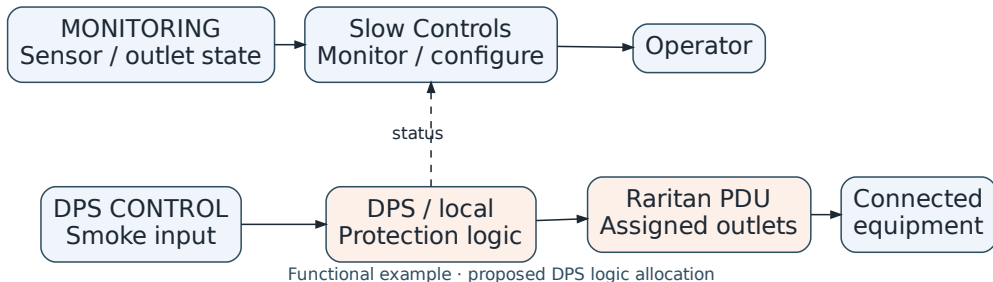


Map each outlet to its equipment. Keep required controls powered.

Start from the defined interfaces

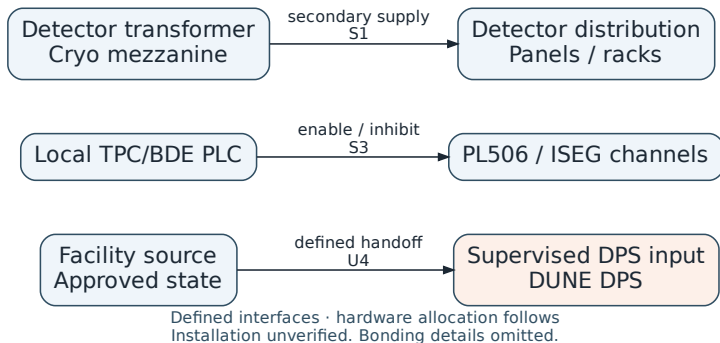

A power boundary, a control interface and an ownership boundary are different things.

Warm electronics lose power; controls need backup

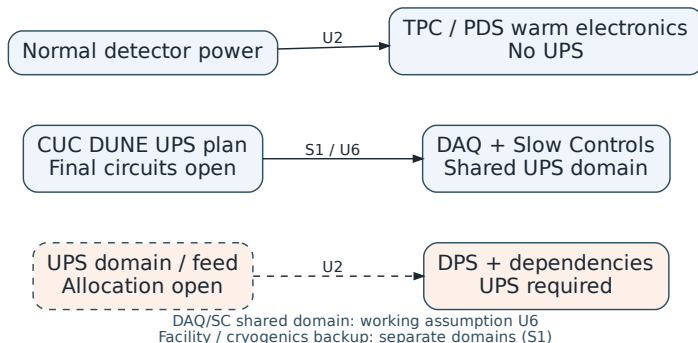

DAQ chillers are unbacked: battery reserve alone does not define the shutdown window.

Five agreements make the interface precise

1. **Limits:** the subsystem defines what can damage it.
2. **Condition:** the source team owns what it reports.
3. **Response:** DPS connects the agreed detector actions.
4. **Endpoint:** identify what acts and how we verify it.
5. **Failure:** define loss behavior and permission to restart.

First result: one boundary map, with an owner on both sides.

Proposed rules. Detailed protocols and registers follow.