


How facility signals reach DUNE

Diagram 01 • Reference architecture

The building management system shares status. The Detector Protection System (DPS) handles approved trips.

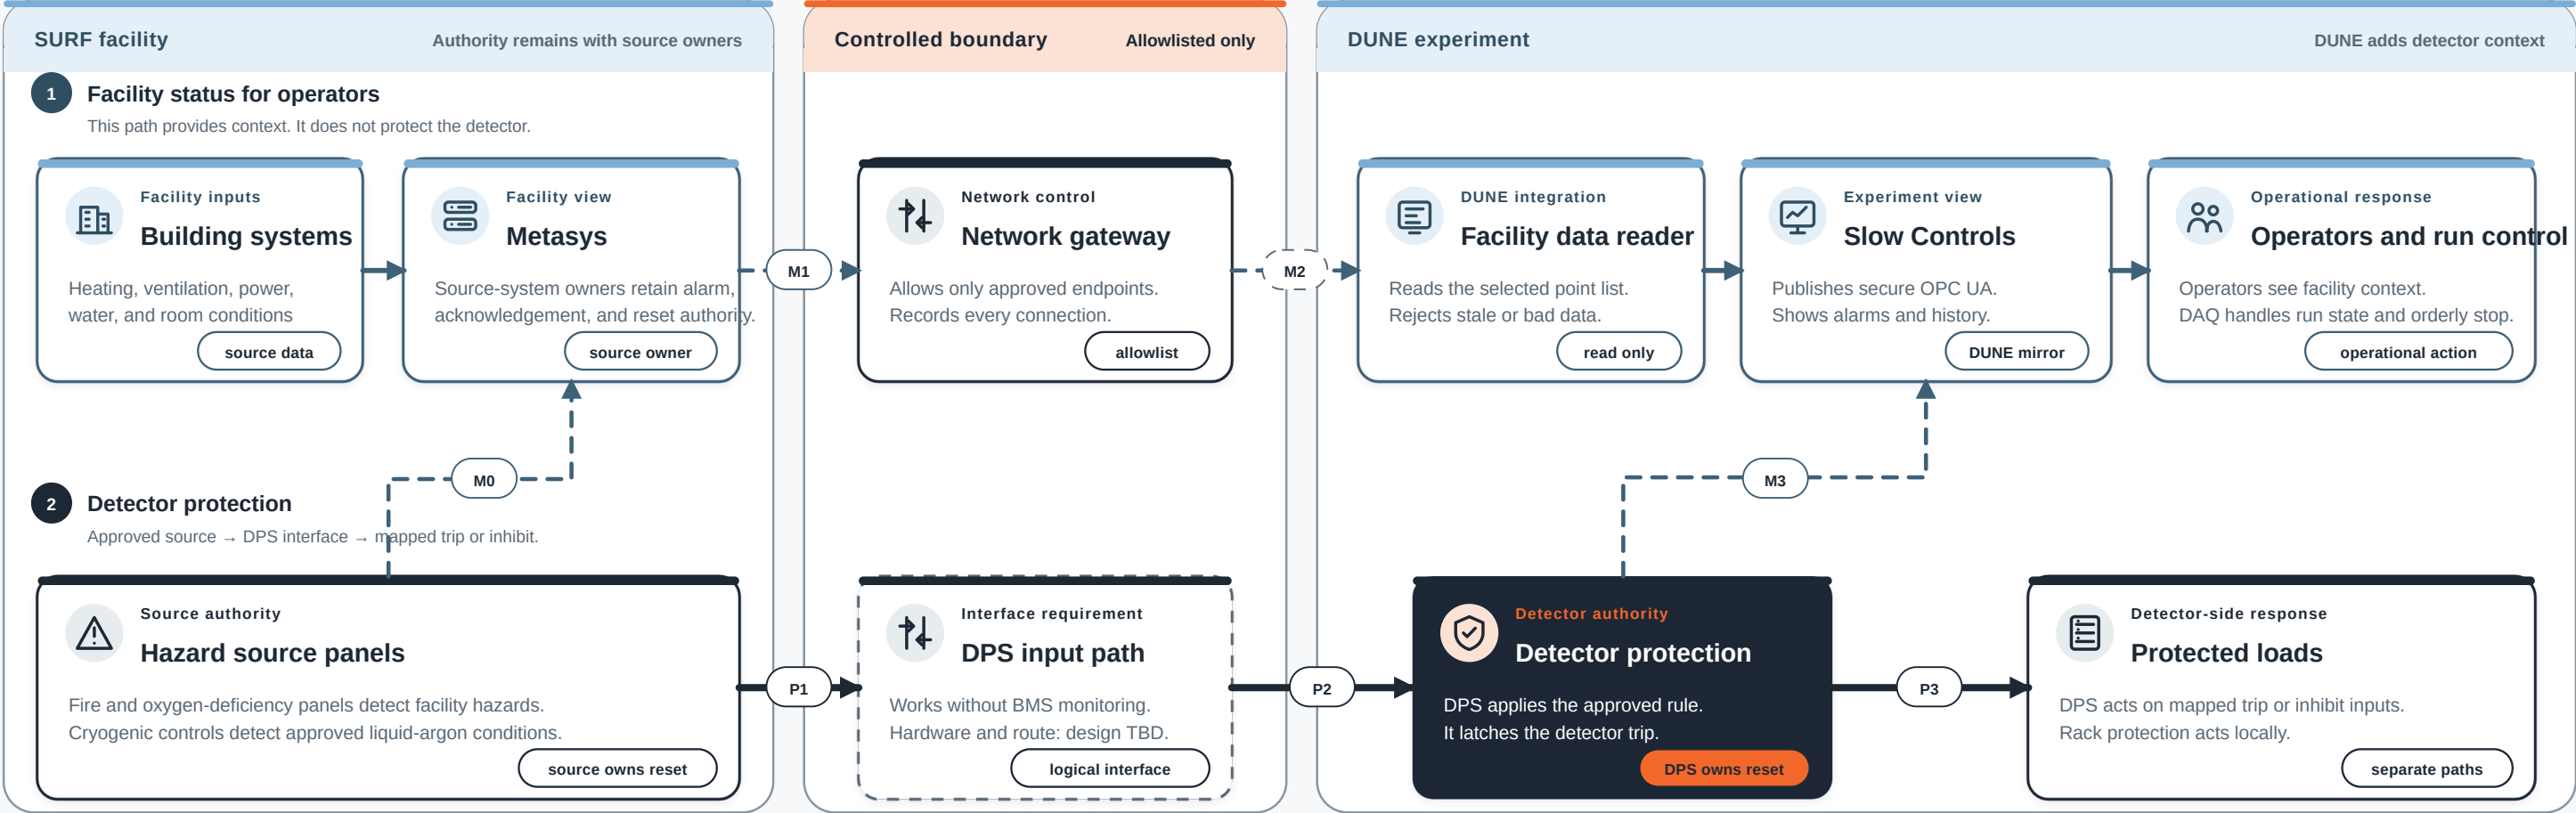

Functional architecture—not a placement drawing
DAQ-stop and rack-local paths have separate contracts.

A broken link appears as UNKNOWN or STALE
Slow Controls marks missing or old values as unknown.

Recovery does not restart equipment
An authorized owner checks the source, then resets the trip.

MONITORING	M0 source status • M1 selected building-management points • M2 BACnet/IP boundary • M3 DPS status
PROTECTION	P1 approved source state • P2 DPS interface—physical design TBD • P3 mapped detector trip or inhibit