The Lowe's

PRIMARY BATH



Color Palette

The primary bath is designed as a calm, restorative retreat with the feel of an upscale spa. A palette of warm greys and soft neutral whites is complemented by subtle green- and blue-grey undertones, creating a serene and timeless atmosphere. Alabaster accents and a thoughtful mix of polished and brushed nickel add depth, sophistication, and a refined touch of luxury.



Lowe's

Primary Bath



Finishes

Polished Nickel

Brushed Nickel

Lighting



Wall Sconce
Frosted glass shade
Polished Nickel



Chandelier
Frosted glass shade
Polished Nickel

Paint

Ceiling, trim, doors & cabinetry
SW 7005 Pure White

Walls
SW 9166 Drift of Mist

Recessed ceiling plane
SW 7657 Tinsmith

Bath Rug



Sable, Silver - Multi, 6x9

Door Style



Name, finish
Full overlay

Hardware & Accessories



Pulls, Polished Nickel



Purist Towel Rod,
Polished Nickel



Recessed Medicine Cabinet





Purist Toilet Paper Brushed Nickel



Purist Grab Bar Brushed Nickel


Marble Tile

Accent vanity wall & shower



Calacatta Verde 12x24
honed, straight horizontal


Shower floor & niche back

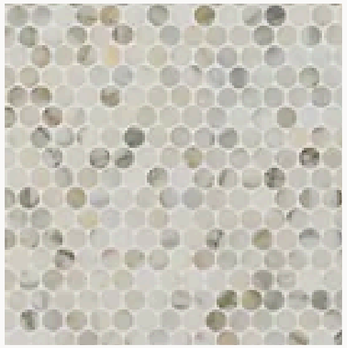

Calacatta Verde Premium
1" penny round honed

Porcelin Tile


Flooring, main area & toilet compartment

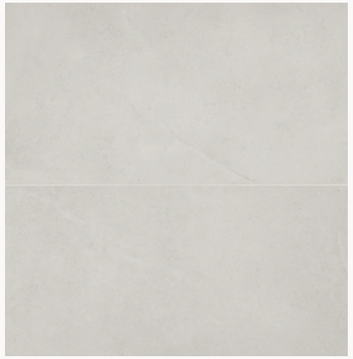

New Rock Perla White
24x48, matte
straight install

Solid Surface

Countertop, shower bench & niches

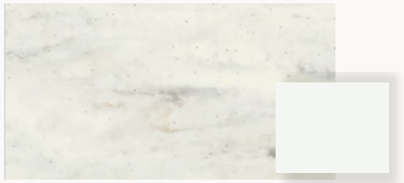

Beige Travertine with
Designer White integrated sink

Shower walls



Grey

Fixtures & Exhast fans



Occasion
Sink Faucet
Brushed Nickel



Occasion
Rite Temp
& Valve trim kit
Brushed Nickel

Occasion
Shower Kit
Brushed Nickel





Aero Pure
Recessed Light &
Humidity Sensor
exhaust fan
Enclosed shower




Atmo
Exhaust fan
& light
Toilet
compartment




Memoirs
Stately
Comfort Height
One Piece Toilet

Shiloh Cabinetry · Tumble · AeroPure Fans · KOHLER · Sherwin-Williams · Wilsonart · Rejuvenation

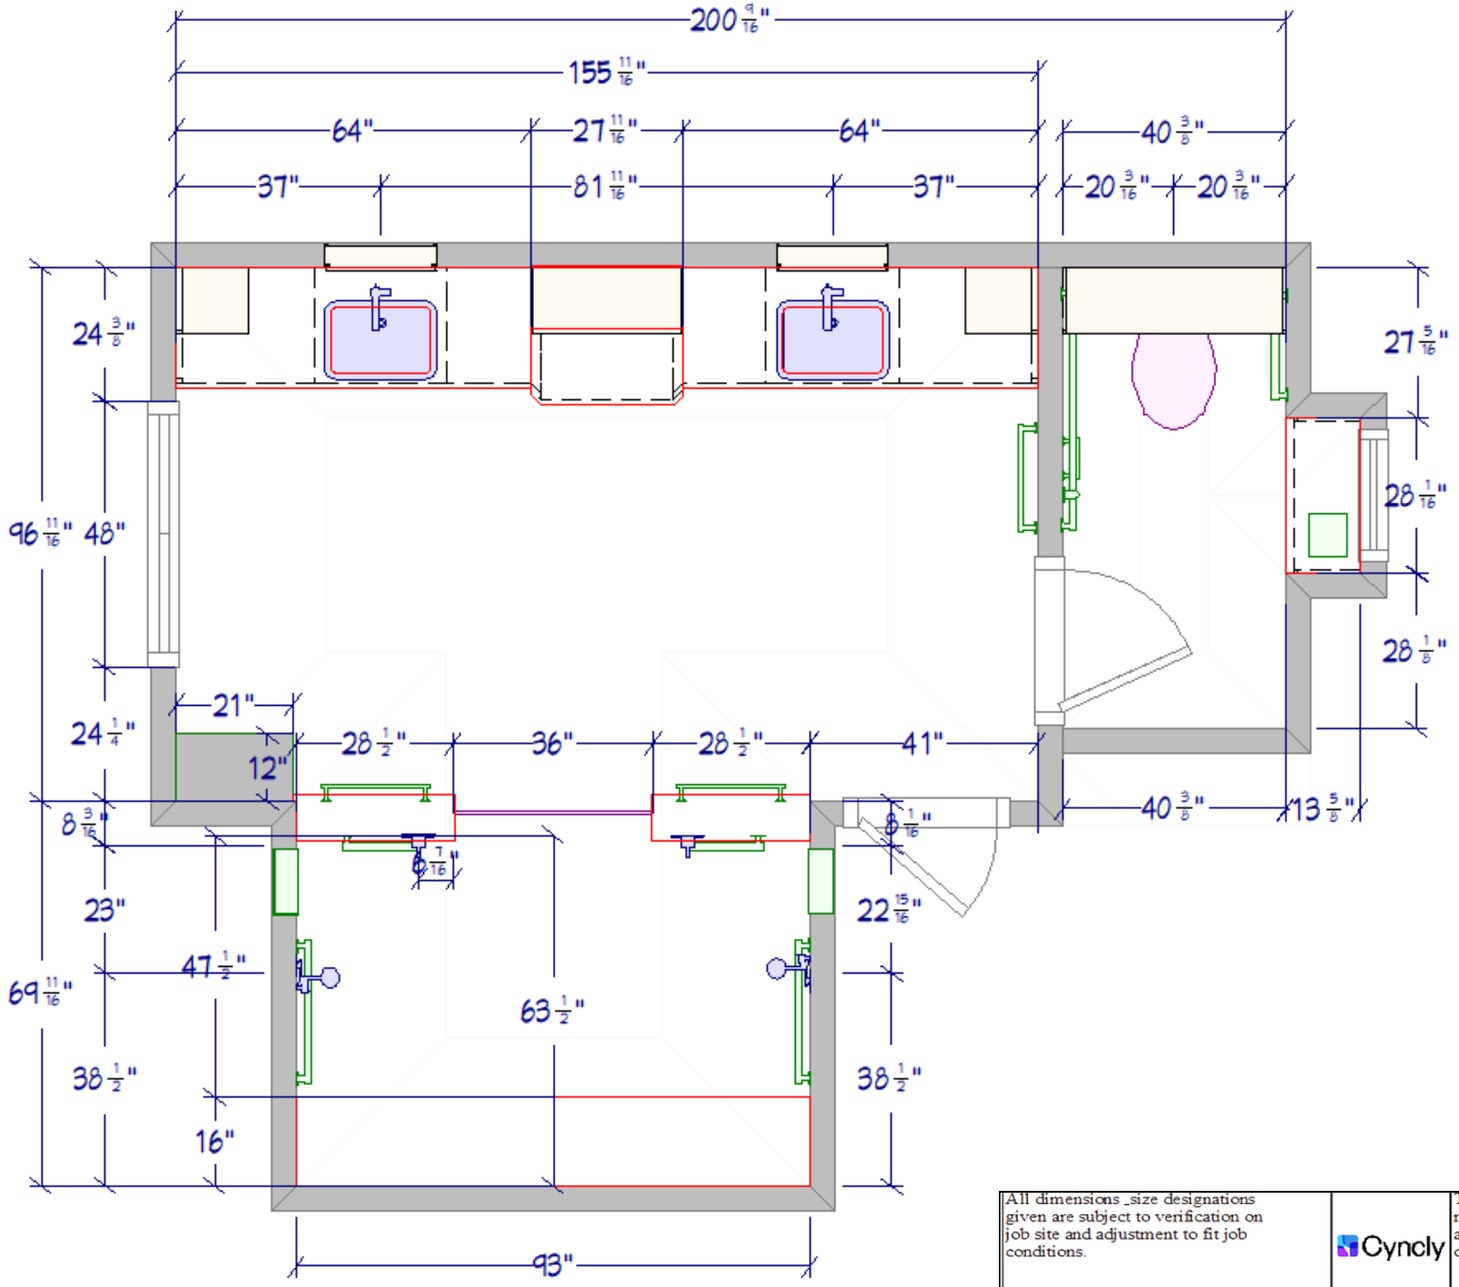

All dimensions _size designations given are subject to verification on job site and adjustment to fit job conditions.	Cyncly	This is an original design and must not be released or copied unless applicable fee has been paid or job order placed.	Designed: 4/29/2026 Printed: 5/5/2026
Lowes_Primary Bath	All	Drawing #: 1	Scale : 0 1/2" = 1'

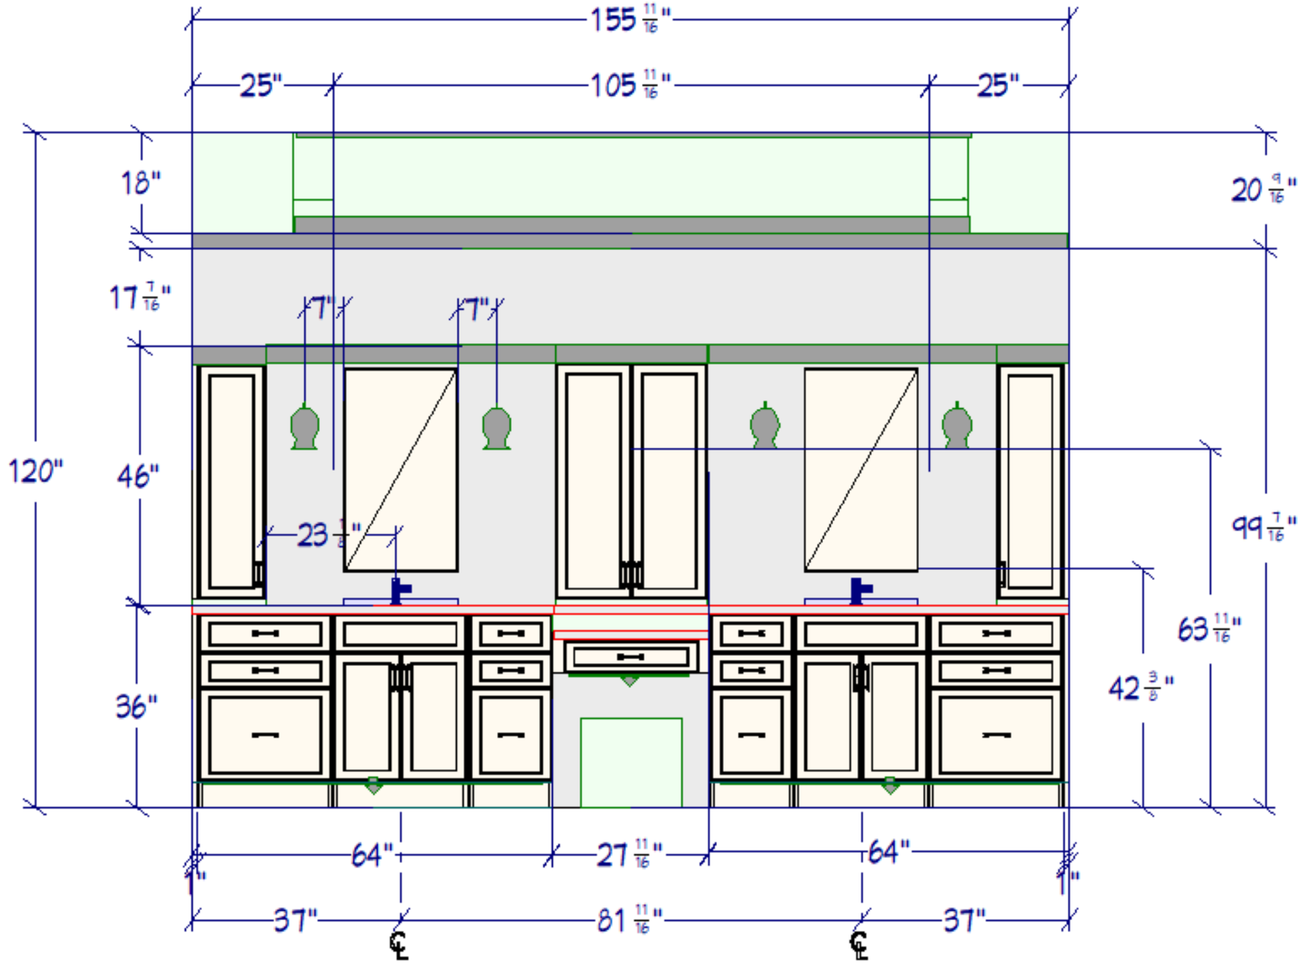

All dimensions _size designations given are subject to verification on job site and adjustment to fit job conditions.	Cyncly	This is an original design and must not be released or copied unless applicable fee has been paid or job order placed.	Designed: 4/29/2026 Printed: 5/5/2026
Lowes_Primary Bath	El 4	Drawing #: 1	Scale : 0 1/2" = 1'

NKBA BATH GUIDELINES

- [x] **Guildeline 1:** ***Door/Entry*** *Clear opening of a door way should be at least 32"*
- [x] **Guildeline 2:** ***Door Interference*** *No entry or fixture should interfere with another and/or ssafe use of fixtures & cabinets*
- [x] **Guildeline 3:** ***Ceiling Height*** *Bathrooms shall have a minimum floor to ceiling height of 80" over fixture and at the front clearance area for fixtures. Minimum floor area 30" x 30" at shower head*
- [x] **Guildeline 4:** ***Clear Space*** *of at least 30" from the front edge of all fixtures to any opposite bath fixture wall or obstacle*
- [x] **Guildeline 5:** ***Single Lavatory*** *placement should be at least 20" from wall or tall obstacle*
- [x] **Guildeline 6:** ***Double Lavatory*** *Placement should be at least 36" between the centerlines*
- [x] **Guildeline 7:** ***Lavatory/Vanity Height*** *should vary between 32"-43" to fit user*
- [x] **Guildeline 8:** ***Countertop Edges*** *should be clipped or rounded corners*
- [x] **Guildeline 9:** ***Shower Size*** *interior should be at least 36" x 36"*
- [x] **Guildeline 10:** ***Tub & Shower Controls*** *should be accesslbe from both inside and outside the shower spray and located between 38"-48" above the floor*
- [x] **Guildeline 11:** ***Shower/Tub Control Valves*** *must be one of the following; pressure balanced, thermostatic mixing or combination of both*
- [x] **Guildeline 12:** ***Shower Seat*** *should be 17"-19" high and 15" deep. Does not infringe on the minimum interior size of shower (900 square inches)*


NKBA BATH GUIDELINES

- [x] **Guildeline 13: *Tub/Shower Surround*** *around tub and shower pan should be covered in a waterproff material extending at least 3" avove the showerhead rough-in*
- [x] **Guildeline 14: *Grab Bars*** *should be planned to facilitate access to and manenuevering within the tub and shower areas. Walls should be reinforced at the time of construction to allow for future install. Grab bars must support a static loadof 300lbs. Grab bars must be 1 & 1/4" to 1 & 1/2" in diameter and extend 1 & 1/2" from the wall.*
- [x] **Guildeline 15: Glazing**, *glass in and around tub and showers must be tempered glass.*
- [x] **Guildeline 16: *Tub/Shower Door*** *hinges shall open outward*
- [x] **Guildeline 17: *Steps*** *should not be placed outside of a tub. If steps are used a grab bar/handrail is mandatory.*
- [x] **Guildeline 18: *Flooring*** *should be slip resistant and be specified for the genteral bath flooring shouwer floors and tub/shower bottoms.*
- [x] **Guildeline 19: *Equipment Access***, *all equipment including access panels, must be installed as per manufacturers specifications. All manufacturer's instructions must be available for installers and inspectors and left for homeowners.*
- [x] **Guildeline 20: *Toilet/Bidet Placement*** *should have a centerline distance of at least 18" from wall or bath fixture. Minimum distance is 15"*
- [x] **Guildeline 21: *Toilet Compartment*** *should have an area of at least 36" x 66" with a door swinging out to the room or use of a pocket door. Minimum size toilet compartment is 30" x 60".*
  *** Door swing into toilet compartment was original to space, no change was made to door.*

NKBA BATH GUIDELINES

- ☑ **Guildeline 22: *Storage*** *provided for accessible toiletries, bath linens, grooming and general bathroom supplies a point of use.*
- ☑ **Guildeline 23: Accessories**, mirror should be placed above or near lavatory at a height that takes the user's eye height into consideration. Toilet paper should be located 8" - 12" in front of the edge of the toilet bowl, centered at 26" above the floor.
- ☑ **Guildeline 24: *Electrical Recepricals*** *should be all GFCI and located at electrical appliance points of use. At least one GFCI protected receptical must be installed within 36" of the outside edge of the lavatory. All recepticals must be protected by a ground-fault-circut-interrupters (GFCI). A receptacle shall not be installed within a shower or tub space. Switches shall not be isntalled within wet locations in tub or shower spaces unless installed as part of the listed tub or shower assembly.*
- ☑ **Guildeline 25: *Lighting*** *in bathroom must include general lighting and task lighting should be provided for each general area in the bathroom (ie. grooming, showering) . At least one wall-switch controlled light must be provided. Switch must be placed at the entrance. All light fixtures installed within tub and shower spaces should be marked "suitable for damp/wet locations" Hanging fixtures cannot be located within a zone of 3' horizontally and 8' vertically from the top of the bathtub rim.*
- ☑ **Guildeline 26: *Ventilation*** *should be planned by mechanical exhaust system, vented to the outside for each enclosed area.*
- ☑ **Guildeline 27: *Heat*** *through heat lamp, toe kick heater or floor heat should be considered. All bathrooms should have an appropriate heat source to maintain a minimum room temperature of 68 degrees Fahrenheit.*



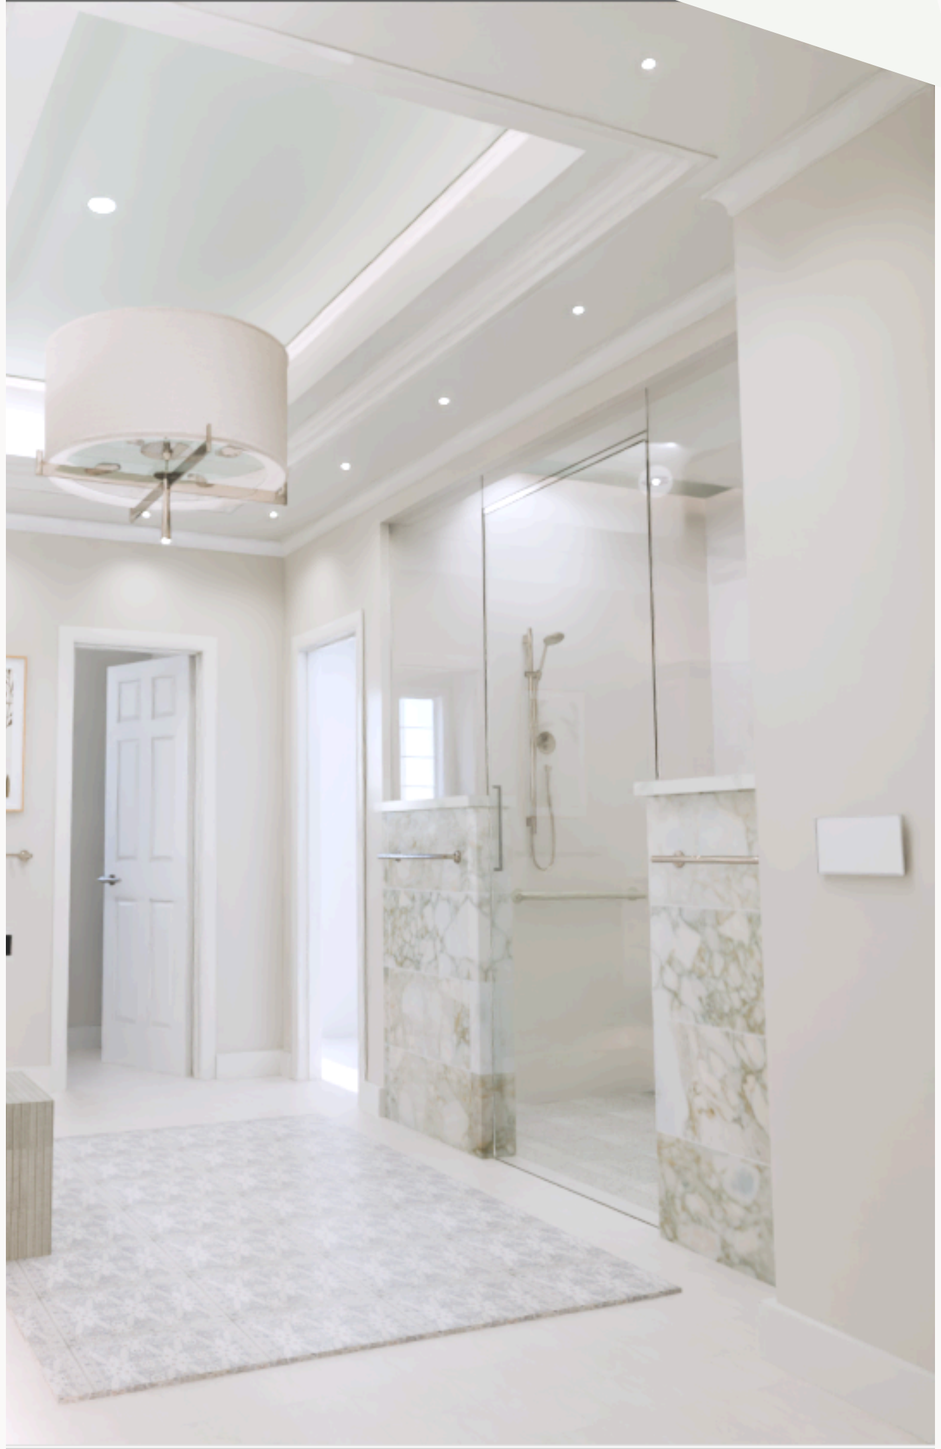







Thank you



E-mail	donovanhouse@outlook.com
Website	www.donovanhouse.com
Phone	972-393-0684