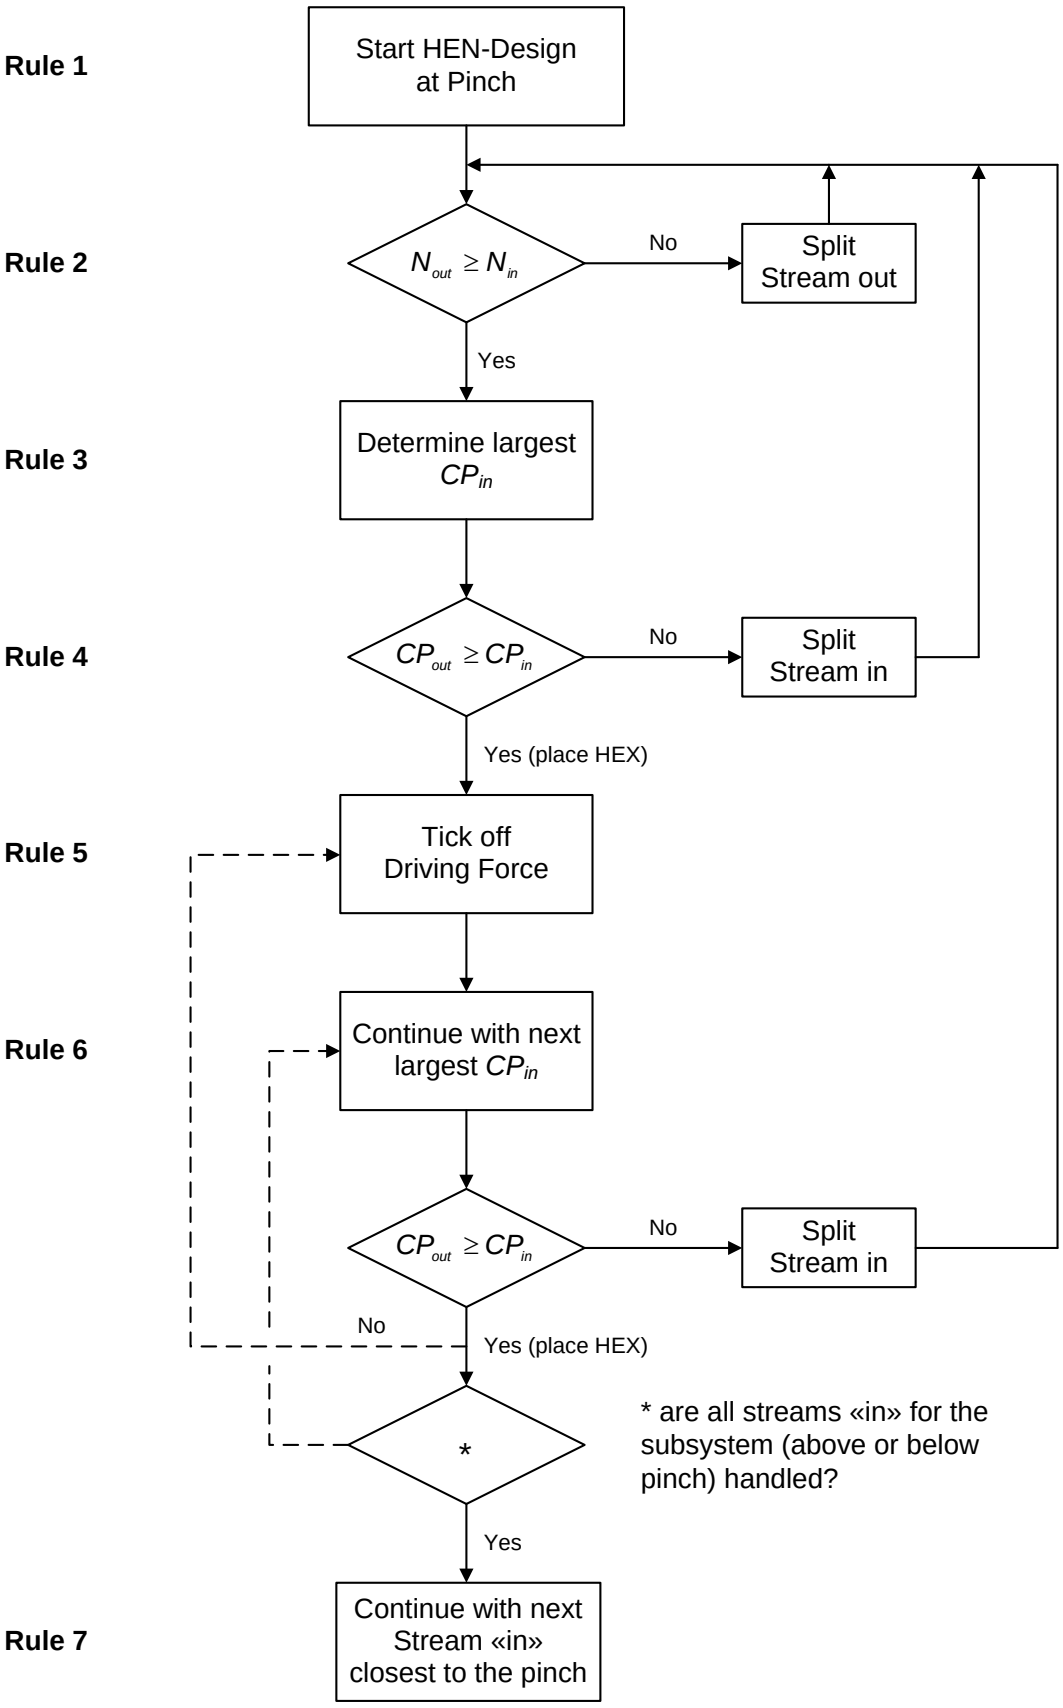Addendum: Rules for the design of Heat Exchanger Networks