Installed generating capacity by technology and investment period

Capacity in operation in each period (not additions). Totals labelled. The four scenarios differ by < 1 GW in total in every period.

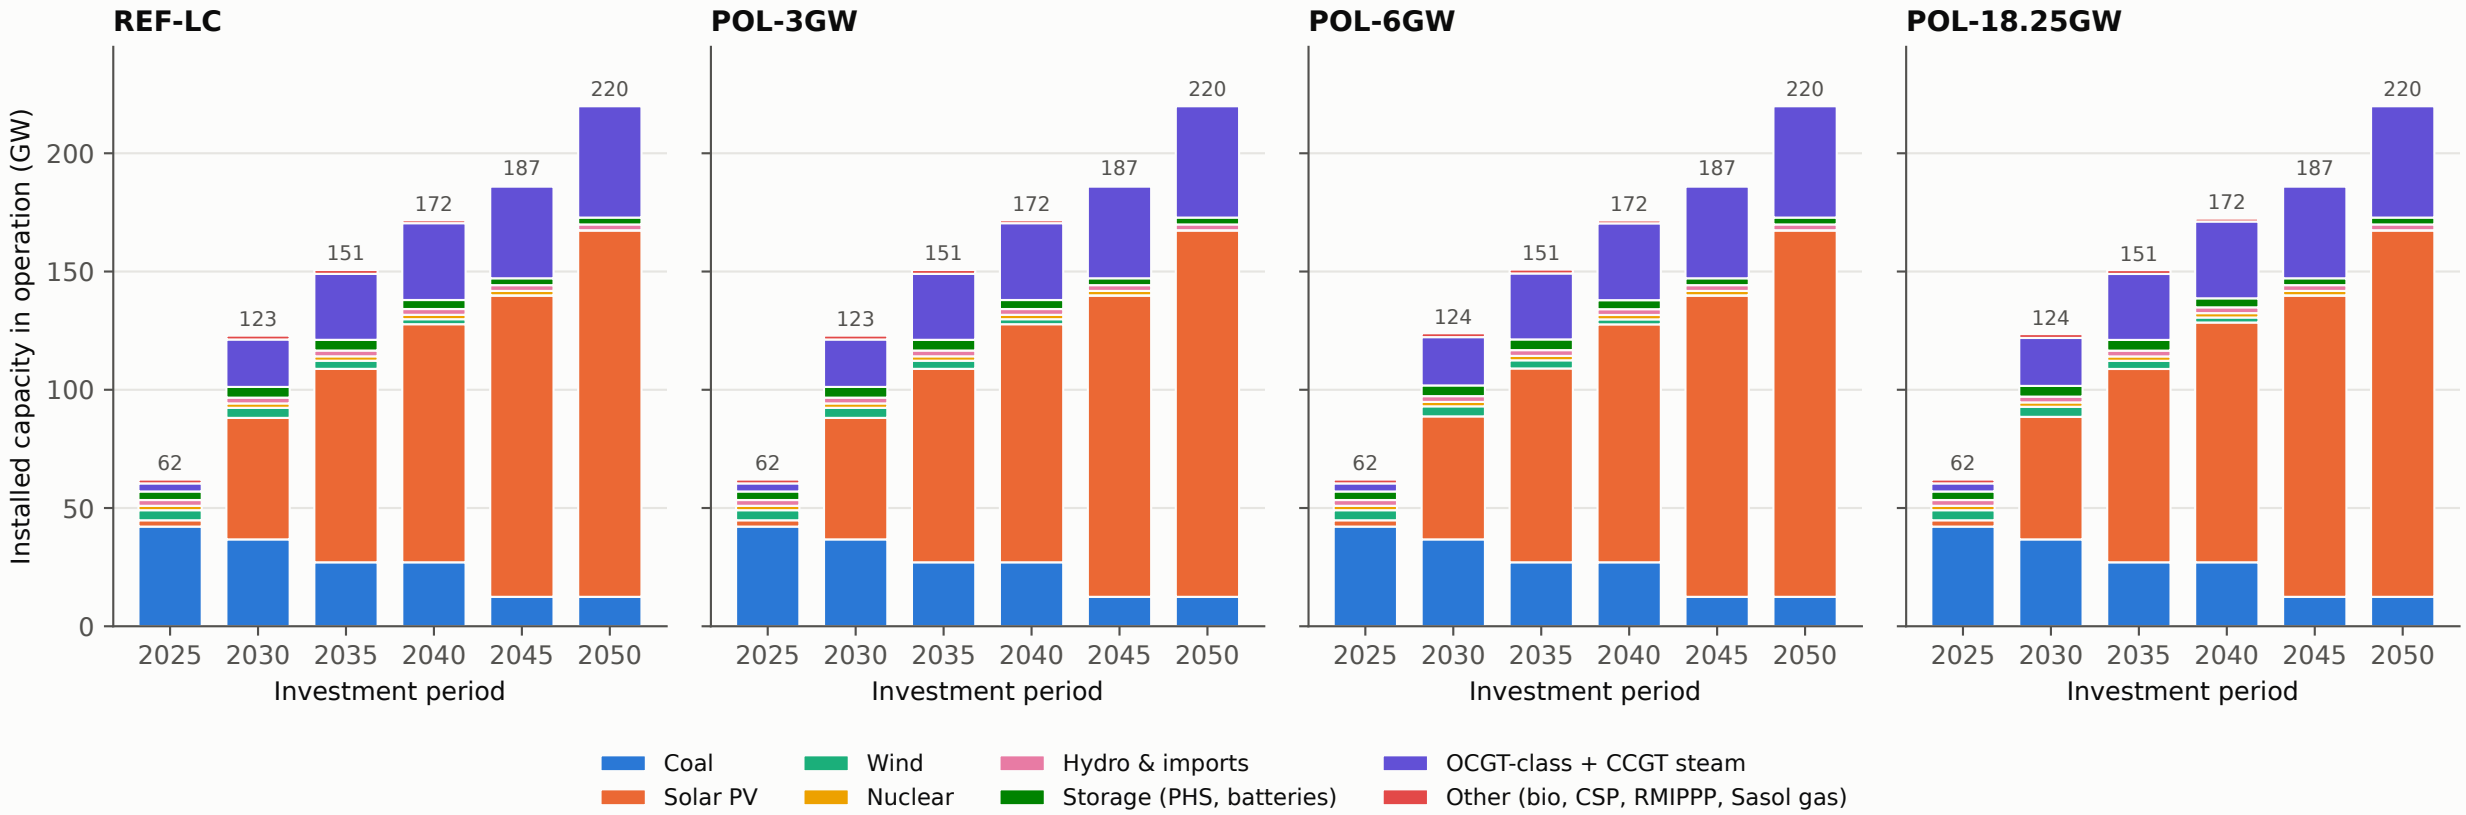

Source: PyPSA-RSA gas-to-power study, saved solved networks (REF-LC 22 Oct 2026; POL runs 27 Oct 2026), commit db90bff. 1-node, LC-182h development results - not hourly-resolution findings.
Storage in GW of power capacity. OCGT-class + CCGT steam is split by carrier in Figure 2.