Peaking capacity: OCGT-class and CCGT steam by carrier

Totals are identical in all scenarios from 2035 (47.13 GW in 2050). Mandated natural-gas OCGT replaces H2-ready and diesel OCGTs; steam is the binding addition.

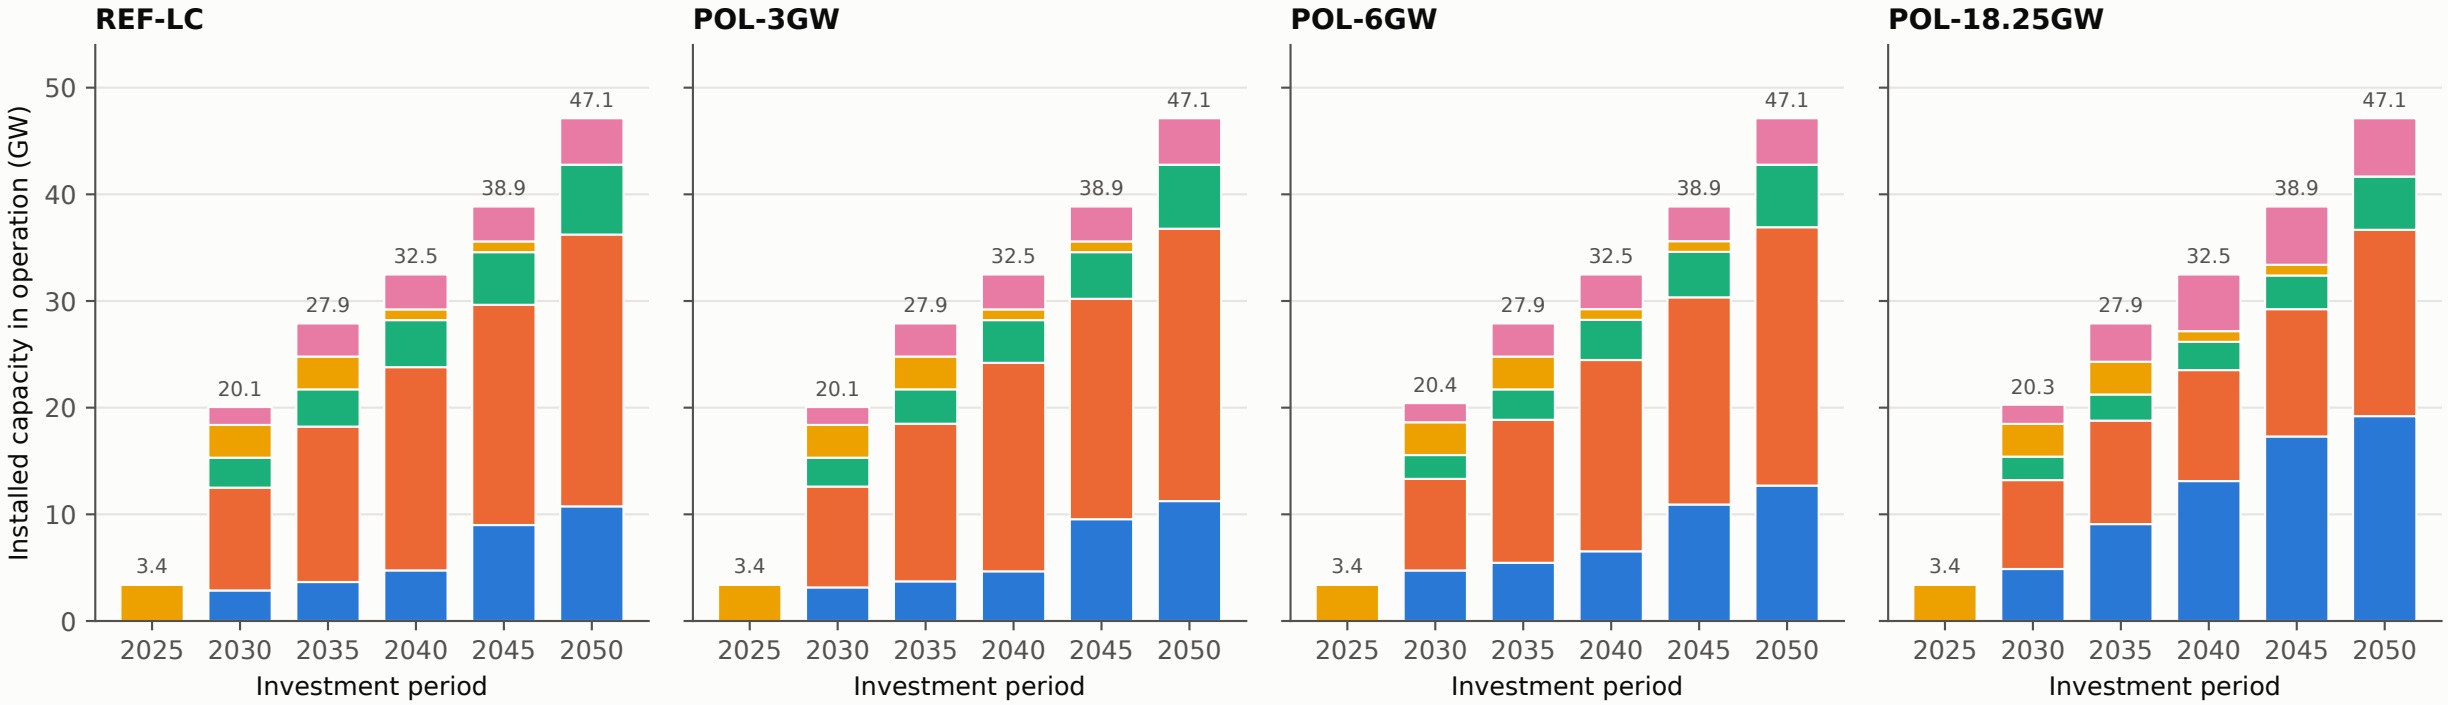

Source: PyPSA-RSA gas-to-power study, saved solved networks (REF-LC 22 Oct 2026; POL runs 27 Oct 2026), commit db90bff. 1-node, LC-182h development results - not hourly-resolution findings.
Natural-gas, H2-ready and new-diesel OCGTs share capex, fixed O&M and efficiency (fuel identical until H2 conversion), so the split between them is near-degenerate; totals are robust. CCGT = separate gas-turbine and steam generators linked only by steam output <= 0.427 x OCGT output.