New gas-turbine and steam capacity by vintage: actual builds versus policy minimums

Additions, not installed totals. Steam builds sit exactly at every POL-6GW and POL-18.25GW minimum (binding); natural-gas floors are met largely by substitution.

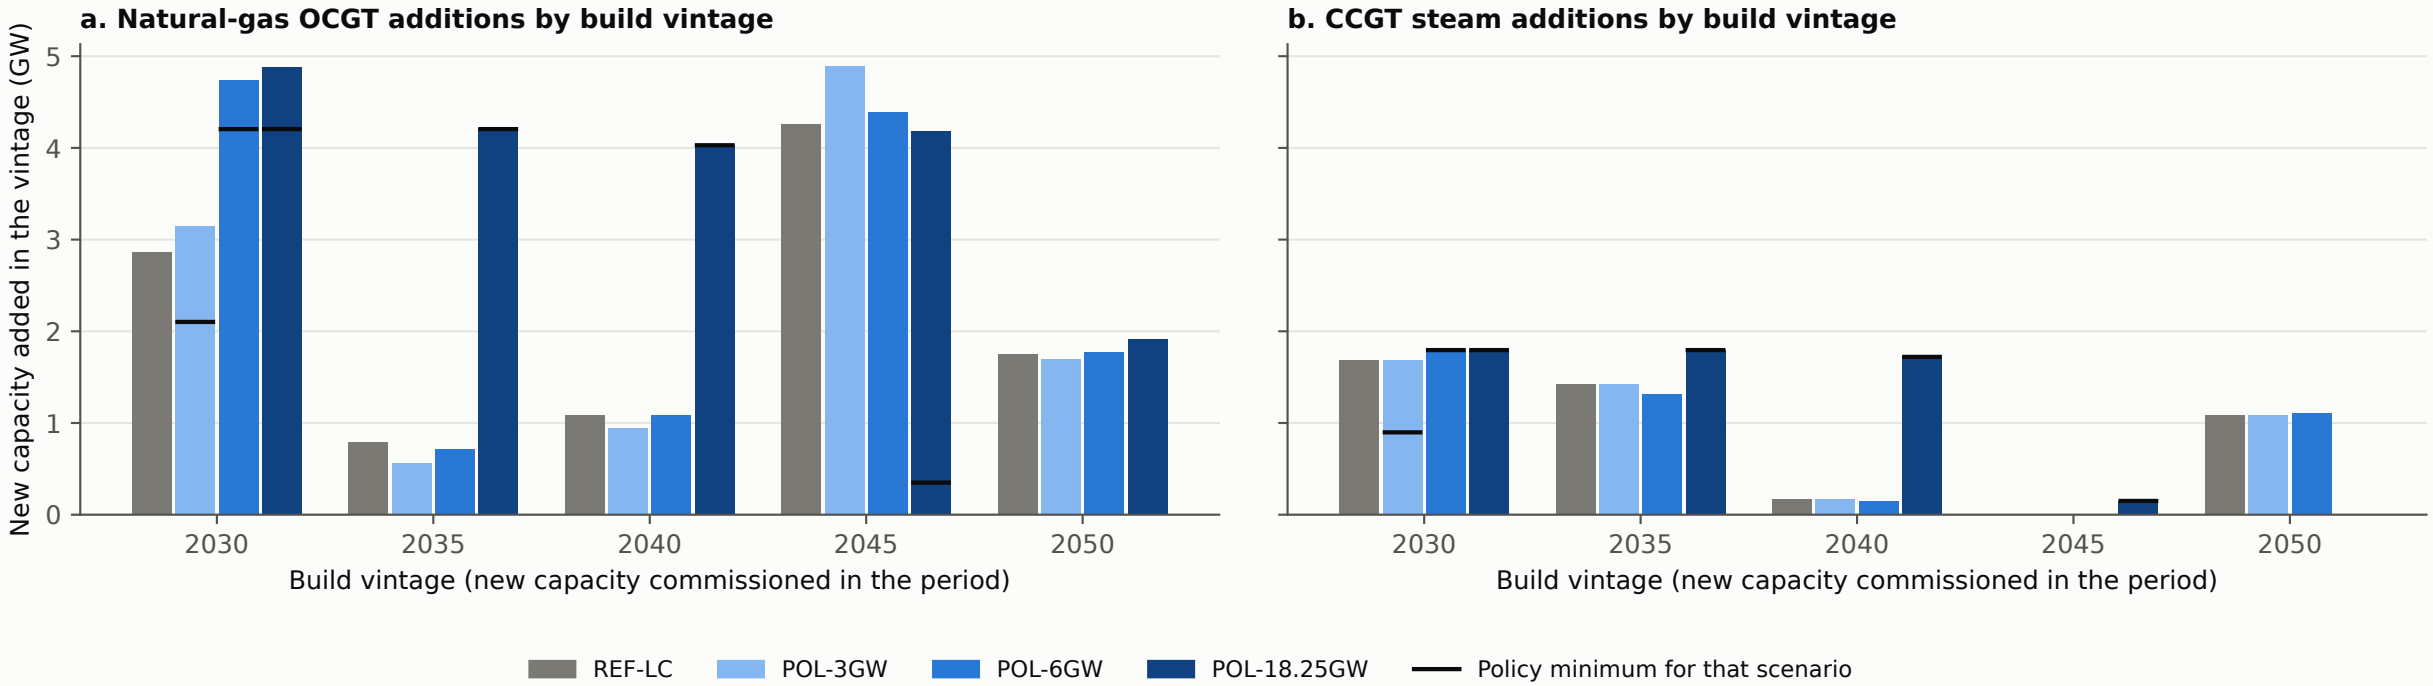

Source: PyPSA-RSA gas-to-power study, saved solved networks (REF-LC 22 Oct 2026; POL runs 27 Oct 2026), commit db90bff. 1-node, LC-182h development results - not hourly-resolution findings.
Black ticks = minimum-build requirement (extendable_technologies::min_annual_installed; 2041 IRP tranche counted in the 2045 vintage). Natural-gas OCGT additions above the floor replace identical H2-ready/diesel units; vintage-level splits are near-degenerate.