


2 E-010 ELECTRICAL POWER & AUXILIARY RDT PLAN
3/16" = 1'-0"

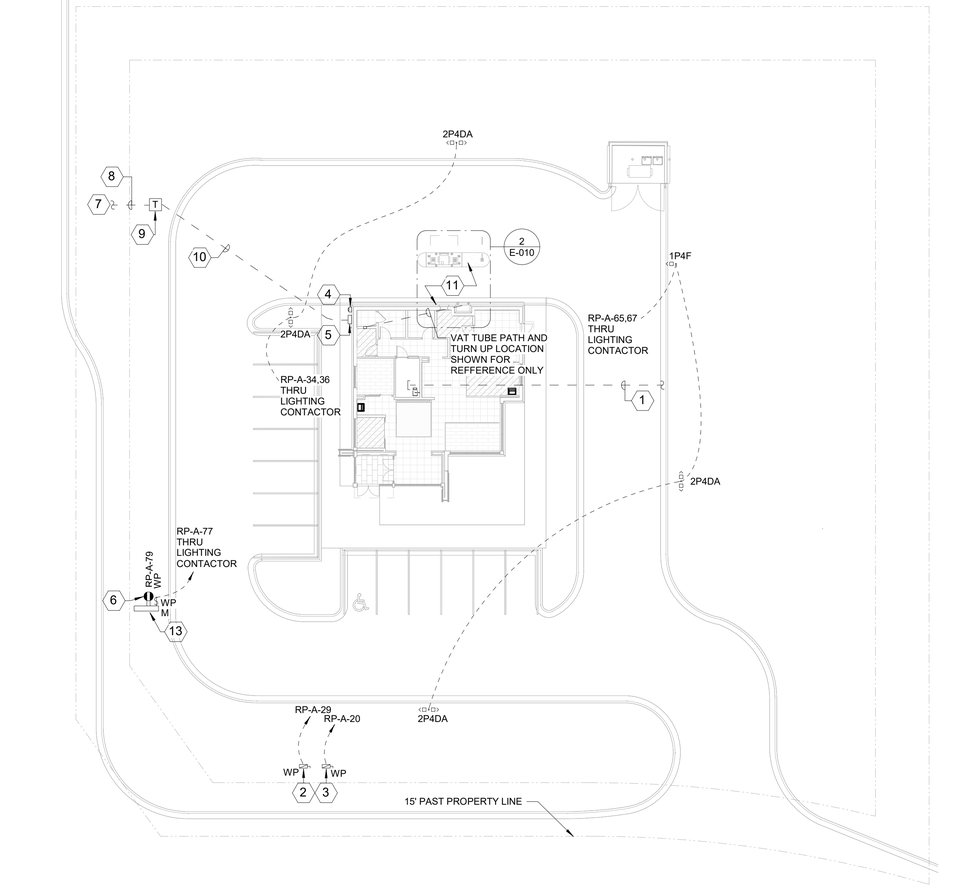

1 E-010 ELECTRICAL SITE PLAN
1" = 20'-0"

SHEET NOTES:

1. COORDINATE ALL SITE CONDUIT ROUTINGS WITH GENERAL CONTRACTOR.
2. REFER TO CIVIL PLANS FOR FINAL LOCATION AND ELECTRICAL REQUIREMENTS OF ALL SIGNAGE, UTILITY CONNECTION POINTS, AND SITE UTILITIES/EQUIPMENT SUCH AS LIFT STATIONS, IRRIGATION PUMPS/CONTROLLERS, HOT BOXES, ETC.
3. ALL UNDERGROUND WIRING SHALL BE LOCATED WITHIN 12" OF BACK OF CURB IN ALL LOCATIONS.
4. BACKFILL, TAMP, AND RESURFACE ALL EXISTING PAVEMENT/ASPHALT AND RESTORE ALL EXISTING LANDSCAPING DISTURBED AS A RESULT OF TRENCHING AND/OR DIRECTIONAL BORING TO ITS ORIGINAL CONDITION.
5. ALL UTILITY SERVICE SHALL BE VERIFIED WITH THE UTILITY COMPANIES PRIOR TO BIDDING AND ALL RESULTING COSTS SHALL BE INCLUDED IN BID
6. ACTUAL INSTALLATION OF ALL UTILITY SERVICES SHALL BE ACCORDING TO FINAL UTILITY COMPANY PLANS.
7. PROVIDE PULLWIRE IN ALL EMPTY CONDUITS.
8. USE JOINT TRENCHING WHEREVER POSSIBLE

KEYED NOTES:

1. ROUTE (2)4"C TO MAIN TELEPHONE SERVICE ENTRANCE. ROUTE TO CLEAR STRUCTURAL FOOTING. CONDUITS SHALL BE STUBBED UP AND CAPPED 12" A.F.F. IN BUILDING. ASBUILT DRAWINGS MUST SHOW CONDUIT LENGTH AND ROUTE
2. IRRIGATION BACKFLOW. VERIFY LOCATION DISCONNECT SHALL BE NEMA 3R.
3. DDCV HOTBOX. VERIFY LOCATION DISCONNECT SHALL BE NEMA 3R.
4. ELECTRIC UTILITY METER. PROVIDE ELECTRIC UTILITY METER PER POWER COMPANY REQUIREMENTS. REFER TO ELECTRICAL RISER DIAGRAM FOR ADDITIONAL INFORMATION. EXACT LOCATION TO BE DETERMINED BY UTILITY COMPANY REPRESENTATIVE IN FIELD.
5. SERVICE DISCONNECT. PROPOSED ELECTRICAL SERVICE DISCONNECT MOUNTED ON BUILDING EXTERIOR. REFER TO ELECTRICAL RISER DIAGRAM FOR ADDITIONAL INFORMATION.
6. MAINTENANCE RECEPTACLE: PROVIDE 120V, 20A, GFCI WEATHER-RESISTANT DUPLEX RECEPTACLE IN WEATHERPROOF SURFACE MOUNTED BELL BOX WITH "EXTRA DUTY WHILE-IN-USE" METALLIC COVER.
7. STUBOUT AND TERMINATE PER UTILITY COMPANY REQUIREMENTS. VERIFY LOCATION OF HIGH VOLTAGE SERVICE POINT PRIOR TO BIDDING AND INCLUDE ALL COST IN BID.
8. (2)5"C FOR HIGH VOLTAGE SERVICE FROM PROPERTY LINE TO TRANSFORMER SLABS VERIFY LOCATION AND ROUTING. HIGH VOLTAGE CONDUIT SHALL BE 48" DEEP. TERMINATE IN ACCORDANCE WITH UTILITY COMPANY REQUIREMENTS INCLUDING TRENCHING AND BACKFILL TO 90% COMPACTION.
9. TRANSFORMER SLABBOX WITH TRAFFIC GUARDS PER UTILITY COMPANY REQUIREMENTS. VERIFY SIZE, LOCATION AND ORIENTATION WITH UTILITY COMPANY. CONTRACTOR WILL PROVIDE TRANSFORMER SLABS INSTALLED COMPLETE IN ACCORDANCE WITH UTILITY COMPANY REQUIREMENTS. PROVIDE ADEQUATE GUARD RAILING AROUND POWER TRANSFORMERS IN PARKING AREAS.
10. SECONDARY FROM TRANSFORMER TO MAIN DISCONNECT. VERIFY ROUTING WITH UTILITY COMPANY AND ROUTE TO CLEAR STRUCTURAL FOOTING. SEE RISER DIAGRAM. TERMINATE IN ACCORDANCE WITH PLANS AND SPECIFICATIONS.
11. CANOPY LIGHT FIXTURE: FACTORY INSTALLED CANOPY LIGHT PROVIDED BY KIOSK MANUFACTURER. EC TO COORDINATE WITH THE MANUFACTURER AND MAKE FINAL CONNECTION.
12. DRIVE-THRU ATM: PROVIDE CONDUIT AND WIRING FOR ATM. REFER TO ELECTRICAL FLOOR PLAN ON SHEET E-500 FOR ADDITIONAL INFORMATION.
13. MONUMENT SIGN POWER: COORDINATE EXACT LOCATION OF SIGNAGE STUB-UP WITH SIGN VENDOR AND MAKE FINAL ELECTRICAL CONNECTIONS. PROVIDE 120V, 20A, TOGGLE SWITCH IN METALLIC BELL BOX WITH METALLIC WEATHERPROOF COVER IF DISCONNECT IS NOT FURNISHED WITH MONUMENT SIGN. COORDINATE EXACT LOCATION WITH CIVIL DRAWINGS.

PRAXIS3
100 Peachtree St NW
Suite 1450
Atlanta, GA 30303
404-875-4500 tel
www.praxis3.com

GEORGIA REGISTERED No. 041604 PROFESSIONAL ENGINEER RAHN ONEAL WILLIAMS

Copyright (c) 2024 Praxis3, LLC

All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by Praxis3 shall retain all common law, statutory and other reserved rights, including copyright thereto.

This drawing may not be reproduced in whole or in part without written permission of Praxis3. It is to be returned upon request. Scales as stated are valid on the original drawings.

Rev	Date	Comments
	07/02/2026	PERMIT SET

Client:
FIFTH THIRD BANK

Project Number: 26032
Project Name:
FIFTH THIRD BANK WATSON 1,900 SF

2711 WATSON BOULEVARD
WARNER ROBBINS, GA 31093

Key Plan:

Sheet Title:
ELECTRICAL SITE PLAN AND REMOTE DRIVE THRU

Sheet Number:
E-010

6/30/2026 2:31:58 PM