HORIZONTAL SCALE: IN FEET
0' 10' 20' 40'
SCALE: 1" = 20'

VERTICAL SCALE: IN FEET
4' 2' 1' 0'
SCALE: 1" = 2'

STRUCTURE TYPES


STSWCB:	GDOT STD 1033D	STDWCB:	GDOT STD 1034D
STSWCB:	GDOT STD 1019A TYPE A	STYI:	NYOPLAST W/DOME
STGI:	GDOT STD 1019A TYPE E	STFE:	GDOT STD 1120
STHW:	GDOT STD 1001B HEADWALL	STOCS:	SEE DETAILS SHEET C-6.2

PROFILE LEGEND


EXISTING GRADE:

PROPOSED GRADE:

100 YR. HGL:

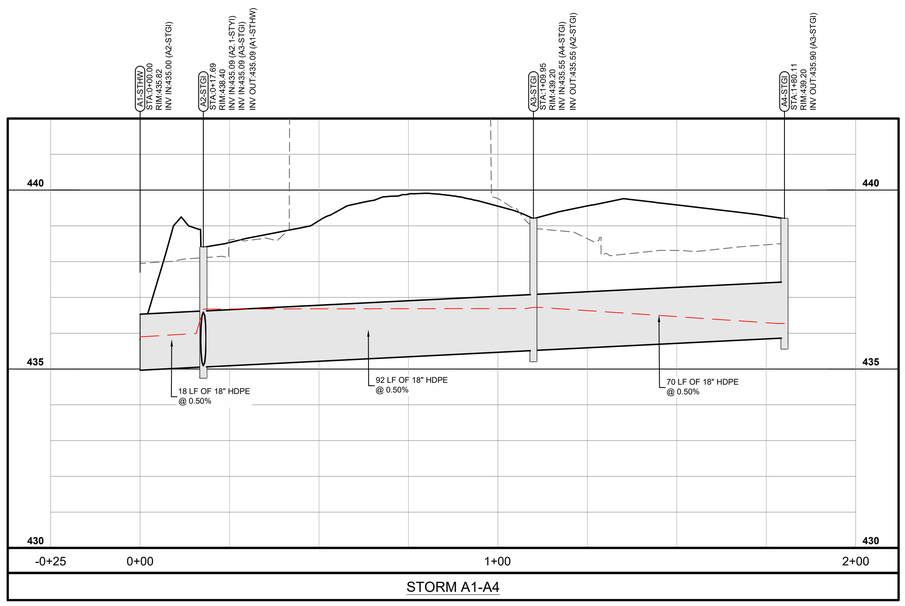


STORM A1-A4

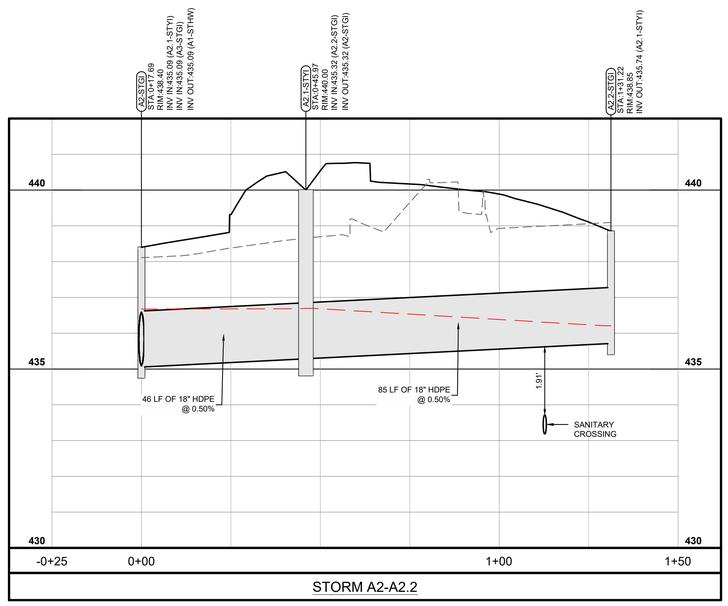

STORM A2-A2.2



STORM B1-B2

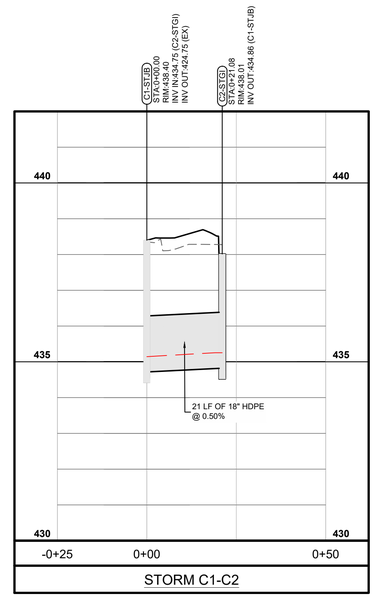

STORM C1-C2

Storm Sewer Tabulation

Page 1

Station Line	To Line	Len (ft)	Drng Area Incr (ac)	Drng Area Total (ac)	Rnoff coeff (C)	Area x C Incr	Area x C Total	Tc Inlet (min)	Tc Syst (min)	Rain (I) (in/hr)	Total flow (cfs)	Cap full (cfs)	Vel (ft/s)	Pipe Size (in)	Pipe Slope (%)	Invert Elev Dn (ft)	Invert Elev Up (ft)	HGL Elev Dn (ft)	HGL Elev Up (ft)	Grnd / Rim Elev Dn (ft)	Grnd / Rim Elev Up (ft)	Line ID
1	End	7 692	0.22	0.55	0.90	0.20	0.50	5.0	7.1	11.0	5.44	8.11	4.91	18	0.51	435.00	435.09	435.90	435.99	437.03	438.40	A1-A2
2	1	92 253	0.07	0.16	0.90	0.06	0.14	5.0	5.6	11.9	1.71	8.03	3.08	18	0.50	435.09	435.55	436.68	436.69	438.40	439.20	A2-A3
3	2	70 167	0.09	0.09	0.90	0.08	0.08	5.0	5.0	12.4	1.00	8.03	1.80	18	0.50	435.55	435.90	436.72	436.27	439.20	439.20	A3-A4
4	1	45 966	0.03	0.17	0.90	0.03	0.15	5.0	5.7	11.9	1.82	8.05	1.05	18	0.50	435.09	435.32	436.68	436.68	438.40	440.00	A2-A2.1
5	4	85 257	0.14	0.14	0.90	0.13	0.13	5.0	5.0	12.4	1.56	7.98	2.11	18	0.49	435.32	435.74	436.70	436.21	440.00	438.94	A2.1-A2.
6	End	21 076	0.10	0.10	0.90	0.09	0.09	5.0	5.0	12.4	1.11	8.22	3.01	18	0.52	434.75	434.86	435.14	435.25	438.40	438.06	C1-C2
7	End	15 110	0.01	0.01	0.01	0.00	0.00	5.0	5.0	12.4	6.20	5.03	5.51	15	0.52	434.87	435.00	435.87	436.18	438.25	438.00	B1-B2

Project File: 75670007 - QAQC.stm | Number of lines: 7 | Run Date: 7/9/2026

NOTES:Intensity = 55.26 / (Inlet time + 5.30) ^ 0.64; Return period =Yrs. 100 ; c = cir e = ellip b = box

Storm Sewers v2024.00

Inlet Report

Page 1

Line No	Inlet ID	Q = CIA (cfs)	Q carry (cfs)	Q capt (cfs)	Q Byp (cfs)	Junc Type	Curb Inlet Ht (in)	Curb Inlet L (ft)	Grate Inlet Area (sqft)	Grate Inlet L (ft)	Grate Inlet W (ft)	Gutter So (ft/ft)	Gutter W (ft)	Gutter Sw (ft/ft)	Gutter Sx (ft/ft)	Gutter n	Gutter Depth (ft)	Gutter Spread (ft)	Inlet Depth (ft)	Inlet Spread (ft)	Inlet Depr (in)	Byp Line No
1	A2-STGI	2.45	0.00	2.45	0.00	Comb	3.0	4.00	2.24	2.42	1.42	Sag	1.50	0.060	0.020	0.000	0.26	9.99	0.26	9.99	0.0	Off
2	A3-STGI	0.78	0.00	0.78	0.00	Comb	3.0	4.00	2.24	2.42	1.42	Sag	1.50	0.030	0.020	0.000	0.12	5.11	0.12	5.11	0.0	Off
3	A4-STGI	1.00	0.00	1.00	0.00	Comb	3.0	4.00	2.24	2.42	1.42	Sag	1.50	0.060	0.020	0.000	0.17	5.30	0.17	5.30	0.0	Off
4	A2.1-ST	0.33	0.00	0.33	0.00	DrGrt	0.0	1.63	1.22	1.63	1.63	Sag	2.00	0.020	0.020	0.000	0.07	8.62	0.07	8.62	0.0	Off
5	A2.2-ST	1.56	0.00	1.56	0.00	Comb	3.0	4.00	2.24	2.42	1.42	Sag	1.50	0.060	0.020	0.000	0.21	7.27	0.21	7.27	0.0	Off
6	C2-STGI	1.11	0.00	1.11	0.00	Comb	3.0	4.00	2.24	2.42	1.42	Sag	1.50	0.060	0.020	0.000	0.17	5.72	0.17	5.72	0.0	Off
7	B2-STO	6.20*	0.00	0.00	6.20	MH	0.0	0.00	0.00	0.00	0.00	Sag	0.00	0.000	0.000	0.000	0.00	0.00	0.00	0.00	0.0	Off

Project File: 75670007 - QAQC.stm | Number of lines: 7 | Run Date: 7/9/2026

NOTES: Inlet N-Values = 0.016; Intensity = 55.26 / (Inlet time + 5.30) ^ 0.64; Return period = 100 Yrs. ; * Indicates Known Q added. All curb inlets are throat.

Storm Sewers v2024.00

PREPARED IN THE OFFICE OF:
GASKINS +LECRAW
a PAPE-DAWSON company
© 2026 GASKINS + LECRAW
3475 CORPORATE WAY
SUITE A
DULUTH, GA 30096
PHONE - 678.546.8100
www.gaskinslecraw.com
PEF008127

REVISIONS:

NO.	DATE	DRAWN BY:	CHECKED BY:
1	-	-	-

CLIENT
PRAXIS3
100 PEACHTREE STREET NW, SUITE 1450, ATLANTA, GEORGIA 30303

PROJECT
FIFTH THIRD BANK - WARNER ROBINS, GA
2711 WATSON BLVD
PARCEL ID: 0W0780-005000
WARNER ROBINS, HOUSTON COUNTY, GEORGIA

SEAL:
GEORGIA REGISTERED ENGINEER
No. PE036681 PROFESSIONAL
* TIMOTHY KYLE SHARPE *
7/9/2026

CALL BEFORE YOU DIG
811
Know what's below. Call before you dig.

SCALE & NORTH ARROW:

DESIGN INFO:

DRAWN BY:	JOA
DESIGNED BY:	MAT
REVIEWED BY:	TKS
JOB #:	75670007
DATE:	JULY 9, 2026

STORM PROFILES

C-4.1

Drawing name: C:\Users\cklentz\Gaskins+LeCraw Dropbox\Shared Folders\Engineering\75670007 - Praxis3 - Fifth Third - Warner Robins_GA\CADD\CONSTR\75670007 - 09 - PROFILES.dwg STORM PROFILES Jul 09, 2026 10:52am by cklentz

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Gaskins + LeCraw, a Pape-Dawson Company shall be without liability to Gaskins + LeCraw, a Pape-Dawson Company, Copyright Gaskins + LeCraw, a Pape-Dawson Company, 2026