
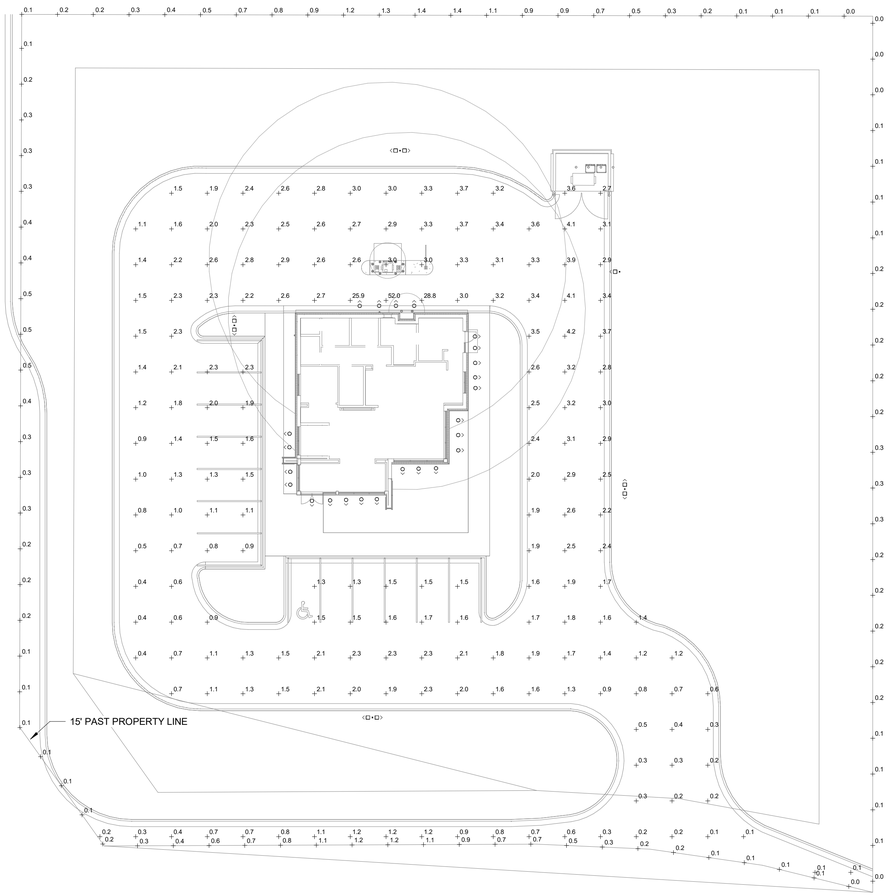


1 E-011 ELECTRICAL PHOTOMETRIC SITE PLAN AT GRADE
1" = 20'-0"

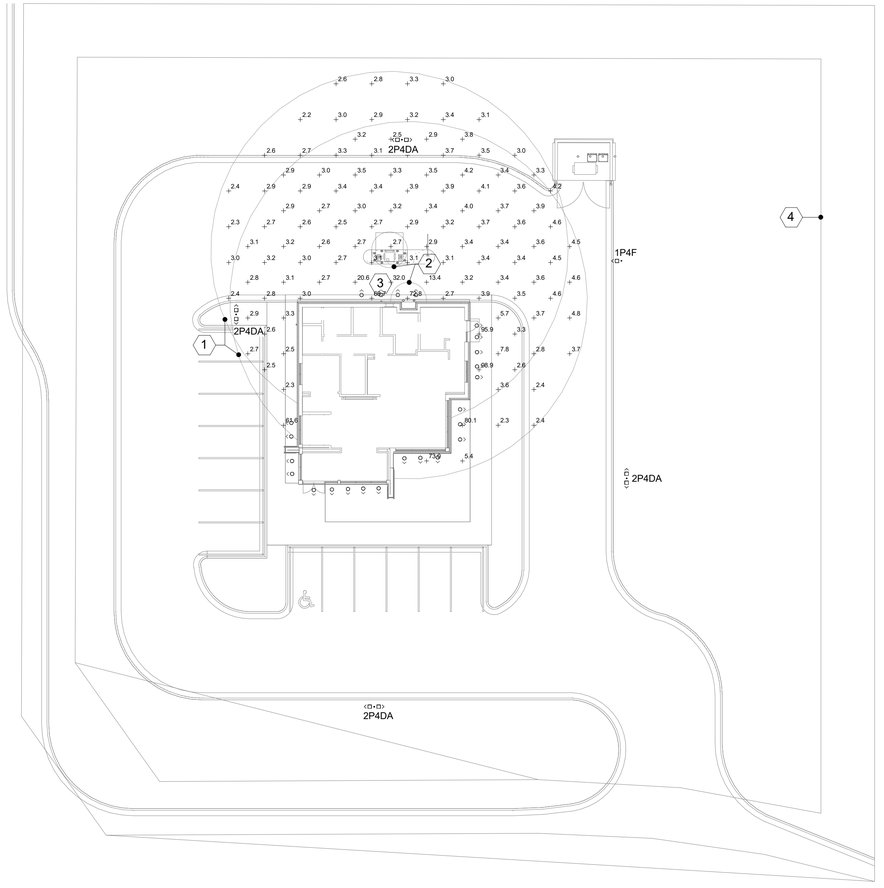

2 E-011 ELECTRICAL PHOTOMETRIC SITE PLAN AT 3'-0"
1" = 20'-0"

LIGHTING STANDARD:

MINIMUM STANDARD

REGULATED STATES: ALABAMA, CALIFORNIA, CONNECTICUT, DISTRICT OF COLUMBIA, FLORIDA, GEORGIA, ILLINOIS, KANSAS, KENTUCKY, LOUISIANA, MARYLAND, MASSACHUSETTS, MISSOURI, MONTANA, NEVADA, NEW HAMPSHIRE, NEW JERSEY, NEW YORK, OREGON, RHODE ISLAND, TEXAS, VIRGINIA, WASHINGTON, VIRGINIA**.

A. BANKING CENTERS IN VIRGINIA MUST COMPLY WITH ALL HOME STATE LAWS AND IS CONSIDERED REGULATED IF THE BANK HEADQUARTERS ARE LOCATED IN A REGULATED STATE.

- A MINIMUM OF TEN (10) FOOT CANDLE POWER AT THE FACE OF THE ATM OR AFTERHOUR DEPOSITORY EXTENDING OUTWARD FIVE (5) FEET IN ALL UNOBSTRUCTED DIRECTIONS.
- A MINIMUM OF TWO (2) FOOT CANDLE POWER EXTENDING OUTWARDS IN ALL UNOBSTRUCTED DIRECTIONS FIFTY (50) FEET FROM THE FACE OF THE ATM AND AFTERHOUR DEPOSITORY.
- A MINIMUM OF TWO (2) FOOT CANDLE POWER IN DEFINED PARKING AREAS WITHIN SIXTY (60) FEET OF THE ATM AND AFTERHOUR DEPOSITORY. IN THE EVENT THE ATM OR AFTERHOUR DEPOSITORY IS LOCATED WITHIN TEN (10) FEET OF THE CORNER OF THE BUILDING AND IS GENERALLY ACCESSIBLE FROM THE ADJACENT SIDE, THERE SHALL BE A MINIMUM OF TWO (2) FOOT CANDLE POWER ALONG THE FIRST FORTY (40) UNOBSTRUCTED FEET OF THE ADJACENT SIDE OF THE BUILDING.
- IF THE ATM OR AFTERHOUR DEPOSITORY IS LOCATED INSIDE A ACCESSIBLE VESTIBULE DURING ANY HOURS OF DARKNESS, A MINIMUM OF 10 FOOT CANDLE POWER AT THE FACE OF THE ATM OR AFTERHOUR DEPOSITORY EXTENDING OUTWARD FIVE (5) FEET IN ALL UNOBSTRUCTED DIRECTIONS. THERE WILL BE A MINIMUM OF TWO (2) FOOT CANDLE POWER AT THE INSIDE OF THE VESTIBULE ENTRY/EXIT DOOR(S). A MINIMUM OF TWO (2) FOOT CANDLE POWER EXTENDING OUTWARDS IN ALL UNOBSTRUCTED DIRECTIONS FIFTY (50) FEET FROM THE VESTIBULE ENTRY/EXIT DOOR. A MINIMUM OF TWO (2) FOOT CANDLE POWER IN DEFINED PARKING AREAS WITHIN SIXTY (60) FEET OF THE VESTIBULE ENTRY/EXIT DOOR. IN THE EVENT THE VESTIBULE ENTRY/EXIT DOOR IS LOCATED WITHIN TEN (10) FEET OF THE CORNER OF THE BUILDING AND IS GENERALLY ACCESSIBLE FROM THE ADJACENT SIDE, THERE SHALL BE A MINIMUM OF TWO (2) FOOT CANDLE POWER ALONG THE FIRST FORTY (40) UNOBSTRUCTED FEET OF THE ADJACENT SIDE OF THE BUILDING. IN URBAN SETTINGS FOR WHICH THERE IS NO DEFINED BANK PARKING AND THE ONLY ACCESS AREA IS A PUBLIC SIDEWALK, A MINIMUM 2 FOOT CANDLE POWER SHALL BE FOR THE FIRST 5 UNOBSTRUCTED FEET FROM THE DOOR. THE MINIMUM FOOT CANDLE READING WILL ALSO BE LIMITED TO BANK CONTROLLED PROPERTY LINES.
- A MINIMUM OF TWO (2) FOOT CANDLE POWER IN THE IMMEDIATE AREA OF THE DESIGNATED ASSOCIATE ENTRANCE/EXIT TO THE FACILITY.
- ALL LIGHTING MEASUREMENTS ARE TO BE TAKEN AT 36 INCHES ABOVE THE GROUND ON A HORIZONTAL PLANE, UNLESS OTHERWISE SPECIFIED BY STATE LAW OR REGULATION (3/07).
- CORPORATE WORKPLACE HAS OVERALL RESPONSIBILITY OF ENSURING THAT BANK PROPERTIES REMAINS IN COMPLIANCE.
- THE MINIMUM STANDARD SHALL APPLY UNLESS A GREATER STANDARD IS REQUIRED BY AN APPLICABLE LAW FOR A PARTICULAR FACILITY LOCATION.

CALCULATION SUMMARY AT 36" AFG

LABEL	CALCTYPE	UNIT	AVG	MAX	MIN	AVG/MIN	MAX/MIN
DRIVEUP VAT 5FT COMPLIANCE	LUMINANCE	FC	PROVIDE BY OTHERS				
DRIVEUP VAT 50FT COMPLIANCE	LUMINANCE	FC	7.8	52.0	2.3	34.8:1	34.8:1
DRIVEUP ATM 5FT COMPLIANCE	LUMINANCE	FC	PROVIDE BY OTHERS				
DRIVEUP ATM 50FT COMPLIANCE	LUMINANCE	FC	8.3	98.9	2.2	3.8:1	45.0:1

SHEET NOTES:

1. PHOTOMETRY CALCULATION:PHOTOMETRIC VALUES SHOWN HEREIN ARE INTENDED FOR DESIGN AND EVALUATION PURPOSES ONLY.THE CALCULATED POINT BY POINT VALUES SHOWN ON THIS SHEET ARE BASED ON A COMPUTER LIGHTING PROGRAM WITH APPROXIMATED PARAMETERS. AS A RESULT, PHOTOMETRIC VALUES MAY VARY FROM ACTUAL FIELD MEASUREMENTS.

KEYED NOTES:

1 ATM/VTM FIVE FOOT COMPLIANCE AREA: A MINIMUM OF TEN (10) FOOT CANDLE POWER AT THE FACE OF THE ATM/AFTERHOUR DEPOSITORY EXTENDING OUTWARD FIVE (5) FEET IN ALL UNOBSTRUCTED DIRECTIONS TO BE PROVIDED BY OWNER'S PREMANUFACTURED ATM CANOPY.

2 ATM/VTM FIFTY FOOT COMPLIANCE AREA: A MINIMUM OF TWO (2) FOOT CANDLE POWER EXTENDING OUTWARD IN ALL UNOBSTRUCTED DIRECTIONS FIFTY (50) FEET FROM THE FACE OF THE ATM AND AFTERHOUR DEPOSITORY.

3 AFTERHOUR DEPOSITORY SIXTY FOOT COMPLIANCE AREA: A MINIMUM OF TWO (2) FOOT CANDLE POWER EXTENDING OUTWARD IN ALL UNOBSTRUCTED DIRECTIONS SIXTY (60) FEET FROM THE FACE OF THE ATM AND AFTERHOURDEPOSITORY.

4 BANK CONTROLLED PROPERTY LINES: THE MINIMUM FOOT CANDLE READING WILL BE LIMITED TO BANK CONTROLLED PROPERTY LINES.

LIGHTING FIXTURE SCHEDULE (EXTERIOR)

LABEL	DESCRIPTION	LIGHT FIXTURE		MOUNTING	QTY. OF LAMPS	VOLTS	WATTS
		MFG.	MODEL NUMBER				
1P4F	LED FULL CUTOFF AREA LUMINAIRE, 15000 LU MENS.FORWARD DISTRIBUTION, ALUMINUM HOUSING, UL LISTED FOR WET LOCATION. 1HEAD	GE/LSI (POLE)	FIXTURE: EALS 04 2 F4 AF 7 40 X D D 1 DKBZ POLE: 4SQB5 S07G ** S BRZ 4BC 27'-6"	POLE MOUNT, **SEE DETAIL FOR POLE HEIGHT	LED	120-277	116
2P4DA	LED FULL CUTOFF AREA LUMINAIRE, 10000 LU MENS.FORWARD DISTRIBUTION, ALUMINUM HOUSING, UL LISTED FOR WET LOCATION. 2HEAD, 180° CONFIGURATION	GE/LSI (POLE)	FIXTURE: EALS 04 2 D4 AF 7 40 X D D1 DKBZ POLE: 4SQB5 S07G ** D180 BRZ 4BC 27'-6"	POLE MOUNT, **SEE DETAIL FOR POLE HEIGHT	LED	120-277	140

PRAXIS3
100 Peachtree St NW
Suite 1450
Atlanta, GA 30303
404-875-4500 tel
www.praxis3.com

GEORGIA REGISTERED No. 041500 PROFESSIONAL ENGINEER RAHN ONEAL WILLIAMS

Copyright (c) 2024 Praxis3, LLC

All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by Praxis3 shall retain all common law, statutory and other reserved rights, including copyright thereto.

This drawing may not be reproduced in whole or in part without written permission of Praxis3. It is to be returned upon request. Scales as stated are valid on the original drawings.

Rev	Date	Comments
	07/02/2026	PERMIT SET

Client:
FIFTH THIRD BANK

Project Number: 26032
Project Name:
FIFTH THIRD BANK WATSON 1,900 SF

2711 WATSON BOULEVARD
WARNER ROBBINS, GA 31093

Key Plan:

Sheet Title:
ELECTRICAL PHOTOMETRIC SITE PLAN

Sheet Number:
E-011

6/30/2026 2:31:58 PM