


2 E-150 SECURITY PLAN REMOTE DRIVE THRU
1/4" = 1'-0"

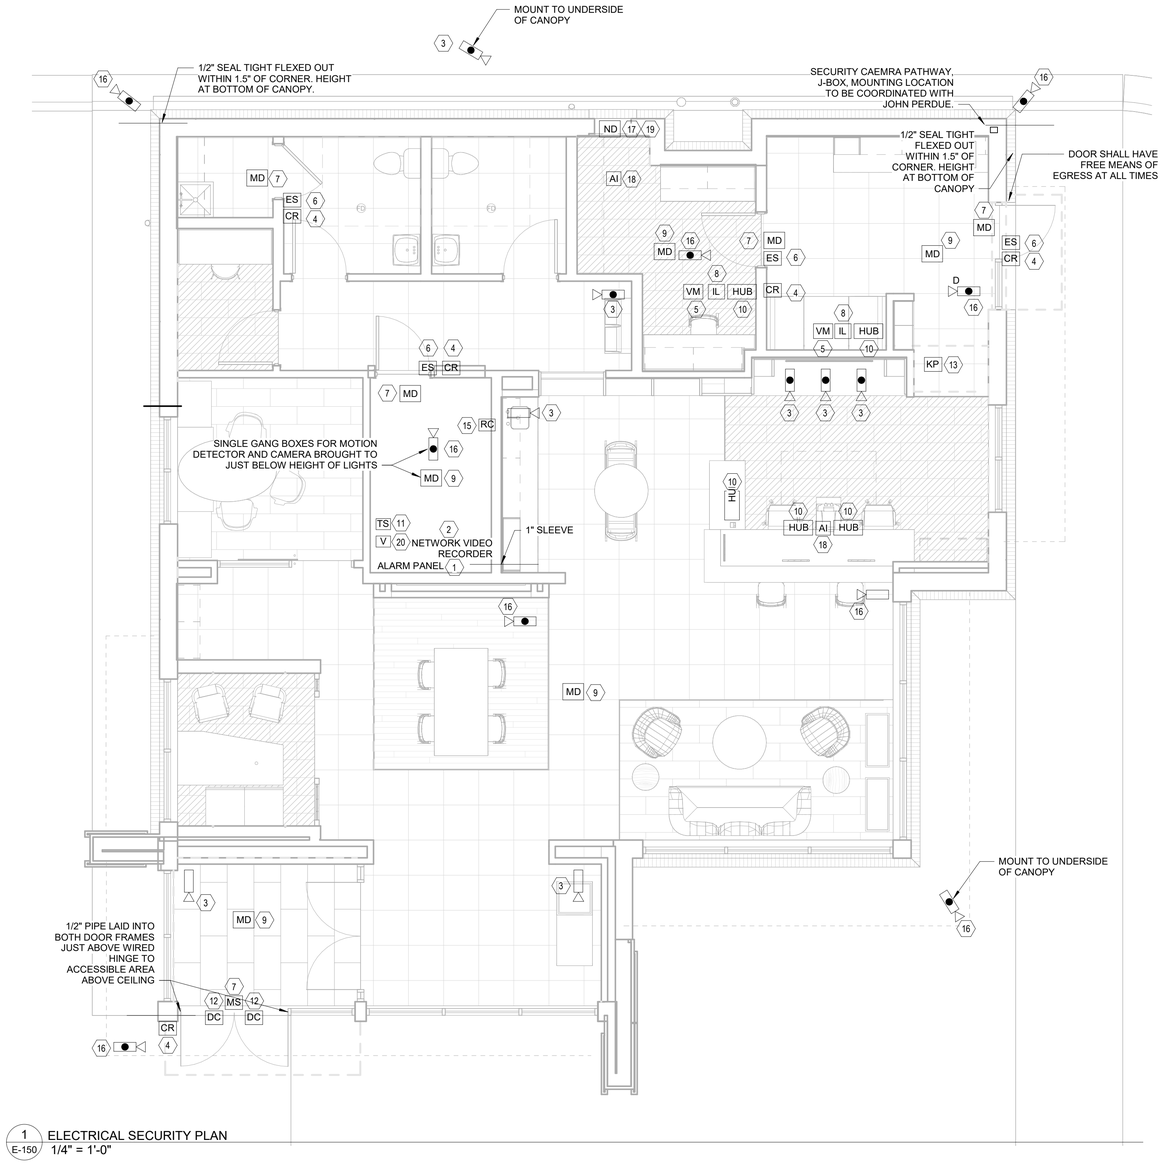

1 E-150 ELECTRICAL SECURITY PLAN
1/4" = 1'-0"

SHEET NOTES:

1. SECURITY DEVICES SHOWING ON THIS SHEET IS FOR COORDINATION PURPOSES ONLY. REFER TO SECURITY DRAWING FOR FINAL LOCATION AND REQUIREMENTS AND PROVIDE ACCORDINGLY.
2. ELECTRICAL CONTRACTOR SHALL PROVIDE ALL RACEWAYS, BOXES, PULLSTRINGS, ETC. SECURITY CABLING SHALL BE BY SECURITY VENDOR.
3. "RED" COLORED WIRE TO BE RESERVED FOR FIRE SYSTEMS AND "YELLOW" WIRES TO BE RESERVED FOR SECURITY SYSTEMS.
4. NOT ALL DEVICES MAY BE USED**
5. ALL CABLES SHALL BE PLENUM RATED
6. SUPPORT DATA / VOICE CABLES ON JHOOKS, 6' O.C., BACK TO THE SECURITY PANEL
7. PROVIDE 3/4" EMT CONDUIT WITH 3/4" BUSHING STUBBED UP TO ACCESSIBLE CEILING AND A 2 GANG BACKBOX FOR THE FOLLOWING: EACH ALARM ACTIVATING DEVICE; EXTERIOR ATM AND / OR NIGHT DEPOSIT; CCTV; CARD READERS; ALL WALL MOUNTED DEVICES.
8. PROVIDE 3/4" C. TO KNOX BOX AND STUB ABOVE TO NEAREST ACCESSIBLE CEILING.
9. ALL EXTERIOR CAMERAS SHALL HAVE A 3/4"C. STUBBED BACK TO THE NEAREST ACCESSIBLE CEILING.
10. ALL EXTERIOR CAMERAS SHALL BE INSTALLED BELOW THE CANOPIES TO MAXIMIZE CAMERA SIGHT LINES CONFIRM FINAL LOCATION WITH SECURITY VENDOR
11. ALL DOORS SHALL HAVE FREE EGRESS. COORDINATE WITH ARCHITECTURAL DOOR HARDWARE.
12. EXTERIOR JUNCTION BOX TO MOUNTED FOR 360 CAMERA TO BE INSTALLED AT CORNERS OF THE BUILDING.

SECURITY DEVICE SCHEDULE

#	DESCRIPTION	WIRE (FOR REFERENCE SEE NOTE A)	INSTALLATION REQUIREMENTS
1	ALARM PANEL	(4) 110VAC DUPLEX	(4) DUPLEX OUTLETS MOUNTED VERTICALLY FROM 6' TO 4' NEXT TO SECURITY PANELS. FIELD VERIFY LOCATION.
2	NETWORK VIDEO RECORDER	(1) 110VAC QUAD	QUAD OUTLET ADJACENT TO DATA RACK. EXACT LOCATION TBD BY SITE.
3	IP DOME CAMERA - INDOOR	CAT6	SINGLE GANG BOX, 2-3/4" ROUND MUD RING, STUB UP INTO ACCESSIBLE AREA ABOVE CEILING. SEE ELEVATION FOR AFF HEIGHT. NO PROVISIONS REQUIRED FOR MOUNTING ON DROP-IN CEILING.
4	CARD READER	22/3 PAIR IN BANANA CABLE	SINGLE GANG BOX, 44" AFF, STUB UP INTO ACCESSIBLE AREA ABOVE CEILING, FLEX FROM BOTTOM OF BOX TO ELECTRIC STRIKE. PROVIDE SLIM/MULLION METAL BACK BOX FOR MOUNTING ON MULLION.
5	VIDEO MONITOR	110VAC OUTLET, RG59 COAX	SINGLE GANG BOX, 86" AFF, SERIALLY PIPED WITH HUB AND IL, STUB UP INTO ACCESSIBLE AREA ABOVE CEILING.
6	ELECTRIC STRIKE WITH LBM	18/4 IN BANANA CABLE	WIRING FROM CARD READER.
7	MOTION DETECTOR (TO SHUNT DOOR CONTACT)	22/4 BANANA CABLE	SINGLE GANG BOX MOUNTED LONG SIDE PARALLEL TO DOOR(S) WITH RING, SEE ELEVATION FOR HEIGHT, NO PROVISIONS REQUIRED FOR MOUNTING ON DROP-IN CEILING TILES.
8	ALARM LAMP/INDICATOR LIGHT	18/2	SINGLE GANG BOX WITH RING, 60" AFF, STUB UP INTO ACCESSIBLE AREA ABOVE CEILING.
9	360 MOTION DETECTOR	22/4	SINGLE GANG BOX WITH ROUND MUD RING IN CEILING, STUB UP INTO ACCESSIBLE AREA ABOVE CEILING, NO PROVISIONS REQUIRED FOR DROP-IN TILE CEILINGS.
10	HOLD UP BUTTON	22/4	FOR TELLER LINE, STUB CONDUIT AT 18" AFF UNDER COUNTERTOP WITH STUB UP INTO ACCESSIBLE AREA ABOVE CEILING. FOR CASH/BREAK ROOMS, SINGLE GANG BOX WITH RING, 44" AFF WITH STUB UP INTO ACCESSIBLE AREA ABOVE CEILING. FOR OFFICE DESK LOCATIONS, SINGLE GANG BOX WITH RING, 18" AFF ON WALL ADJACENT TO DESK WITH STUB UP INTO ACCESSIBLE AREA ABOVE CEILING.
11	TEMPERATURE SENSOR	22/4	FOR ATM ROOM, SINGLE GANG BOX WITH RING, 60" AFF, STUB UP INTO ACCESSIBLE AREA ABOVE CEILING. FOR IT ROOMS, NO PROVISIONS REQUIRED.
12	DOOR CONTACT	22/2 IN BANANA CABLE	1/2" PIPE LAID INTO BOTH DOOR FRAMES JUST ABOVE WIRED HINGE INTO ACCESSIBLE AREA ABOVE CEILING.
13	ALARM KEYPAD	22/4	SINGLE GANG BOX WITH RING, 44" AFF, STUB UP INTO ACCESSIBLE AREA ABOVE CEILING.
14	ANALOG MINIATURE BOARD CAMERA	CAT6	SINGE GANG BOX WITH RING, STUB UP INTO ACCESSIBLE AREA ABOVE CEILING. SEE ELEVATION FOR HEIGHT.
15	ROOF CONTACT	22/4	NO PROVISIONS REQUIRED.
16	360 IP DOME CAMERA	CAT6	SINGLE GANG BOX WITH 2-3/4" ROUND MUD RING, 8'-6" AFF OR TO CEILING FOR CEILING OR CANOPY MOUNT, STUB UP INTO ACCESSIBLE AREA ABOVE CEILING. NO PROVISIONS REQUIRED FOR MOUNTING ON DROP-IN CEILING TILES.
17	IP MINIATURE BOARD CAMERA	CAT6	SINGLE GANG BOX WITH RING, 74" AFF, STUB UP INTO ACCESSIBLE AREA ABOVE CEILING. SEE ELEVATION FOR HEIGHT.
18	ALARM INTERFACE	22/8	SINGLE GANG BOX WITH RING, STUB UP INTO ACCESSIBLE AREA ABOVE CEILING. HEIGHT TO BE DETERMINED BY SHOP PRINTS PER JOB. NO PROVISIONS REQUIRED FOR VAULT.
19	NIGHT DEPOSIT	110VAC	110VAC OUTLET, 74" AFF, ADJACENT TO CAMERA JBOX. SEE POWER PLAN FOR CIRCUIT.
20	VENUS ROUTER		NO PROVISIONS REQUIRED.

PRAXIS3
100 Peachtree St NW
Suite 1450
Atlanta, GA 30303
404-875-4500 tel
www.praxis3.com

GEORGIA REGISTERED No. 041500 PROFESSIONAL ENGINEER RAHN ONEAL WILLIAMS

Copyright (c) 2024 Praxis3, LLC

All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by Praxis3 shall retain all common law, statutory and other reserved rights, including copyright thereto.

This drawing may not be reproduced in whole or in part without written permission of Praxis3. It is to be returned upon request. Scales as stated are valid on the original drawings.

Rev	Date	Comments
	07/02/2026	PERMIT SET

Client:
FIFTH THIRD BANK

Project Number: 26032
Project Name:
FIFTH THIRD BANK WATSON 1,900 SF

2711 WATSON BOULEVARD
WARNER ROBBINS, GA 31093

Key Plan:

Sheet Title:
ELECTRICAL SECURITY PLAN

Sheet Number:
E-150

6/30/2026 2:32:05 PM