




4 E-702 ELEVATION MEETING ROOM 105/4
1/4" = 1'-0"




3 E-702 ELEVATION MEETING ROOM 105/3
1/4" = 1'-0"

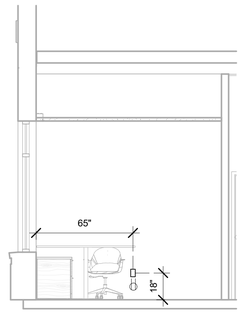


2 E-702 ELEVATION MEETING ROOM 105/2
1/4" = 1'-0"

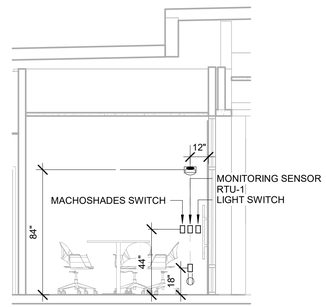


1 E-702 ELEVATION MEETING ROOM 105/1
1/4" = 1'-0"




8 E-702 ELEVATION ELEC/IT 106/4
1/4" = 1'-0"



7 E-702 ELEVATION ELEC/IT 106/3
1/4" = 1'-0"



6 E-702 ELEVATION ELEC/IT 106/2
1/4" = 1'-0"

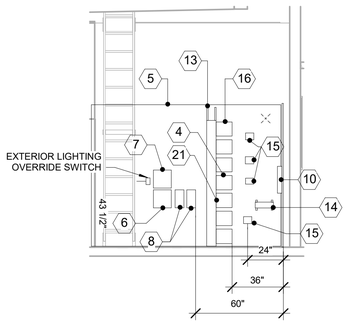


5 E-702 ELEVATION ELEC/IT 106/1
1/4" = 1'-0"

KEYED NOTES:


1. PANEL PP
2. PANEL RP-A SEC I
3. NOT USED
4. DATA RACK
5. PLYWOOD BACKBOARD: PROVIDE 8' X (LENGTH AS REQUIRED) X 3/4" FIRE-RATED PLYWOOD BACKBOARDS MOUNTED VERTICALLY ALONG ALL NER ROOM WALLS. UL FIRE RATING LABEL SHALL REMAIN VISIBLE AFTER INSTALLATION.
6. LIGHTING CONTROL PANEL
7. DIMMER PANEL
8. LIGHTING CONTACTOR
9. SECURITY PANEL
10. TELECOMMUNICATION BOX
11. FIRE ALARM CONTROL PANEL: FIRE ALARM CONTROL PANEL WITH TOP OF CABINET NOT TO EXCEED 72" ABOVE THE FINISHED FLOOR.
12. DIGITAL ALARM COMMUNICATOR TRANSMITTER
13. CABLE TRAY
14. GROUND BUS BAR: PROVIDE A 12" X 2" X 1/4" COPPER GROUND BAR WITH STANDOFF INSULATORS ON TELEPHONE BACKBOARD. PROVIDE #2 AWG COPPER GROUND ROUTED IN 1" CONDUIT FROM TELEPHONE BACKBOARD GROUNDING BAR TO ELECTRICAL SERVICE GROUNDING ELECTRODE SYSTEM. COORDINATE EXACT LOCATION ON BACKBOARD WITH TELEPHONE SERVICE PROVIDER.
15. QUAD RECEPTACLE
16. PROVIDE A PANDUIT (PART NUMBER: R2P) TWO POST CABLE MANAGEMENT RACK SYSTEM IN IT/ELEC ROOM
17. PROVIDE PANDUIT (PART NUMBER: WMPV45E) VERTICAL CABLE MANAGER AND PANDUIT (PART NUMBER: WMP1E) HORIZONTAL CABLE MANAGER IN ELECTRICAL/IT ROOM AS REQUIRED.
18. PROVIDE 18" STEEL HOMACO LADDER RACK ABOVE TBB AT 90" AFF. BOND ALL SECTIONS WITH #6 AWG GREEN INSULATED COPPER GROUND TO GROUND BUS ON TBB.
19. PROVIDE (1) CAT 6 CABLE RUN FROM RACK TO DRIVE UP EQUIPMENT MATRIX LOCATION. COORDINATE EXACT LOCATION WITH OWNER VENDOR.
20. ELECTRICAL CONTRACTOR TO PULL CABLES FOR MOOD MEDIA. EQUIPMENT PROVIDED BY OWNER

ELEC/IT 106 ELEVATION GENERAL NOTES:


1. ELEVATIONS ARE SHOWN FOR REFERENCE ONLY. COORDINATE WITH RESPECTIVE EQUIPMENT SUPPLIERS FOR EXACT DIMENSIONS, REQUIRED CLEARANCES, LOCATIONS, MOUNTING HEIGHTS, AND ROUGH-IN REQUIREMENTS AND ADJUST IN FIELD AS REQUIRED.
2. MAINTAIN A MINIMUM OF 36" CLEAR IN THE FRONT OF THE ELECTRICAL PANELS PER NEC 110.26.
3. EXPOSED CONDUIT IN ELECTRICAL/IT ROOM SHALL BE EMT; MC CABLE SHALL NOT BE EXPOSED.
4. ALL WIRING DEVICES IN NEC AND ELECTRICAL ROOM SHALL BE FLUSH MOUNTED.
5. LOW VOLTAGE CONDUITS SHALL BE PROVIDED WITH PLASTIC INSULATED CONDUIT BUSHINGS ON EACH END AND NYLON PULL STRING.

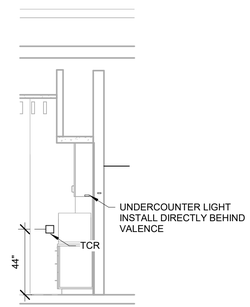


12 E-702 ELEVATION LIBRARY 107/3
1/4" = 1'-0"



11 E-702 ELEVATION LIBRARY 107/2
1/4" = 1'-0"



10 E-702 ELEVATION LIBRARY 107/1
1/4" = 1'-0"

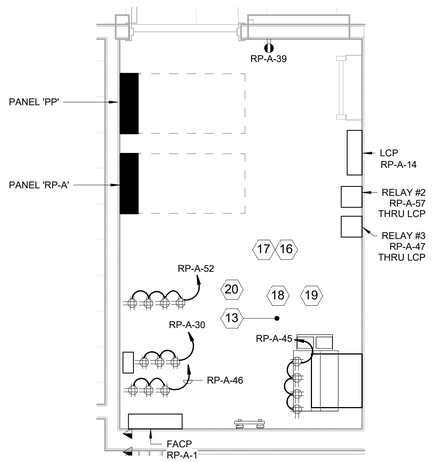

9 E-702 ENLARGED ELEC/IT ROOM 1
1/2" = 1'-0"

PRAXIS3
100 Peachtree St NW
Suite 1450
Atlanta, GA 30303
404-875-4500 tel
www.praxis3.com

GEORGIA REGISTERED No. 041508 PROFESSIONAL ENGINEER RAHN ONEAL WILLIAMS

Copyright (c) 2024 Praxis3, LLC

All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by Praxis3 shall retain all common law, statutory and other reserved rights, including copyright thereto.

This drawing may not be reproduced in whole or in part without written permission of Praxis3. It is to be returned upon request. Scales as stated are valid on the original drawings.

Rev	Date	Comments
	07/02/2026	PERMIT SET

Client:
FIFTH THIRD BANK

Project Number: 26032
Project Name:
FIFTH THIRD BANK WATSON 1,900 SF

2711 WATSON BOULEVARD
WARNER ROBBINS, GA 31093

Key Plan:

Sheet Title:
ELECTRICAL ELEVATIONS

Sheet Number:
E-702

6/30/2026 2:32:16 PM