
NOTE:
PREFERRED SUPPLIER FOR SWITCHGEAR IS WESCO.


CONTACT DELENA STUART-WATSON, GLOBAL ACCOUNT MANAGER
TEL: 214-549-1164
EMAIL: DELENA.WATSON@ANIXTER.COM

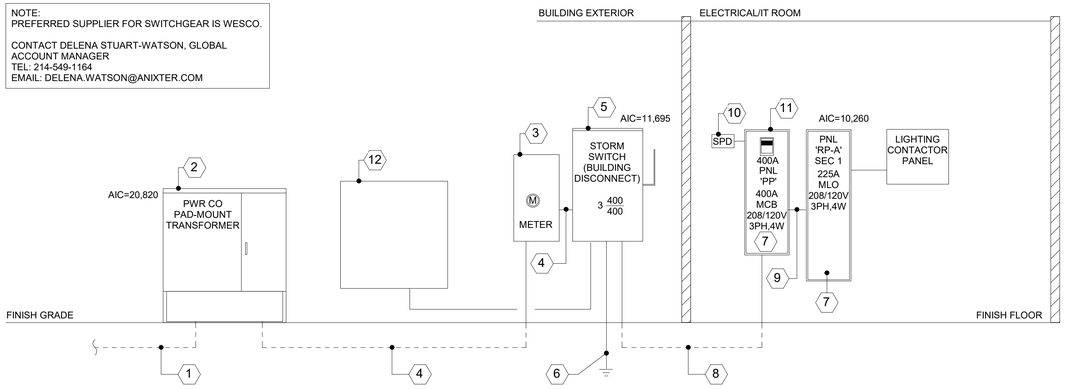

1 E-800 ELECTRICAL RISER DIAGRAM
N.T.S.

KEYED NOTES:

1. ELECTRIC UTILITY PRIMARY FEEDERS: PROVIDE COMPLETE UNDERGROUND CONDUIT SYSTEMS IF REQUIRED BY THE LOCAL POWER COMPANY FROM TRANSFORMER TO POINT OF INTERCEPTION AT EDGE OF PROPERTY LINE. REFER TO ELECTRICAL SITE PLAN FOR ROUTING AND ADDITIONAL REQUIREMENTS.
2. ELECTRIC UTILITY XFMR (PAD-MOUNTED): REFER TO ELECTRICAL SITE PLAN FOR LOCATION AND ADDITIONAL REQUIREMENTS.
3. ELECTRIC UTILITY METER (SELF-CONTAINED): PROVIDE 320A CONTINUOUS 400A MAX, 600V, 3PH, 4W, SELF-CONTAINED METER BASE AND ENCLOSURE. COORDINATE METER BASE SELECTION AND INSTALLATION WITH POWER COMPANY.
4. 400A SERVICE ENTRANCE: PROVIDE 2 SETS OF 4-#3/0 KCMIL EACH IN 4" CONDUIT.
5. STORM SWITCH - MANUAL TRANSFER SWITCH: MANUFACTURED BY ESL POWER SYSTEMS INC, PART# 3042-10V: SFD4-400C-400C-208-311-S-C, 400A, 208Y/120VAC, 65KAIC,3PH, 4W SAFETY INTERLOCK MANUAL TRANSFER SWITCH, WALL MOUNT, TYPE 3R, 14GA GALVANNEALED STEEL, POWDER COATED WRINKLE GRAY (RAL7035). FACTORY WIRED COMPLETE USING INSULATED FLEXIBLE BUS WITH 400A MOLDED CASE 3-POLE C/B FOR UTILITY SIDE (ACCEPTS (2) 2/0-500KCMIL WIRE PER PHASE/NEUTRAL), 400A MOLDED CASE 3-POLE C/B FOR GENERATOR SIDE, MALE CAM-STYLE RECEPTACLES: (1) A-PHASE - BLACK, (1) B-PHASE-RED, (1) C-PHASE-BLUE,(1) NEUTRAL-WHITE, (1) GROUND-GREEN (MATING PLUGS NOT PROVIDED). INCLUDES DEADFRONT, PAD LOCKABLE DOOR WITH STOP AND HANDLE COVER. LOAD WIRE RANGE (2) 2/0-500KCMIL PER PHASE/NEUTRAL. CONDUIT ENTRY AREA THROUGH BOTTOM LEFT SIDE OR LEFT SIDE AT BOTTOM. SUITABLE FOR USE AS SERVICE EQUIPMENT. USE COPPER WIRE. UL/cUL 1008 LISTED.
6. GROUND ELECTRODE CONDUCTOR: PROVIDE #3/0 CU GROUNDING ELECTRODE CONDUCTOR (GEC). TO GROUNDING ELECTRODE SYSTEM CONSISTING OF MIN (2) 3/4" CU CLAD GROUND RODS, BUILDING STEEL, CONCRETE ENCASED ELECTRODE, INTERSYSTEM BONDING JUMPER, AND METALLIC COLD WATER PIPE.
7. ELECTRICAL PANEL: PROVIDE PANELBOARD AS SPECIFIED ON ELECTRICAL PANEL SCHEDULES.
8. 400A FEEDER: PROVIDE 2 SETS OF 4-#3/0 KCMIL, #3 GND EACH IN 4" CONDUIT.
9. 225A FEEDER: PROVIDE 4-#4/0, #4 GND IN 3" CONDUIT.
10. SURGE PROTECTION DEVICE: PROVIDE SURGE PROTECTION DEVICE (SPD) SURGE APT-TE-02-XDS-10-4X-KITFMXF, REFER TO "SPD PANELBOARD INSTALLATION DETAIL" ON SHEET E-501.
11. PROVIDE POWER SCOUT METER, PSHD3, WITH CONNECTION TO THE BUILDING MANAGEMENT SYSTEM AND 400A CTS WITHIN THE MAIN PANEL. PROVIDE ALL CONDUIT AND WIRE TO THE BMS & CONNECT WITH 4#12 & 1#12(G).
COORDINATE WITH STEVE SMITH AT IOT - CONTACT:
STEPHEN SMITH
STEPHENS@IOFTEAM.COM
OFFICE PHONE: 512-649-5142 EXT. 105
DIRECT LINE:
512-686-3978.
12. TEMPORARY GENERATOR WITH OVERCURRENT PROTECTION AND CABLE BY OTHERS

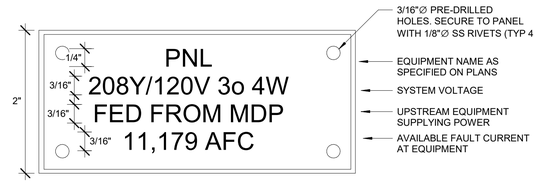




NOTES:

1. ALL ELECTRICAL EQUIPMENT, SUCH AS SWITCHBOARDS, SWITCHGEAR, PANELBOARDS, INDUSTRIAL CONTROL PANELS, METER SOCKET ENCLOSURES, MOTOR CONTROL CENTERS, AND SAFETY DISCONNECT SWITCHES SHALL BE PROVIDED WITH AN ARC FLASH HAZARD WARNING LABEL.
2. THE LABEL SHALL BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED.
3. THE LABEL SHALL BE PERMANENTLY AFFIXED TO THE EQUIPMENT AND SHALL NOT BE HAND WRITTEN.
4. THOROUGHLY CLEAN SURFACE PRIOR TO ADHERING LABEL.
5. PROVIDE BRADY B-302 SERIES 3.5"x5" POLYESTER LABEL WITH PERMANENT ACRYLIC ADHESIVE, CATALOG #101950 (5 PACK), #102307 (100 PACK), OR APPROVED EQUAL.

2 ARC FLASH HAZARD WARNING LABEL REQUIREMENTS
N.T.S.

NOTES:

1. ALL DISTRIBUTION EQUIPMENT SUCH AS PANELBOARDS, SWITCHBOARDS, DISCONNECTS, TRANSFORMERS, ETC. SHALL BE PROVIDED WITH AN EQUIPMENT LABEL PER THE REQUIREMENTS OF THIS DETAIL.
2. LABELS SHALL BE 2-PLY ENGRAVED PLASTIC LAMINATE WITH BLACK TYPEFACE LETTERS. LABEL BACKGROUND SHALL FOLLOW THE BELOW COLOR SCHEME:
   A. NORMAL POWER - WHITE
   B. UPS POWER - BLUE
   C. LIFE SAFETY POWER - YELLOW
3. LABEL MATERIAL SHALL BE DURABLE, UV STABLE, RATED FOR OUTDOOR USE, AND ABRASION RESISTANT. WHERE ATTACHED TO NEMA 4X EQUIPMENT, LABELS SHALL IN ADDITION BE CHEMICAL RESISTANT.
4. LABELS SHALL BE PERMANENTLY ATTACHED TO ENCLOSURE COVER WITH RIVETS UNLESS DOING SO COMPROMISES ITS NEMA / IP RATING. LABELS FOR ENCLOSURES WITH WELDED SEAMS AND GASKETED DOORS SUCH AS THOSE RATED NEMA 12 OR NEMA 4 SHALL BE INSTALLED USING PERMANENT WEATHER-, UV-, AND TEMPERATURE-RESISTANT DOUBLE-SIDED MOUNTING TAPE ONLY.
5. A SUBMITTAL WITH A COMPLETE LIST OF EQUIPMENT LABELS SHALL BE PROVIDED FOR ENGINEER APPROVAL PRIOR TO ORDERING.
6. LABELS SHALL INDICATE NO LESS THAN THE FOLLOWING:
   A. EQUIPMENT NAME
   B. THE NOMINAL SYSTEM VOLTAGE WHICH SAID EQUIPMENT IS CONNECTED TO
   C. THE EQUIPMENT NAME SUPPLYING POWER TO SAID EQUIPMENT
   D. THE AVAILABLE FAULT CURRENT AT SAID EQUIPMENT



3 EQUIPMENT LABEL DETAIL
N.T.S.

6/30/2026 2:32:22 PM

PRAXIS3
100 Peachtree St NW
Suite 1450
Atlanta, GA 30303
404-875-4500 tel
www.praxis3.com

GEORGIA REGISTERED No. 041508 PROFESSIONAL ENGINEER RAHN ONEAL WILLIAMS

Copyright (c) 2024 Praxis3, LLC

All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by Praxis3 shall retain all common law, statutory and other reserved rights, including copyright thereto.

This drawing may not be reproduced in whole or in part without written permission of Praxis3. It is to be returned upon request. Scales as stated are valid on the original drawings.

Rev	Date	Comments
	07/02/2026	PERMIT SET

Client:
FIFTH THIRD BANK

Project Number: 26032
Project Name:
FIFTH THIRD BANK WATSON
1,900 SF

2711 WATSON BOULEVARD
WARNER ROBBINS, GA 31093

Key Plan:

Sheet Title:
ELECTRICAL RISER DIAGRAM

Sheet Number:
E-800