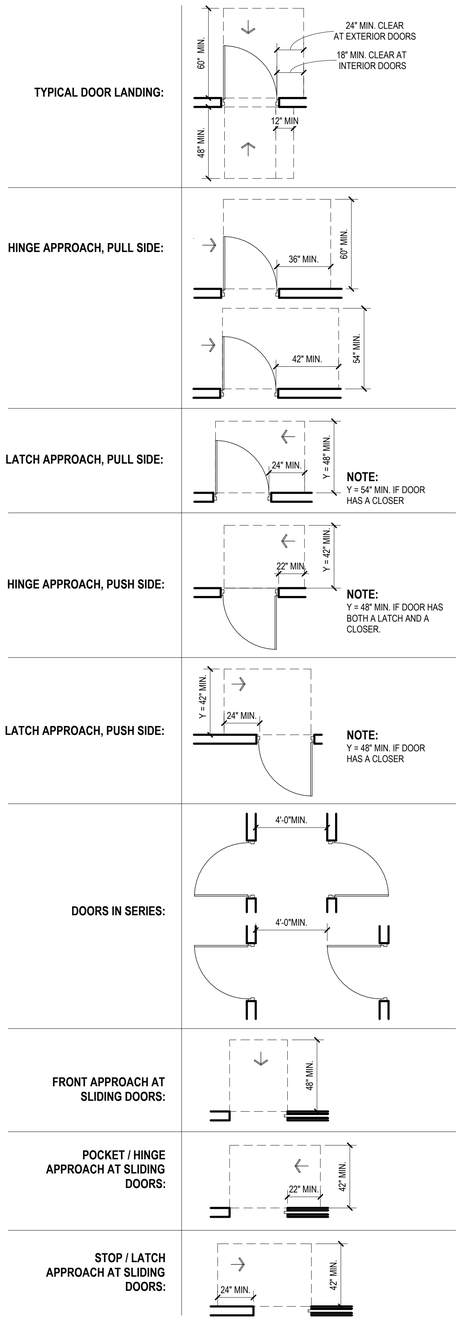
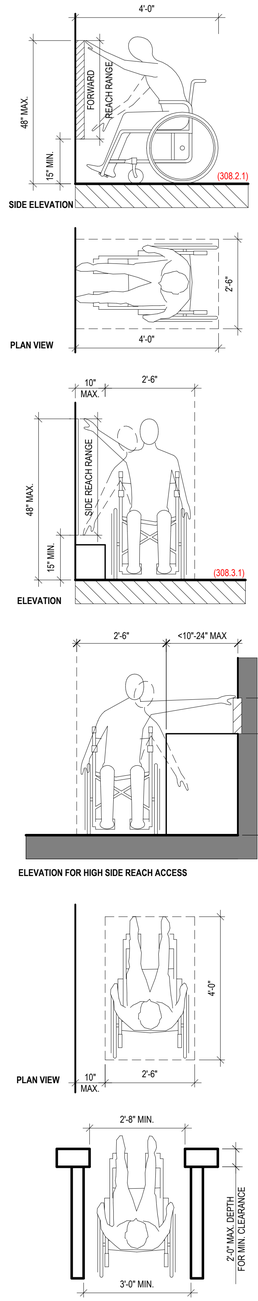
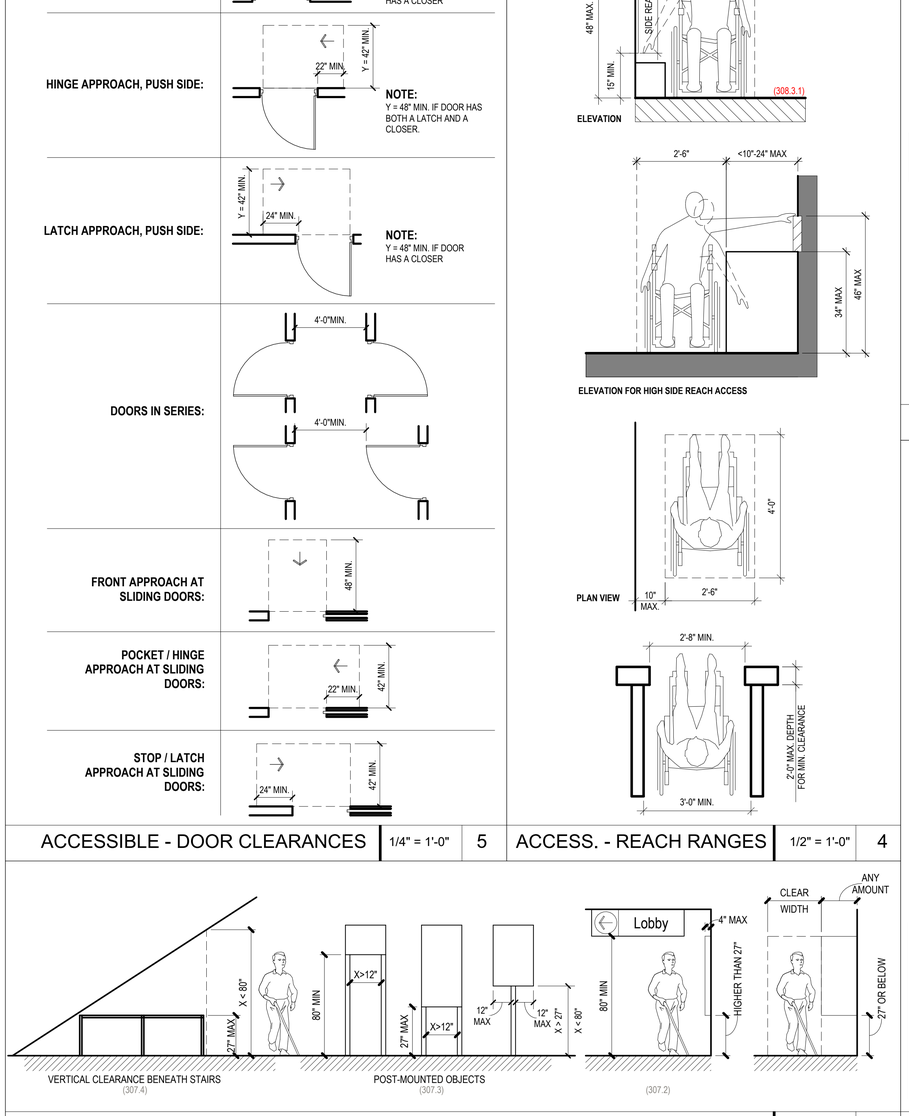


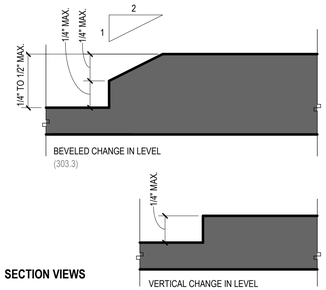

ACCESSIBLE - DOOR CLEARANCES | 1/4" = 1'-0" | 5



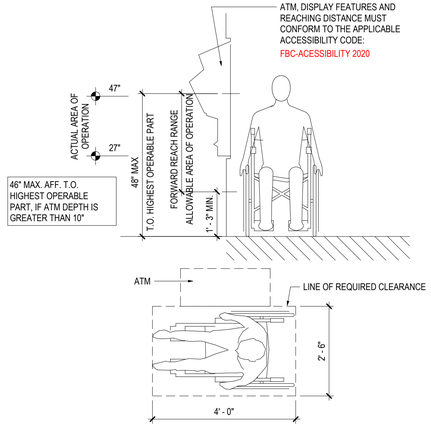

ACCESS. - REACH RANGES | 1/2" = 1'-0" | 4



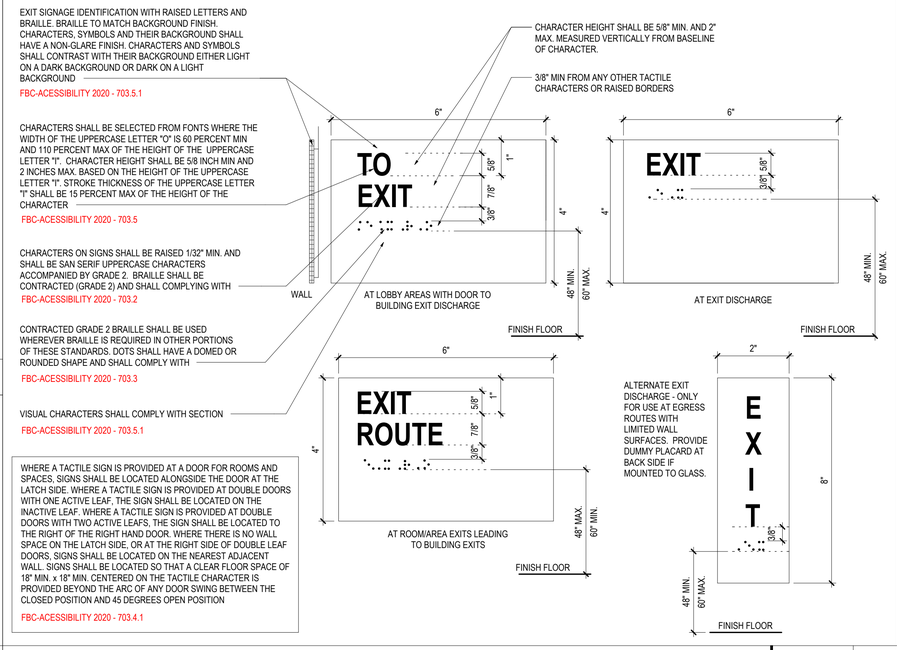

ACCESSIBLE - PROTRUDING OBJECTS | 1/4" = 1'-0" | 3




ACCESSIBLE - THRESHOLD | 3/4" = 1'-0" | 7




ATM APPROACH CLEARANCES | 1/2" = 1'-0" | 6



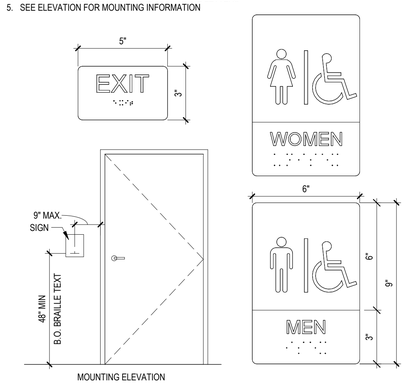

TACTILE EXIT SIGN | 6" = 1'-0" | 2

## GENERAL NOTES - ACCESSIBILITY

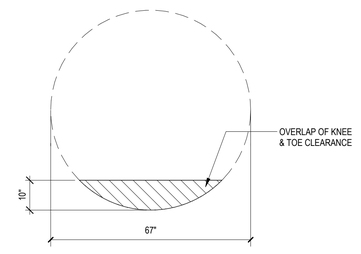
1. THE FLOOR OR LANDING ON EACH SIDE OF AN ENTRANCE OR PASSAGE DOOR SHALL BE LEVEL AND CLEAR. THE LEVEL AND CLEAR AREA SHALL BE AT LEAST 60" LONG IN THE DIRECTION OF THE DOOR SWING AND 48" CLEAR IN THE DIRECTION OPPOSITE THE DOOR SWING MEASURED IN RIGHT ANGLES TO THE PLANE OF THE DOOR IN ITS CLOSED POSITION.
2. IDENTIFY ACCESSIBLE ENTRANCES WITH INTERNATIONAL SYMBOL OF ACCESSIBILITY AND WITH ADDITIONAL DIRECTIONAL SIGNS, AS REQUIRED, VISIBLE FROM APPROACHING PEDESTRIAN WAYS.
3. IN BUILDINGS AND FACILITIES, FLOORS OF A GIVEN STORY SHALL BE A COMMON LEVEL THROUGHOUT, OR SHALL BE CONNECTED BY PEDESTRIAN RAMPS, PASSENGER ELEVATORS OR SPECIAL ACCESS LIFTS.
4. FLOOR SURFACES SHALL BE SLIP-RESISTANT.
5. EVERY CORRIDOR AND AISLE SERVING AN OCCUPANT LOAD OF 10 OR MORE, SHALL NOT BE LESS THAN 44" IN WIDTH.
6. ABRUPT CHANGES IN LEVEL ALONG ANY ACCESSIBLE ROUTE SHALL NOT EXCEED 1/2" IN HEIGHT. LEVEL CHANGES NOT EXCEEDING 1/4" MAY BE VERTICAL. BEVEL OTHERS WITH A SLOPE NOT GREATER THAN 1:2.
7. LATCHING AND LOCKING DOORS THAT ARE HAND ACTIVATED AND WHICH ARE IN A PATH OF TRAVEL SHALL BE OPERABLE WITH A SINGLE EFFORT BY LEVER. TYPE HARDWARE, PANIC BARS, PUSH-PULL ACTIVATING BARS, OR OTHER HARDWARE SHALL BE DESIGNED TO PROVIDE PASSAGE WITHOUT REQUIRING THE ABILITY TO GRASP THE OPENING HARDWARE. MOUNT DOOR OPENING HARDWARE BETWEEN 34" AND 44" A.F.F.
8. CENTER HAND-ACTIVATED DOOR OPENING HARDWARE BETWEEN 34" AND 44" A.F.F.
9. MAXIMUM PULL OR PUSH EFFORT TO OPERATE DOORS SHALL NOT EXCEED 5 POUNDS FOR EXTERIOR DOORS AND 5 POUNDS FOR INTERIOR DOORS, MEASURED AT RIGHT ANGLES TO HINGED DOORS AND AT CENTER PLANE OF SLIDING OR FOLDING DOORS. CORRESPONDING DEVICES OR AUTOMATIC DOOR OPERATORS MAY BE UTILIZED TO MEET THE ABOVE STANDARDS. MAXIMUM EFFORT TO OPERATE REQUIRED FIRE DOORS MAY BE INCREASED BUT SHOULD NOT EXCEED 15 POUNDS.
10. THE BOTTOM 10" OF ALL DOORS (EXCEPT SLIDING) SHALL HAVE A SMOOTH UNINTERRUPTED SURFACE TO ALLOW THE DOOR TO BE OPENED BY A WHEELCHAIR FOOTREST WITHOUT CREATING A TRAP OR HAZARDOUS CONDITION.
11. EVERY REQUIRED ENTRANCE OR PASSAGE DOORWAY SHALL NOT BE LESS THAN 3' IN WIDTH AND NOT LESS THAN 6'-8" IN HEIGHT. DOORS SHALL BE CAPABLE OF OPENING AT LEAST 90 DEGREES AND SHALL BE MOUNTED SO THAT THE CLEAR WIDTH OF THE DOORWAY IS NOT LESS THAN 32".
12. WHERE A PAIR OF DOORS IS UTILIZED, AT LEAST ONE OF THE DOORS SHALL PROVIDE A CLEAR, UNOBSTRUCTED OPENING WIDTH OF 32". CLEAR OPENINGS OF DOORWAYS WITH SWINGING DOORS SHALL BE MEASURED BETWEEN THE FACE OF THE DOOR AND THE STOP, WITH THE DOOR OPEN 90 DEGREES. OPENINGS MORE THAN 24 INCHES DEEP SHALL PROVIDE A CLEAR OPENING OF 36 INCHES MINIMUM. THERE SHALL BE NO PROJECTIONS INTO THE REQUIRED CLEAR OPENING WIDTH LOWER THAN 34 INCHES ABOVE THE FINISH FLOOR OR GROUND. PROJECTIONS INTO THE CLEAR OPENING WIDTH BETWEEN 34 INCHES AND 80 INCHES ABOVE THE FINISH FLOOR OR GROUND SHALL NOT EXCEED 4 INCHES.
13. TO ALERT THE VISUALLY IMPAIRED, MARK THE UPPER APPROACH AND THE LOWER TREAD OF EACH INTERIOR STAIR WITH A STRIP OF CLEARLY CONTRASTING COLOR AT LEAST 2" WIDE PLACED PARALLEL TO AND NOT MORE THAN 1" FROM THE NOSE OF THE STEP OR LANDING. THE STRIP SHALL BE OF A MATERIAL THAT IS AT LEAST AS SLIP RESISTANT AS THE OTHER TREADS OF THE STAIR.
14. ELECTRICAL RECEPTACLE OUTLETS ON BRANCH CIRCUITS OF 30 AMPERES OR LESS AND COMMUNICATION SYSTEM RECEPTACLES SHALL BE MOUNTED 15" MIN. A.F.F. TO THE BOTTOM OF THE BOX AND 48" MAX. A.F.F. TO THE TOP OF THE BOX.
15. FLOORS AND LANDINGS SHALL NOT BE MORE THAN 1/2" LOWER THAN THE THRESHOLD OF THE DOORWAY. CHANGE IN LEVEL BETWEEN 1/4" AND 1/2" SHALL BE BEVELED WITH A SLOPE NO GREATER THAN 1:2.
16. MINIMUM MANEUVERING CLEARANCES AT DOORS AND GATES SHALL EXTEND THE FULL WIDTH OF THE DOORWAY AND THE REQUIRED LATCH SIDE OR HINGE SIDE CLEARANCE.
17. HANDLES, PULLS, LATCHES, LOCKS, AND OTHER OPERABLE PARTS ON DOORS AND GATES SHALL COMPLY AS FOLLOWS. OPERABLE PARTS OF SUCH HARDWARE SHALL BE 34 INCHES MINIMUM AND 44 INCHES MAXIMUM ABOVE THE FINISH FLOOR OR GROUND. WHERE SLIDING DOORS ARE IN THE FULLY OPEN POSITION, OPERATING HARDWARE SHALL BE EXPOSED AND USABLE FROM BOTH SIDES.
18. THE DISTANCE BETWEEN TWO HINGED OR PIVOTED DOORS IN SERIES AND GATES IN SERIES SHALL BE A MINIMUM OF 48" PLUS THE WIDTH OF THE DOORS OR GATES SWINGING INTO THE SPACE.
19. A KEY-OPERATED LOCKING DEVICE IS PERMITTED FROM THE EGRESS SIDE PROVIDED THAT THE LOCKING DEVICE IS READILY DISTINGUISHABLE AS LOCKED. A READILY VISIBLE DURABLE SIGN IS POSTED ON THE EGRESS SIDE ON OR ADJACENT TO THE DOOR STATING "THIS DOOR TO REMAIN UNLOCKED WHEN THIS SPACE IS OCCUPIED". THE SIGN SHALL BE IN LETTERS 1" HIGH ON A CONTRASTING BACKGROUND.
20. ALL CONTROLS FOR USE BY CUSTOMERS MUST BE MOUNTED BETWEEN 15" AND 48" ABOVE FINISHED FLOOR AND MUST HAVE 30" X 48" MINIMUM CLEAR FLOOR SPACE FOR A FORWARD OR PARALLEL APPROACH. CONTROLS MOUNTED OVER AN OBSTRUCTION THAT IS BETWEEN 10" AND 24" DEEP MAY BE NO HIGHER THAN 46" AFF. IF A PARALLEL APPROACH IS PROVIDED; OR WHERE OBSTRUCTIONS ARE BETWEEN 20" AND 25" DEEP WITH A FORWARD APPROACH. CONTROLS MUST NOT REQUIRE TIGHT GRASPING OR TWISTING OF THE WRIST.
21. COMMON EMPLOYEE AREAS SUCH AS BREAK ROOMS, LOCKERS, AND TOILET ROOMS MUST BE ACCESSIBLE AND HAVE ACCESSIBLE FEATURES AND FIXTURES. EMPLOYEE WORK AREAS LESS THAN 1,000 SF AS DEFINED BY PERMANENTLY INSTALLED PARTITIONS, COUNTERS, CASEWORK OR FURNISHINGS ARE NOT REQUIRED TO HAVE AN ACCESSIBLE PATH OF CIRCULATION THROUGHOUT THE SPACE BUT ARE REQUIRED TO BE CONSTRUCTED SO AN INDIVIDUAL CAN APPROACH, ENTER AND EXIST THE SPACE.
22. IN COMMON SPACES WITHIN EMPLOYEE AREAS, AT LEAST ONE OF EACH TYPE OF STORAGE OR WORK COUNTER, 5% OF LOCKERS AND CONTROLS (EMERGENCY PHONES, CARD READERS ETC.) MUST BE ON AN ACCESSIBLE ROUTE, WITHIN REACH RANGE AND MUST COMPLY WITH STANDARDS OR LOCALS CODES, WHICHEVER IS STRICTER.
23. FIRE ALARM SYSTEM SHALL HAVE PERMANENTLY INSTALLED AUDIBLE AND VISIBLE ALARMS COMPLYING WITH NFPA (1999 OR 2010 EDITION) AND AS REQUIRED BY LOCAL AUTHORITIES. ALARMS MUST BE LOCATED IN PUBLIC AND COMMON USE AREAS. WHERE EMPLOYEES HAVE AUDIBLE ALARMS, THE WIRING SHALL BE DESIGNATED SO VISIBLE ALARMS CAN BE INTEGRATED INTO THE SYSTEM, UNLESS GREATER STANDARDS ARE REQUIRED BY LOCAL AUTHORITIES.
24. OPERABLE PORTION OF CARD READER TO BE MOUNTED AT 48" OR BELOW WITH CLEAR FLOOR SPACE FOR FRONT OR PARALLEL APPROACH.
25. ALL SIGNS IDENTIFYING PERMANENT ROOMS OR SPACES ARE REQUIRED TO HAVE VISUAL AND RAISED CHARACTERS AND BRAILLE. SIGNAGE TO BE MOUNTED ON LATCH SIDE OF DOOR WITH THE BOTTOM OF THE BRAILLE NO LOWER THAN 48" AND THE BOTTOM OF THE HIGHEST TACTILE CHARACTER NO HIGHER THAN 60" AFF.
26. IN PUBLIC AREAS PROVIDED WITH WORK SURFACES ARE COUNTERS INTENDED FOR DINNING/DRINKING, AT LEAST 5% OF THE TABLES MUST BE ACCESSIBLE WITH COMPLIANT KNEE AND TOE CLEARANCE AN ACCESSIBLE ROUTE AND DISTRIBUTED THROUGHOUT THE SPACE.
27. ALL EQUIPMENT, FURNITURE AND MILLWORK INTENDED FOR CUSTOMER USE MUST MEET ALL CLEARANCES AND REACH RANGES AS DEFINED BY GOVERNING ACCESSIBILITY CODE OR LOCAL CODE; WHICHEVER IS STRICTER.
28. PROVIDE ACCESSIBLE FLOOR TRANSITIONS AT ALL LOCATIONS WHERE THERE IS A CHANGE IN FLOORING MATERIAL OR AT DOOR THRESHOLDS. THE CHANGE OF LEVEL BETWEEN MATERIALS MUST BE NO MORE THAN 1/4" OR UP TO 1/2" IF SLOPED NO MORE THAN 1:2.
29. ALL DATA AND POWER RECEPTACLES INTENDED FOR CUSTOMER ACCESS/ USE MUST BE INSTALLED WITHIN ACCESSIBLE REACH RANGES - SEE PLAN GENERAL NOTE 1.
30. WALL MOUNTED EQUIPMENT, FIXTURES, LIGHTING, ETC. BETWEEN 27" AND 80" AFF. SHALL NOT PROTRUDE MORE THAN 4" FROM THE WALL PER ACCESSIBILITY REQUIREMENTS.
31. ALL EQUIPMENT (INCLUDING COFFEE MACHINES, ATM MACHINES, ETC.), FURNITURE, AND MILLWORK INTENDED FOR CUSTOMER USE MUST BE ON AN ACCESSIBLE ROUTE AND MUST MEET ACCESSIBILITY STANDARDS FOR CLEAR FLOOR SPACE, REACH RANGE, OPERATING PARTS, AND KNEE AND TOE SPACE AS DEFINED BY ACCESSIBILITY REQUIREMENTS OR APPLICABLE LOCAL CODES, WHICHEVER IS STRICTER.
32. ALL EQUIPMENT INTENDED FOR CUSTOMER USE MUST BE PLACED SO THAT CONTROLS REQUIRED FOR USE ARE WITHIN ACCESSIBLE REACH RANGE. OWNER MUST VERIFY THAT ALL EQUIPMENT MEETS THESE REQUIREMENTS PRIOR TO INSTALLATION.

## GENERAL NOTES - SIGNAGE

1. 5/8" HIGH BY 1/32" RAISED LETTERING (UNLESS NOTED OTHERWISE)
2. GRADE 2 BRAILLE POSITIONED DIRECTLY BELOW TEXT, AND SHALL BE SEPARATED 3/8" MIN FROM ANY OTHER TACTILE CHARACTERS AND 3/8" MIN FROM RAISED BORDERS.
3. 1/32" RAISED PICTOGRAM WITH 70% CONTRASTING BETWEEN BACKGROUND AND TEXT. FINISH TO BE EGGSHELL
4. COLOR TO BE BLUE BACKGROUND WITH WHITE LETTERS
5. SEE ELEVATION FOR MOUNTING INFORMATION




ADA TURNING CLEARANCE | 1/2" = 1'-0" | 1




PRAXIS3
100 Peachtree St NW
Suite 1450
Atlanta, GA 30303
404-875-4500 tel
www.praxis3.com

STATE OF GEORGIA
STUART M. ROMM
07/02/26
CERTIFICATE NO. 34577
REGISTERED ARCHITECT

Copyright (c) 2026 Praxis3, LLC
All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by Praxis3 shall retain all common law, statutory and other reserved rights, including copyright thereto.
This drawing may not be reproduced in whole or in part without written permission of Praxis3. It is to be returned upon request. Scales as stated are valid on the original drawings.

| Rev | Date | Comments |
|---|---|---|
| | 07/02/2026 | PERMIT SET |

Client:
**FIFTH THIRD BANK**

Project Number: 26302
Project Name:
**WATSON BLVD.**

2711 WATSON BOULEVARD
WARNER ROBINS, GA 31093

Key Plan:

Sheet Title:
**ACCESSIBILITY NOTES**

Sheet Number:
**G-002**

7/8/2026 2:37:36 PM