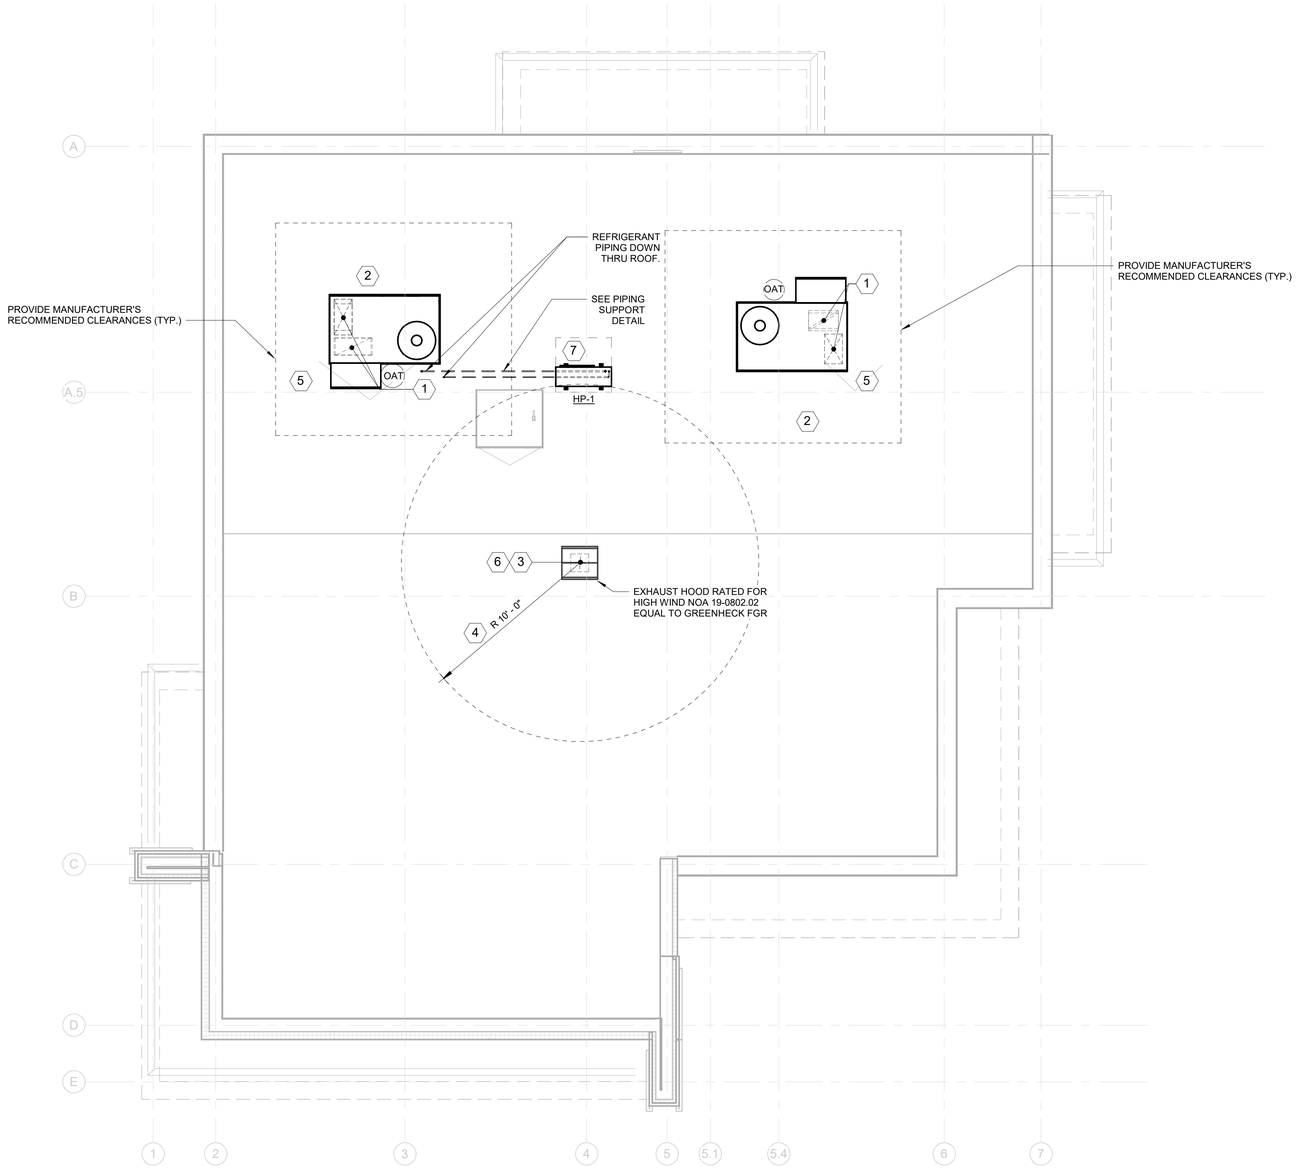


1 M-302 ROOF PLAN - MECHANICAL
1/4" = 1'-0"

MECHANICAL GENERAL NOTES
(APPLIES TO THIS SHEET ONLY)

1. RTU'S TO BE SCREENED BY NEW BUILDING PARAPET WALL SO THAT ROOF-MOUNTED EQUIPMENT IS OBSCURED FROM VIEW AT GRADE. SEE ARCHITECTURAL DRAWINGS.
2. ALL EXTERIOR-MOUNTED EQUIPMENT AND SUPPORTS SHALL COMPLY WITH APPLICABLE STATE AND LOCAL PRODUCT APPROVAL REQUIREMENTS, INCLUDING FLORIDA PRODUCT APPROVAL OR MIAMI-DADE NOA WHERE REQUIRED.

MECHANICAL KEY NOTES
(APPLIES TO THIS SHEET ONLY)

1. SUPPLY AND RETURN DUCT UP TO RTU ON ROOF. COORDINATE CURB FOOTPRINT WITH STRUCTURAL BEAMS.
2. PROVIDE 1-1/2" RTU CONDENSATE DRAIN WITH P-TRAP AND REMOVABLE VENTED CAP, ROUTE TO PRIMARY ROOF DRAIN.
3. EXHAUST DUCT UP TO EXHAUST FAN ON ROOF. COORDINATE CURB FOOTPRINT WITH STRUCTURAL BEAMS.
4. MAINTAIN 10' CLEARANCE FROM ALL EXHAUST OUTLETS TO FRESH AIR INTAKES.
5. INSTALL ROOFTOP AC UNIT ON 18" WIND-RATED ROOF CURBS. CURBS SHALL BE APPROVED FOR REQUIRED WIND LOADS PER APPLICABLE BUILDING CODE. AIRSOUTH COMMERCIAL UNITS STEEL CURBS (NOA 25-0410.04) OR EQUIVALENT.
6. GRAVITY VENTILATOR SHALL BE APPROVED FOR REQUIRED WIND LOADS PER APPLICABLE BUILDING CODE. EQUAL TO GREENHECK FGR (NOA 23-1122.03) OR LOREN COOK PR-8 FOR STANDARD WIND.
7. INSTALL HP ON WIND-RATED ROOF SUPPORT. SUPPORT SHALL BE APPROVED FOR REQUIRED WIND LOADS PER APPLICABLE BUILDING CODE. EQUIVALENT TO MIAMI-TECH INC. ASMU MECHANICAL UNIT STAND (NOA 24-0117.01).

PRAXIS3
100 Peachtree St NW
Suite 1450
Atlanta, GA 30303
404-875-4500 tel
www.praxis3.com

GEORGIA REGISTERED 032221 PROFESSIONAL ENGINEER GARRY M. JENKINS

Copyright (c) 2024 Praxis3, LLC

All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by Praxis3 shall retain all common law, statutory and other reserved rights, including copyright thereto.

This drawing may not be reproduced in whole or in part without written permission of Praxis3. It is to be returned upon request. Scales as stated are valid on the original drawings.

Rev	Date	Comments
	07/02/2026	PERMIT SET

Client:
FIFTH THIRD BANK

Project Number: 26032
Project Name:
FIFTH THIRD BANK WATSON 1,900 SF

2711 WATSON BOULEVARD
WARNER ROBBINS, GA 31093

Key Plan:

Sheet Title:
MECHANICAL PROPOSED ROOF PLAN

Sheet Number:
M-302

6/30/2026 4:54:58 PM