


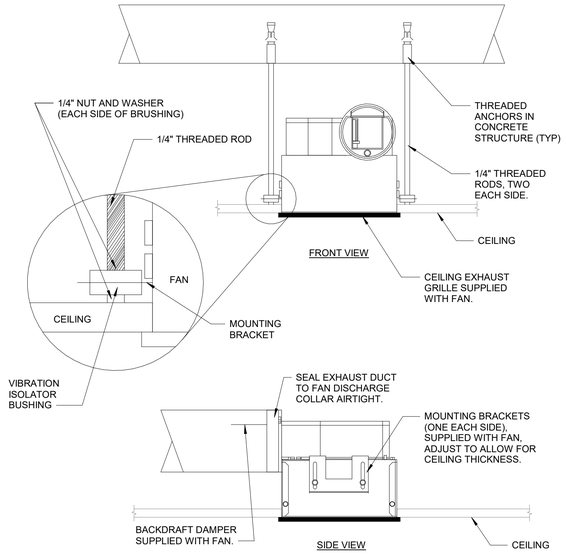


1 M-501 CEILING EXHAUST FAN DETAIL
NOT TO SCALE

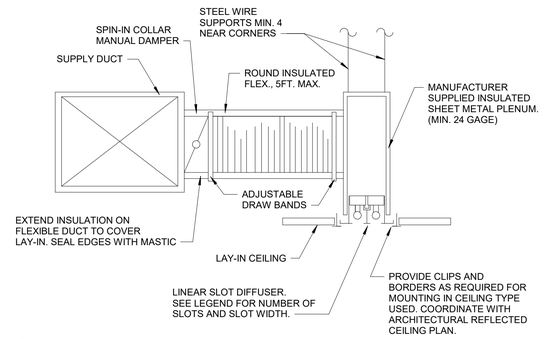


4 M-501 LINEAR SLOT CEILING DIFFUSER DETAIL
NOT TO SCALE

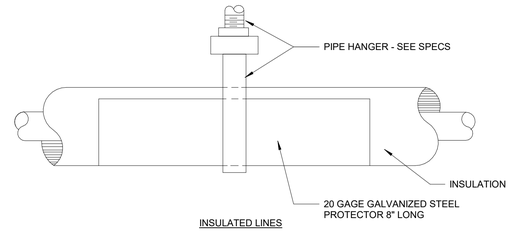

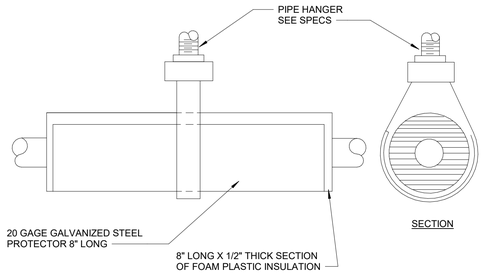


7 M-501 REFRIGERANT PIPING HANGER DETAIL
NOT TO SCALE

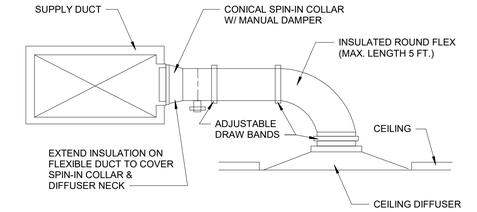


NOTES:

WHEREVER THE SUPPLY DUCT HEIGHT IS INSUFFICIENT TO CONNECT THE SPIN-IN, THE SPIN-IN MAY BE CONNECTED TO THE TOP OR BOTTOM OF THE DUCT. IF THE BRANCH DUCT MUST BE CONNECTED TO THE SIDE OF THE MAIN DUCT, USE A RECTANGULAR BRANCH DUCT CONNECTION OF EQUAL AIR VELOCITY AND TRANSITION TO ROUND DUCT. REFER TO SPECIFICATION FOR MAXIMUM TURNS IN FLEX DUCT.


10 M-501 CEILING DIFFUSER INSTALLATION DETAIL
NOT TO SCALE

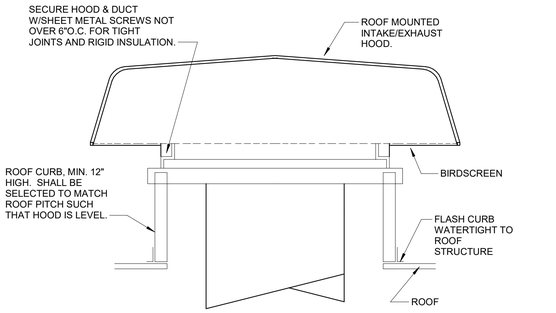


2 M-501 EXHAUST HOOD DETAIL
NOT TO SCALE

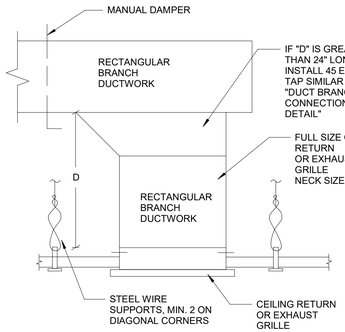

5 M-501 CEILING RETURN CONNECTION DETAIL
12" = 1'-0"

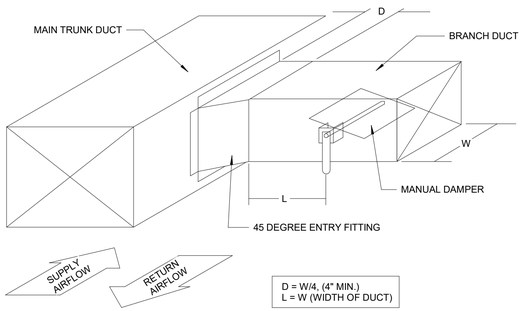


11 M-501 DUCT BRANCH CONNECTION
12" = 1'-0"

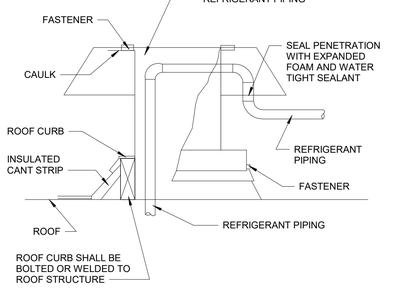

8 M-501 PIPE PENETRATION THRU ROOF
12" = 1'-0"


MINIMUM CONDENSATE PIPE SIZE	
AC TONS	MIN. DRAIN SIZE
0 TO 20	1"
21 TO 40	1-1/4"
41 TO 60	1-1/2"
61 TO 100	2"
101 TO 250	3"
251 & LARGER	4"

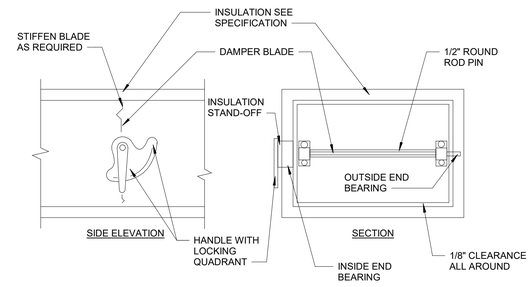

NOTES:

1. DELETE INSULATION STAND-OFF ON DUCTWORK WITHOUT EXTERIOR INSULATION.
2. DETIL SHOWS SINGLE BLAD DAMPER. DAMPER INSTALLATION SHALL BE SIMILAR FOR MULTI-BLADE DAMPERS & ROUND DAMPERS.
3. MANUAL DAMPERS SHALL BE EQUAL TO RUSKIN MD35 (FOR RECTANGULAR DUCTS) AND SHALL BE EQUAL TO RUSKIN MDRS25 (FOR ROUND DUCTS).


3 M-501 MANUAL DAMPER DETAIL
12" = 1'-0"

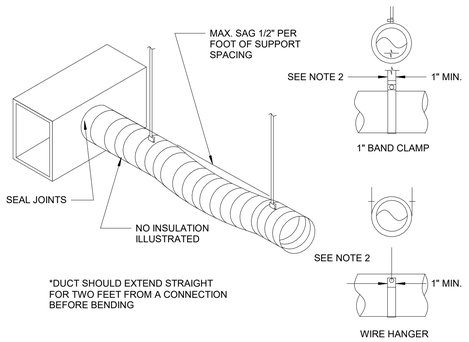


NOTES:

1. SUPPORT SYSTEM MUST NOT DAMAGE DUCT OR CASUE OUT OF ROUND SHAPE.
2. DUCTS ARE FLEXIBLE WITH EXTERNAL INSULATION AND VAPOR BARRIER JACKETING.
3. MIN. CENTER LINE BEND LINE RADIUS IS ONE DIA. (OR INSIDE RADIUS OF D/2).
4. FLEXIBLE DUCT LENGTH SHALL NOT EXCEED 5 LINEAR FEET.

6 M-501 FLEXIBLE DUCT SUPPORT DETAIL
12" = 1'-0"

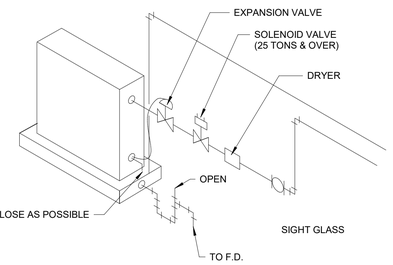

9 M-501 DX COIL PIPING DETAIL
12" = 1'-0"

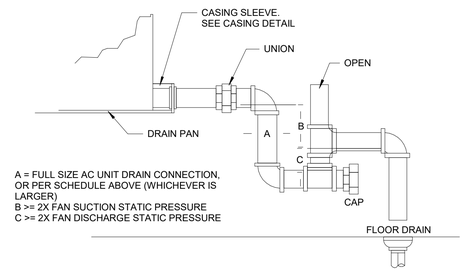

12 M-501 AC UNIT DRAIN TRAP DETAIL
12" = 1'-0"

6/30/2026 4:55:03 PM

PRAXIS3
100 Peachtree St NW
Suite 1450
Atlanta, GA 30303
404-875-4500 tel
www.praxis3.com

GEORGIA REGISTERED 032221 PROFESSIONAL ENGINEER GARRY M. JENKINS

Copyright (c) 2024 Praxis3, LLC

All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by Praxis3 shall retain all common law, statutory and other reserved rights, including copyright thereto.

This drawing may not be reproduced in whole or in part without written permission of Praxis3. It is to be returned upon request. Scales as stated are valid on the original drawings.

Rev	Date	Comments
	07/02/2026	PERMIT SET

Client:
FIFTH THIRD BANK

Project Number: 26032
Project Name:
FIFTH THIRD BANK WATSON 1,900 SF

2711 WATSON BOULEVARD
WARNER ROBBINS, GA 31093

Key Plan:

Sheet Title:
MECHANICAL DETAILS

Sheet Number:
M-501