


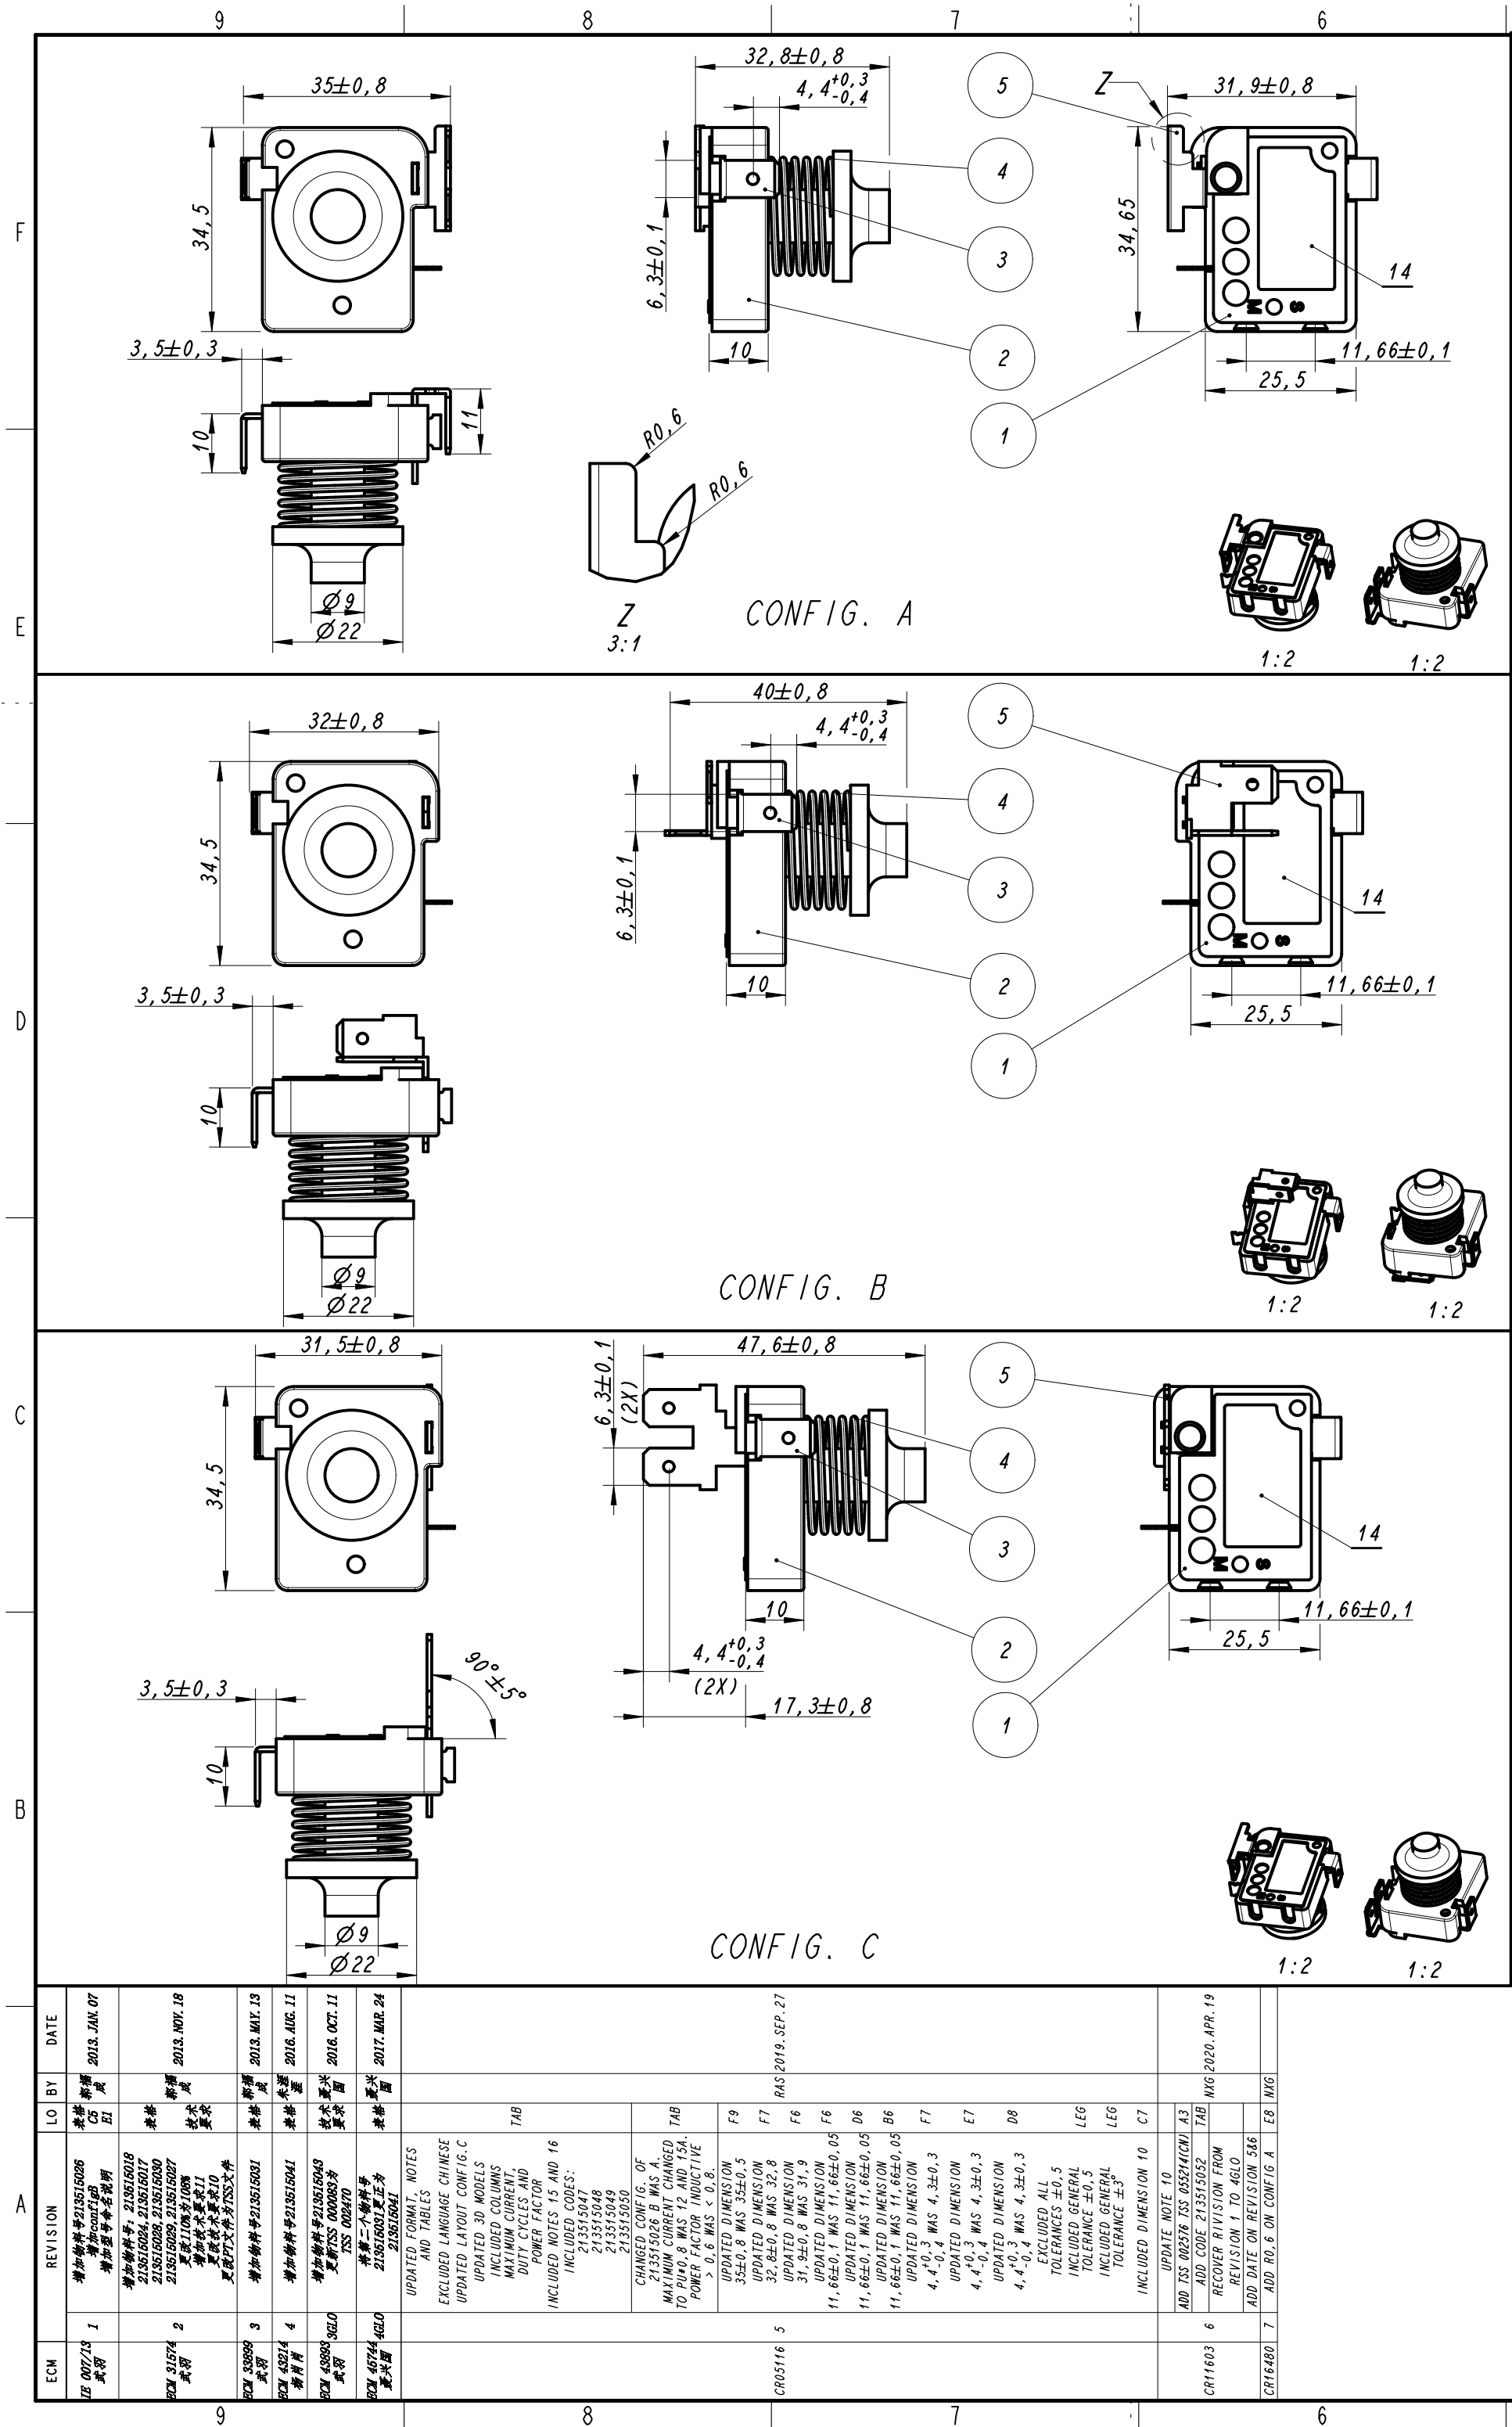

CODE	MODEL	MAX. PICK-UP AMPERE (A)	MIN. DROP-OUT AMPERE (A)	CONFIG.	PICK-UP/ DROP-OUT	MAXIMUM CURRENT (ELECTRICAL CONTACT) AMPERE (A)	DUTY CYCLES	POWER FACTOR INDUCTIVE
213515041	QL2-2.00	2.00	1.50	A	108x1	1.6	500.000 CYCLES	> 0,6
213515017	QL2-2.55	2.55	1.98			2.04		
213515018	QL2-3.40	3.40	2.62			2.72		
213515015	QL2-3.75	3.75	2.95			3.0		
213515019	QL2-3.76	3.76	3.15			3.01		
213515028	QL2-3.90	3.90	3.10			3.12		
213515024	QL2-4.05	4.05	3.13			3.24		
213515020	QL2-4.35	4.35	3.55			3.48		
213515025	QL2-4.55	4.55	3.50			3.64		
213515026	QL2-4.55	4.55	3.50	B		3.64		
213515030	QL2-4.80	4.80	3.73	A		3.84		
	QL2-6.30	6.30	5.00			5.04		
213515031	QL2-6.40	6.40	5.35	B	5.12			
213515043	QL2-6.40	6.40	5.35	C	5.12			
213515016	QL2-7.10	7.10	5.60	A	5.68			
213515029	QL2-7.50	7.50	6.00		6.0			
213515047	QL2-8.10	8.10	6.60		6.48			
	QL2-8.40	8.40	6.70		6.72			
213515048	QL2-9.10	9.10	7.40		7.28			
213515049	QL2-9.50	9.50	7.70		7.6			
213515027	QL2-11.90	11.90	8.55		9.52			
213515050	QL2-16.00	16.00	12.60		12.8			
213515052	QL2-6.40	6.40	5.35		5.12			

NOTES:

1 - DRAWING ACCORDING TO ISO STANDARDS, SEE TSS 002513.

2 - DIMENSIONS AND SPECIFICATIONS SIGNED WITH $\nabla \nabla \oplus$, SEE TSS 002470.

3 - REQUIREMENTS ABOUT HAZARDOUS SUBSTANCES ACCORDING TO TSS 002420. $\oplus$

4 - HFC MANDATORY REQUIREMENTS ACCORDING TO TSS 002369. ∇

5 - IDENTIFICATION SHOULD BE READABLE AND OF EASY VISUALIZATION.

6 - THE DATE OF PRODUCTION SHOULD BE INDICATED ACCORDING TO AAMDD FORMAT.
AA ARE THE LAST TWO NUMBERS OF THE PRODUCTION YEAR, MM IS THE MONTH OF PRODUCTION AND DD IS THE DAY OF PRODUCTION.

7 - METAL PARTS MUST BE RESISTANT TO SALT SPRAY TEST, IN ACCORDING SOP 009326.

8 - COMPONENT MUST HAVE FOLLOWING CERTIFICATES: VDE (IN ALTERNATIVE KEMA, IMQ), cURus (IN ALTERNATIVE UL+CSA), CQC.

9 - COMPONENT MUST BE APPROVED ACCORDING TO IEC/EN 60079-15 - REQUIREMENT FOR FLAMMABLE REFRIGERANTS.

10 - THE MAXIMUM VALUE OF FIRST INSERTION SHOULD BE UNDER 100N (TWO PIN), THE PIN DIAMETER OF TESTER IS $2.26^{+0.005}_{-0}$ mm.
FOR 213515019 AND 213515020, THE VALUE OF FIRST INSERTION SHOULD BE BETWEEN 60N AND 120N(TWO PIN), THE VALUE OF FIFTH WITHDRAW SHOULD ABOVE 38N(TWO PIN), ACCORDING TO TSS 055214.

11 - BODY AND COVER MUST USE THE MATERIAL THAT SATISFY GLOW WIRE TEST 750°C, 850°C AND CTI > 250V.

12 - MEASUREMENT OF MINIMUM STABILITY LIMIT CURRENT/ MEASUREMENT OF PICK UP CURRENT > 180%.

13 - CONFIG. C RELAY SHOULD ENDURE 19,2N (NORMAL DIRECTION), NO HAPPEN FAILURE LIKE SHAPE CHANGE, LOOSE AND SO ON.

14 - IDENTIFICATION OF MODEL AND DATE OF PRODUCTION.

15 - THE CURRENT RELAY APPROVAL ROUTINE ACCORDING TO TSS 002576.

16 - THE TERMINALS SPECIFICATIONS ACCORDING TO IEC 61210 - CONNECTING DEVICES.

05	RELAY - TERMINAL CAPACITOR
04	RELAY - COIL (COPPER)
03	RELAY - TERMINAL
02	RELAY - BODY
01	RELAY - COVER
POS.	DENOMINATION

MATERIAL : SEE COMPONENTS		embraco Nidec		GEN. TOL. : ±0,5	
CODE : TSS 002576 TSS 055214(CN)				ANG. TOL. : ±3°	
				SCALE : 1:1	
				UNIT: mm	 A2
DRAWN : GUO FUCHENG		TITLE, DOCUMENT TYPE TY - RELAY - ASSEMBLY		REPLACE:	
APP.: YUAN GUIYING				No. 213515020	
ECM : 1E 579/12				SHEET NUMBER: 1 OF 1	
DATE : 2012.OCT.24		THIS MATERIAL IS CONFIDENTIAL AND PROPRIETARY TO EMBRACO, AND MAY NOT BE REPRODUCED, DISCLOSED, DISTRIBUTED OR USED WITHOUT PERMISSION			